

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8003050442 DOC. DATE: 80/02/26 NOTARIZED: NO DOCKET #
 FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co. 05000269
 50-270 Oconee Nuclear Station, Unit 2, Duke Power Co. 05000270
 50-287 Oconee Nuclear Station, Unit 3, Duke Power Co. 05000287

AUTH. NAME: AUTHOR AFFILIATION
 PARKER, W.O. Duke Power Co.
 RECIP. NAME: RECIPIENT AFFILIATION
 REID, R.W. Operating Reactors Branch 4


SUBJECT: Forwards "Fire Qualification Test on Silicone Foam Floor Penetration Seals." Describes testing which successfully demonstrated 3-h fire rating for installed cable penetration fire stops. *see Rpt*

DISTRIBUTION CODE: A006S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+450
 TITLE: Fire Protection Information (After Issuance of OP. Lic.)

NOTES: M. CUNNINGHAM - ALL AMENDS TO FSAR + CHANGES TO TECH SPECS. R. CAPRA. ICY

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL		ID CODE/NAME	LTR
ACTION:	05 BC ORB #4	4	4			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	09 I&E	2	2	12 AUXIL SYS BR	2	2
	14 PLANT SYS BR	5	5	19 WAMBACH	1	1
	20 MURANAKA, R	1	1	OELD	1	0
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	22 ACRS	16	16			

MAR 6 1980



TOTAL NUMBER OF COPIES REQUIRED: LTR 37 ENCL 36
36 35

MA

DUKE POWER COMPANY
POWER BUILDING
422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

February 26, 1980

TELEPHONE: AREA 704
373-4083

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555


Attention: Mr. R. W. Reid, Chief
Operating Reactors Branch No. 4

Re: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287

Dear Sir:

Please find attached a copy of the "Fire Qualification Test on Silicone Foam Floor Penetration Seals" for Oconee Nuclear Station prepared by the Southwest Research Institute. This report is submitted in response to Item 3.1.13 of the Fire Protection Safety Evaluation Report for Oconee issued August 11, 1978. The report describes the testing which successfully demonstrated the three-hour fire rating for the installed cable penetration firestops.

Very truly yours,

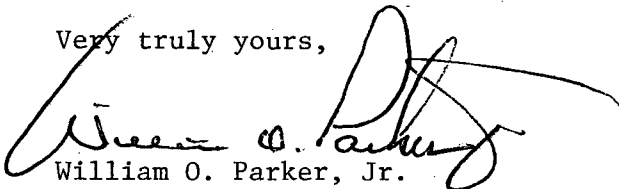
William O. Parker, Jr.

SRL:scs

Attachment

A006
S
1/1

8003050

F

442