

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8104210228 DOC. DATE: 81/04/13 NOTARIZED: NO  
 FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co.  
 AUTH. NAME: PARKER, W.O. AUTHOR AFFILIATION: Duke Power Co.  
 RECIP. NAME: DENTON, H.R. RECIPIENT AFFILIATION: Office of Nuclear Reactor Regulation, Director  
 STOLZ, J.F. Operating Reactors Branch 4

DOCKET #  
05000269

SUBJECT: Notifies that unit will shut down for refueling, implementation of several mods & performance of certain 10-yr inservice insps. Ltr documents position re performance of Type A leak testing during Summer 1981 outage.

DISTRIBUTION CODE: A017S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2  
 TITLE: Containment Leak Rate Testing - Appendix J

NOTES: AEOD, Ornstein: 1cc.

05000269

*ADD: D. Choney 1 0*

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
ACTION:	ORB #4 BC 04	7		
INTERNAL:	A/D CORE & CS11	1	CONT SYS BR 09	1
	I&E 06	2	NRC PDR 02	1
	OELD 13	1	OR ASSESS BR 07	1
	PROC/TST REV 08	1	<u>REG FILE</u> 01	1
EXTERNAL:	ACRS 12	16	LPDR 03	1
	NSIC 05	1		

APR 1981

TOTAL NUMBER OF COPIES REQUIRED: LTR 36 ENCL 0

*KB*

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.  
VICE PRESIDENT  
STEAM PRODUCTION

April 13, 1981

TELEPHONE: AREA 704  
373-4083

Mr. Harold R. Denton, Director  
Office of Nuclear Reactor Regulation  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555

Attention: Mr. J. F. Stolz, Chief  
Operating Reactors Branch No. 4


Re: Oconee Nuclear Station; Unit 1  
Docket No. 50-269

Dear Sir:

Duke Power will shut down Oconee Unit 1 this summer for refueling, implementation of several significant modifications, and the performance of certain 10-year in-service inspections. With regard to this last item, it is planned to do a portion of this inspection work this coming outage with the remainder of the 10-year in-service inspections being completed during the next refueling outage, currently planned for early 1983. The purpose of this letter is to document our position concerning the performance of a Type A leak test during the outage for the 10-year inspections.

10 CFR 50, Appendix J, III.D.1.(a) requires a Type A test "... at approximately equal intervals during each 10-year service period. The third test of each set shall be conducted when the plant is shutdown for the 10-year plant in-service inspections."

The code does not explicitly address multiple outages to conduct the 10-year inspections. Because the last Oconee 1 test was completed February 11, 1980, and in consideration of the requirement to conduct such tests on approximately equal intervals, the third Type A test of Oconee 1 will be conducted during the early 1983 refueling outage rather than the summer 1981 outage. This plan is deemed preferable and, as both outages together will be used to complete all 10-year inspection requirements, is considered to be within the Appendix J requirements.

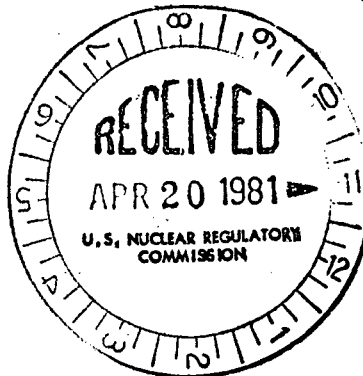

A017  
5/10  
ADD: CE  
D CHANEY 10


810.421022

P

Mr. Harold R. Denton, Director  
Page 2

Unless informed to the contrary, Duke Power considers this position to be acceptable to the NRC.

Very truly yours,

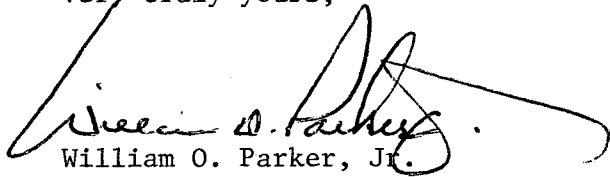

William O. Parker, Jr.

RLG:pw

cc: Director  
Office of Inspection and Enforcement  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555