


H
G
F
E
D
C
B
A

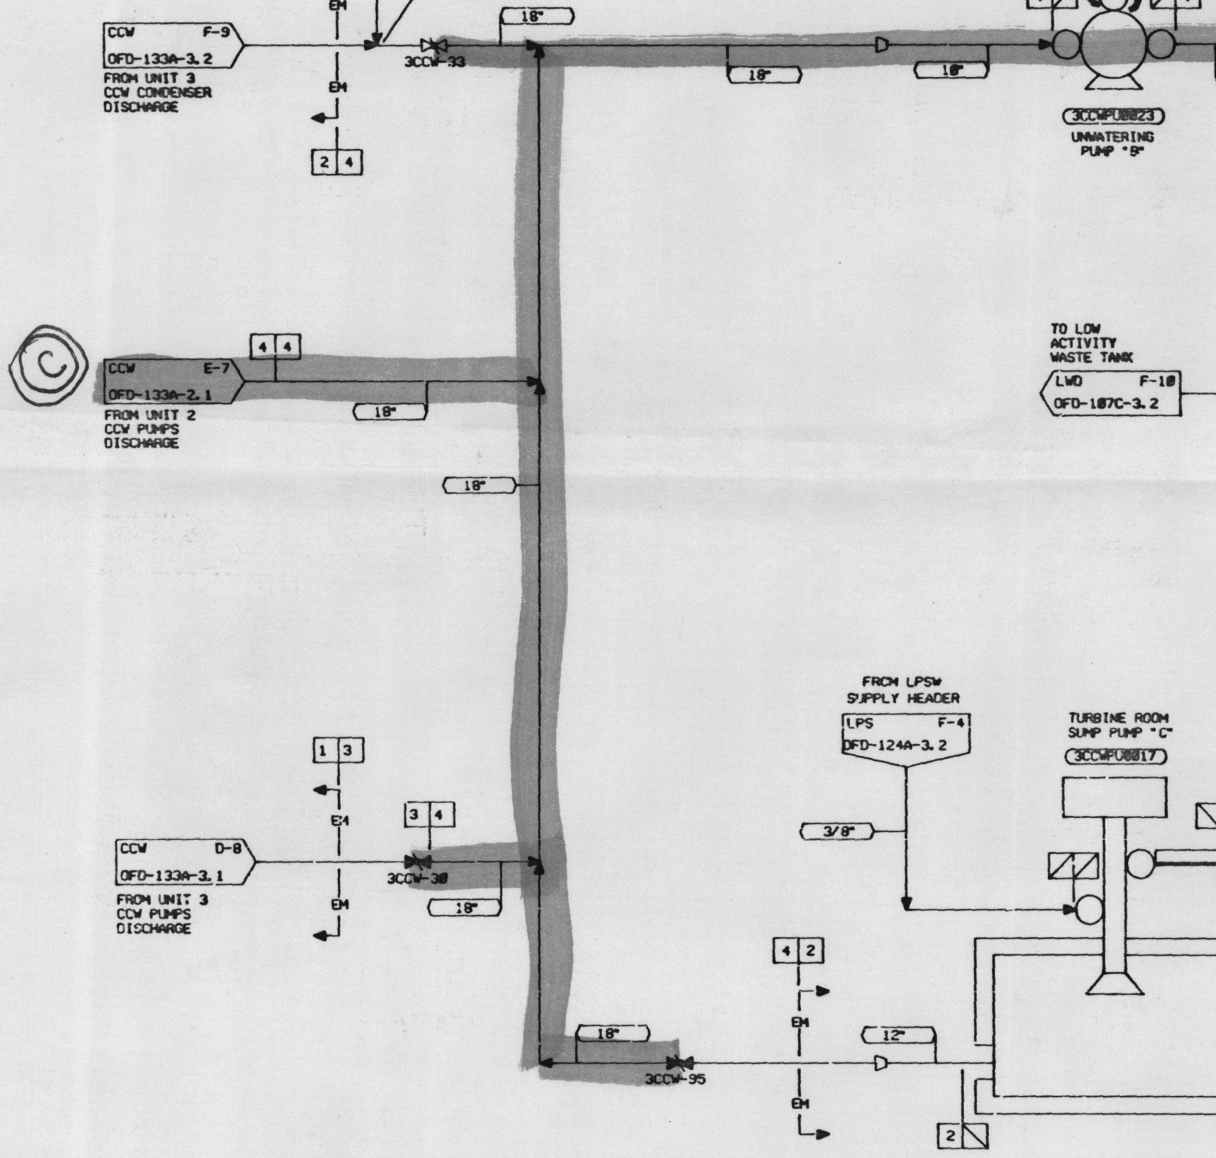

NOTES:

1. OPERATING MODE REPRESENTED BY BOLD LINES: NORMAL. TURBINE ROOM SUMP PUMP DISCHARGE TO YARD DRAIN.
2. 1/2" THRU 2" SCH. = XS
2 1/2" THRU 10" SCH. = 40
12" THRU 24" SCH. = STD.
3. 1/2" THRU 2" SCH. = 08
2 1/2" THRU 10" SCH. = 40
12" THRU 24" SCH. = STD.
4. PIPING COVERED BY CIVIL/ENVIRONMENTAL DIVISION SPECIFICATION NO. OSS-0127.00-00-0000 AND/OR ITEM NO. 12B.
5. THE ORIGINAL ISSUE OF THIS DRAWING IS BASED ON PD-133B, REV. 2B.
6. 1/2" THRU 10" SCH. = 40
7. STAINLESS STEEL (PS-151.4) MAY BE SUBSTITUTED FOR PIPE SIZES 1/2" THRU 6".

DESIGN PARAMETERS

LINE NO.	LINE CLASS	DESIGN PRESS.	DESIGN TEMP.	MATERIAL	SPE.
1	NOTE 4	---	---	CS	N
2	NOTE 4	---	---	CS	N
3	F	50 PSIG	100°F	CS (NOTE 7)	1
4	G	50 PSIG	100°F	CS (NOTE 7)	1
6	G	225 PSIG	150°F	CS (NOTE 7)	1
9	G	100 PSIG	100°F	CS (NOTE 7)	1
17	G	100 PSIG	150°F	CS (NOTE 7)	1

ERNCOX000LSE

1 | 2 | 3 | 4 | 5 | 6