


In the Matter of: Entergy Nuclear Operations, Inc. (Indian Point Nuclear Generating Units 2 and 3)	
	ASLBP #: 07-858-03-LR-BD01
	Docket #: 05000247 05000286
	Exhibit #: NYS000566-00-BD01
	Admitted: 11/5/2015
	Rejected: 11/5/2015
Other:	Identified: 11/5/2015 Withdrawn: Stricken:

FIGURE 1

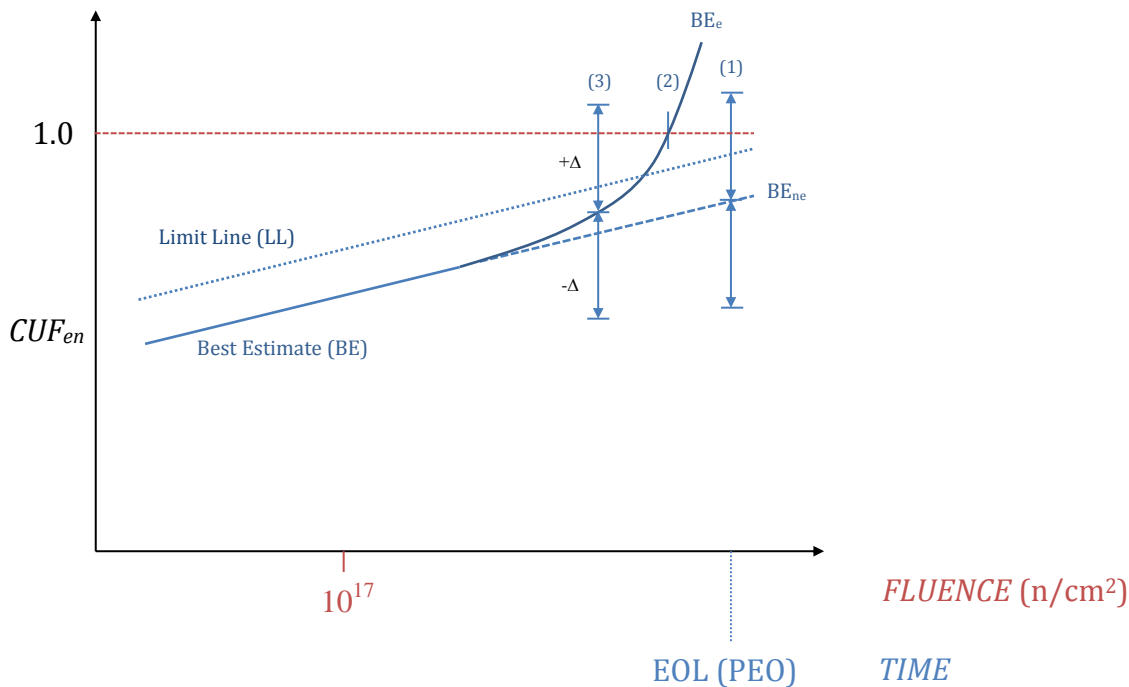


Figure 1: Comparison of Limit Line (LL) and Best Estimate (BE) predictions, with embrittlement (BE_e) and without embrittlement (BE_{ne}).

Note:

- (1) BE_{ne} predicts possible failure at end of life (EOL).
- (2) BE_e predicts failure ($CUF_{en} = 1.0$) before end of life.
- (3) BE_e predicts possible failure well before end of life.