

Overview of Spent Fuel Pool Design for the APR1400

1. Introduction
2. Codes and Standards
3. Load and Load Combinations
4. Analysis
5. Design

DRAFT

1. Introduction

- The purpose of this presentation is to present an overview of the analysis and design of the APR1400 spent fuel pool (SFP).

DRAFT


1) SFP Configuration

TS

DRAFT

2) Description of SFP

- 35 ft x 42 ft x 42 ft with a depth of 42 ft (EL.114'- 0" to 156'- 0")
- Interior surface - stainless steel liner plates
- Liner system and its anchorage system for form work and leak tight membrane

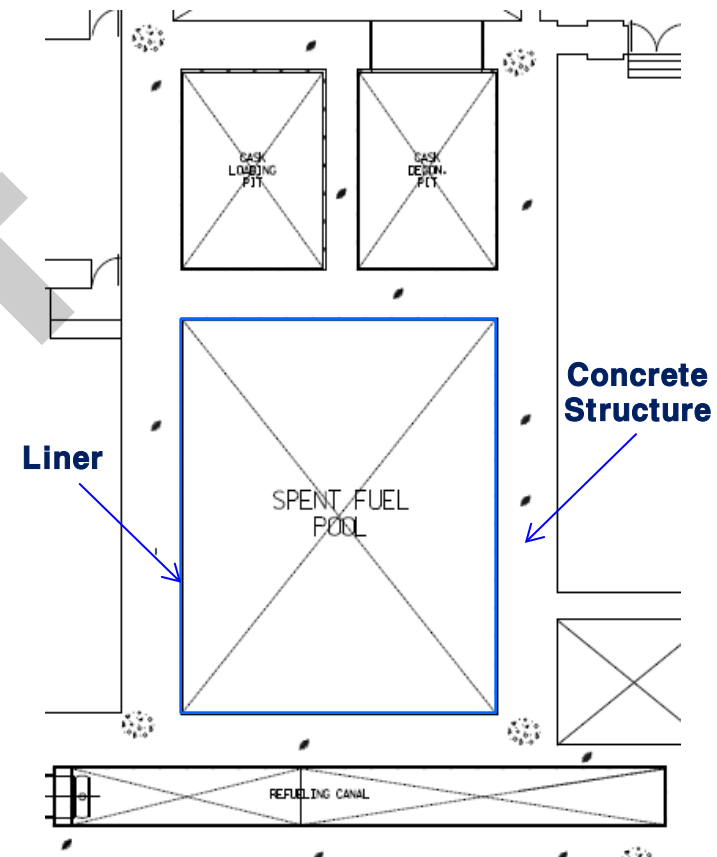


PLAN

2) Description of SFP (Cont'd)


Liner

Details of
Shin-Kori units 3&4

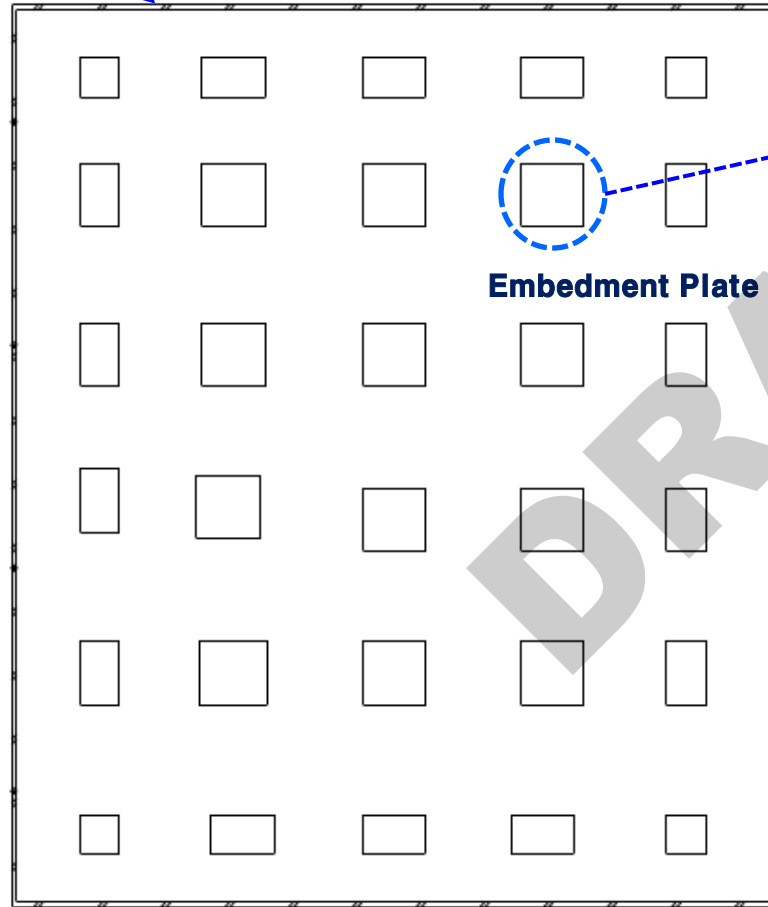


Embedment Plate

A

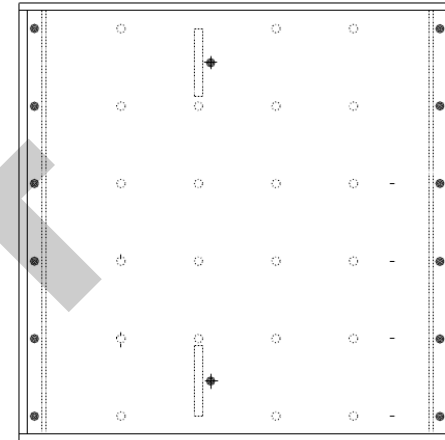

Detail of Embedment Plate

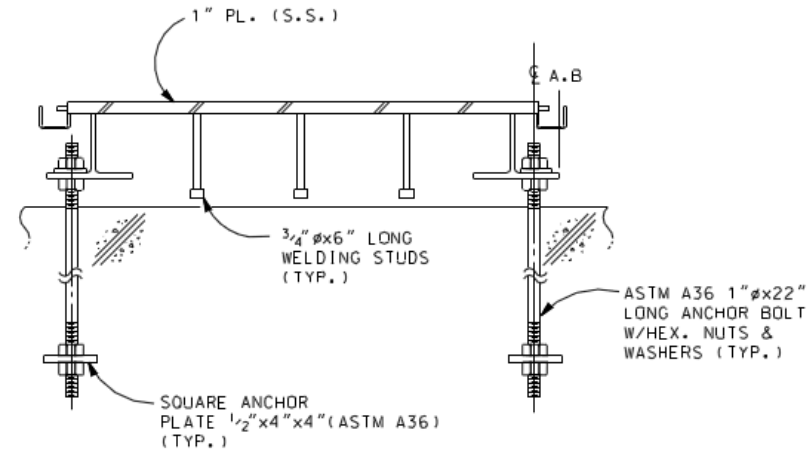

PLAN of SFP Floor

Section A

2. Codes and Standards

DRAFT

2 Codes and Standards

- **ASME Section III, Division 2, Subsection CC**: Code for Concrete Containments, ASME, 2001 Edition with the 2003 Addenda
- **ACI 349**: Code Requirements for Nuclear Safety-Related Concrete Structures, ACI, 1997, including Appendix B (2001)
- **AISC N690**: Specification for the Design, Fabrication, And Erection of Steel Safety-related Structures for Nuclear Facilities, including Supplement 2 (2004), ANSI/AISC, 1994

DRAFT

3. Loads and Load Combinations

DRAFT

1) Loads

- Dead Load (D)
- Hydro-static Loads (L_h)
- Thermal Loads due to Spent Fuel Decay Heat (T_o, T_a)
- Safety Shutdown Earthquake including Hydro-dynamic Water Pressure (E_s)

DRAFT

2) Load Combinations

- Concrete Structure Design
 - ✓ Normal Condition : $1.1 D + 1.1 L_h + 1.2 T_o$
 - ✓ Abnormal Condition : $1.0 D + 1.0 L_h + 1.0 T_a$
 - ✓ Abnormal/Extreme Environmental
: $1.0 D + 1.0 L_h + 1.0 T_a + 1.0 E_s$
- Liner Design
 - ✓ Normal Condition : $1.0 D + 1.3 T_o$
 - ✓ Abnormal Condition : $1.0 D + 1.0 T_a$

4. Analysis

- 1) Global Structural Analysis
- 2) Thermal Analysis
- 3) Hydro-dynamic analysis

DRAFT

1) Global Structural Analysis

This analysis is performed to compute all member forces of shear walls in the AB.

TS

DRAFT

1) Global Structural Analysis (Cont'd)


- Accidental Torsion
 - Accidental torsional moment : Story inertia force X 5% of the building plan dimension
 - Accidental torsional moments are applied at the mass center of each floor elevation.

TS

DRAFT




2) Thermal analysis

- For thermal analysis, following stage is considered.

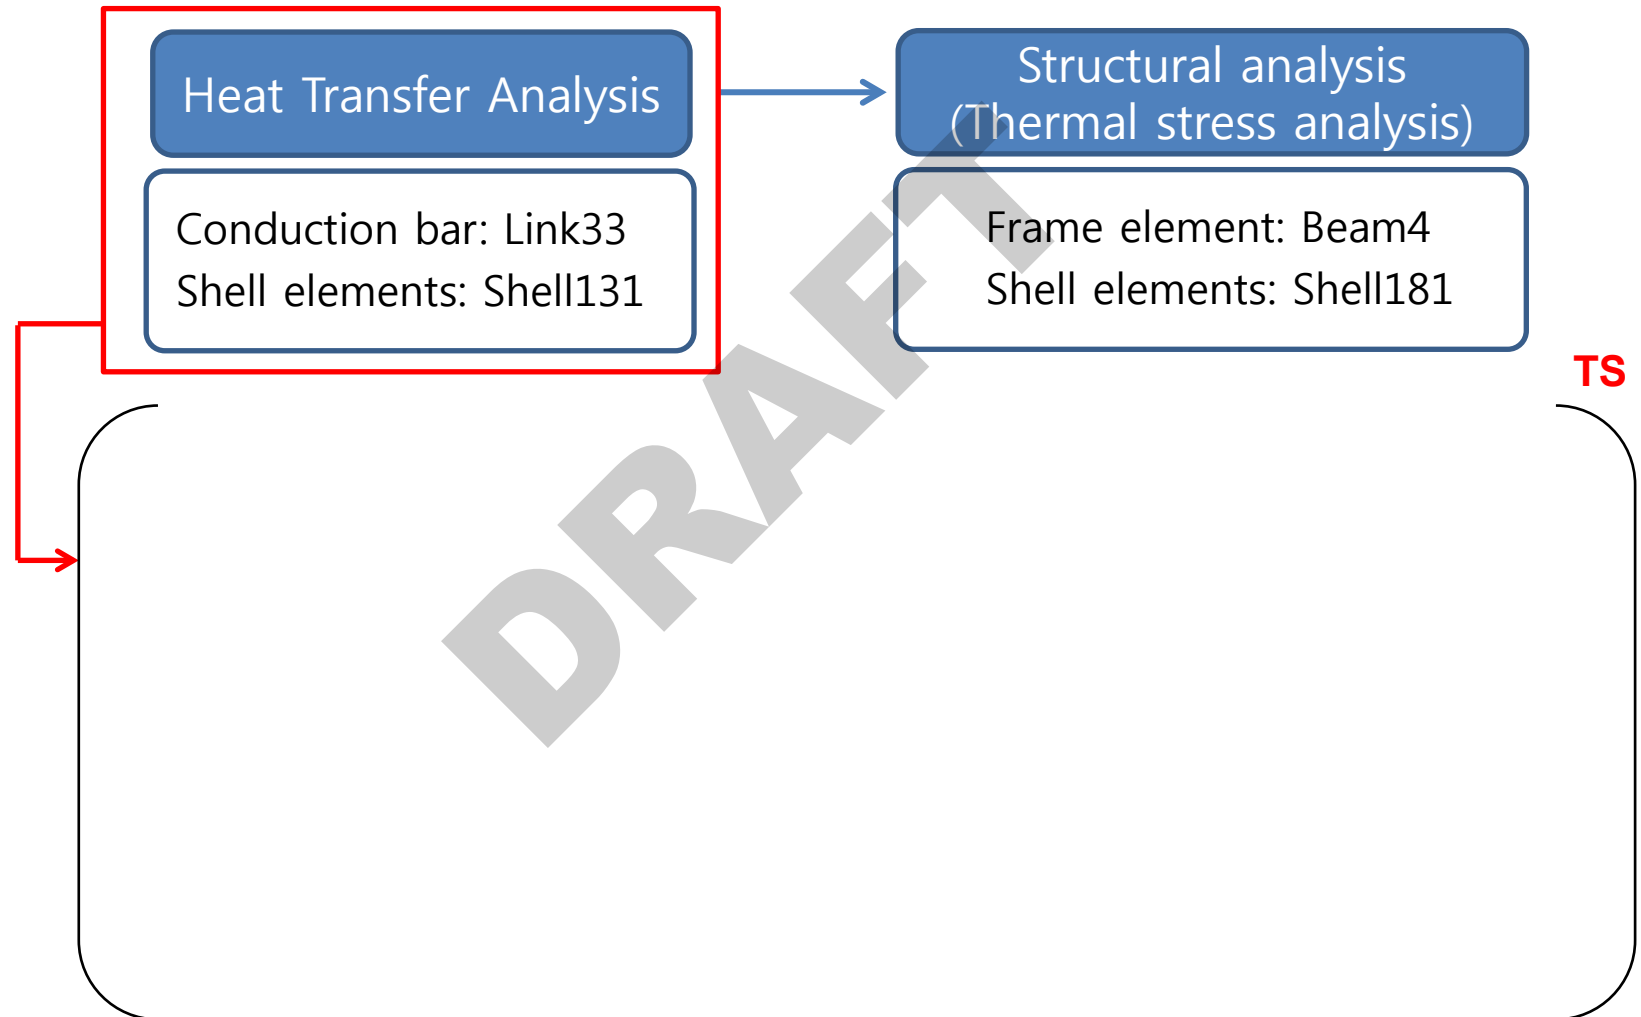

2) Thermal analysis (cont'd)

- For thermal analysis, following stage is considered.

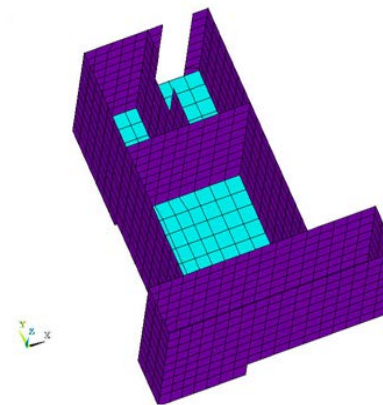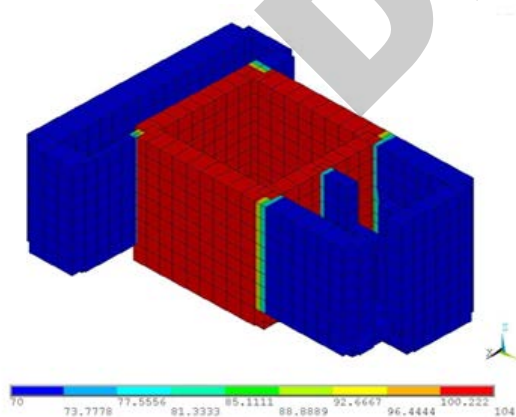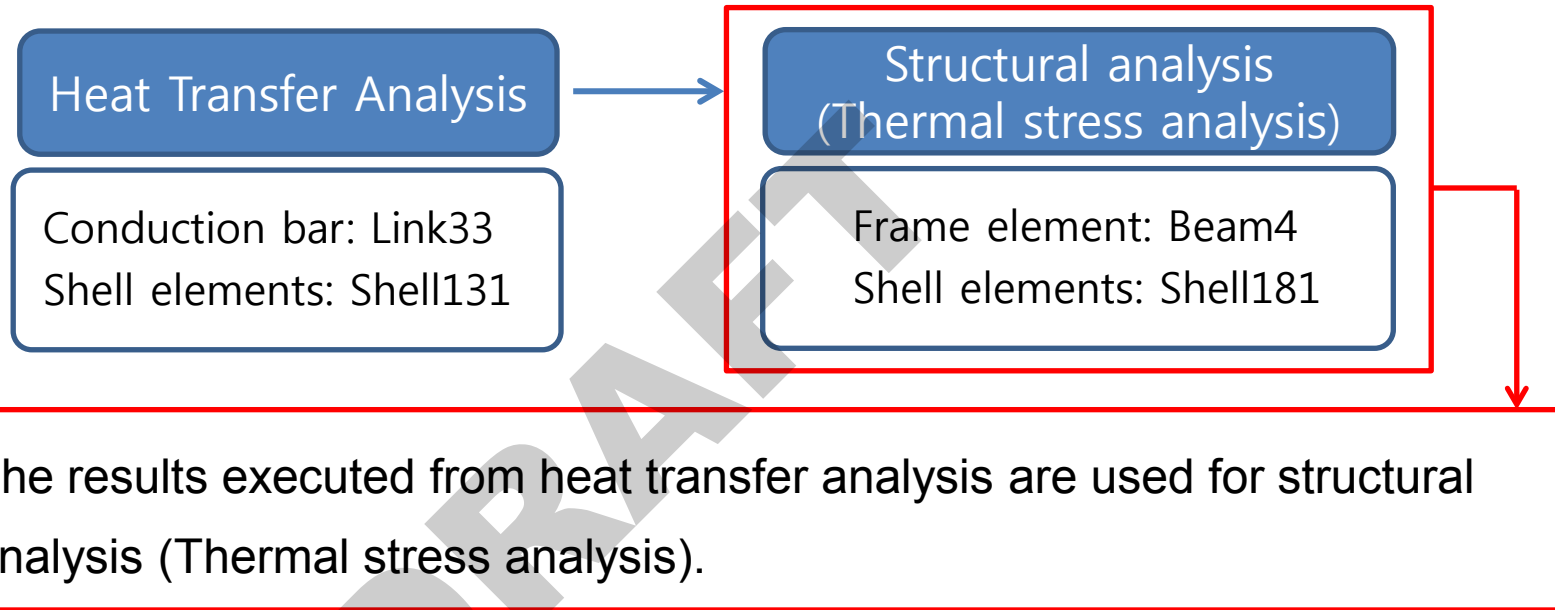


3) Hydro-dynamic analysis

- The purpose of analysis is to perform the structural analysis considering water pressures (Hydro-static load, Hydro-dynamic load)

Load	Remark
Hydro-static load	$P = \gamma_w \times \Delta H$
Hydro-dynamic load	Hydro-dynamic pressure corresponding to the impulsive, convective and wall inertia are defined according to code TID-7024.
Analysis method	Modal analysis (for Fundamental period), Static analysis (for Member force)

- These loads are applied to the surface of SFP, Cask loading pit and Refueling Canal FE model as surface load.

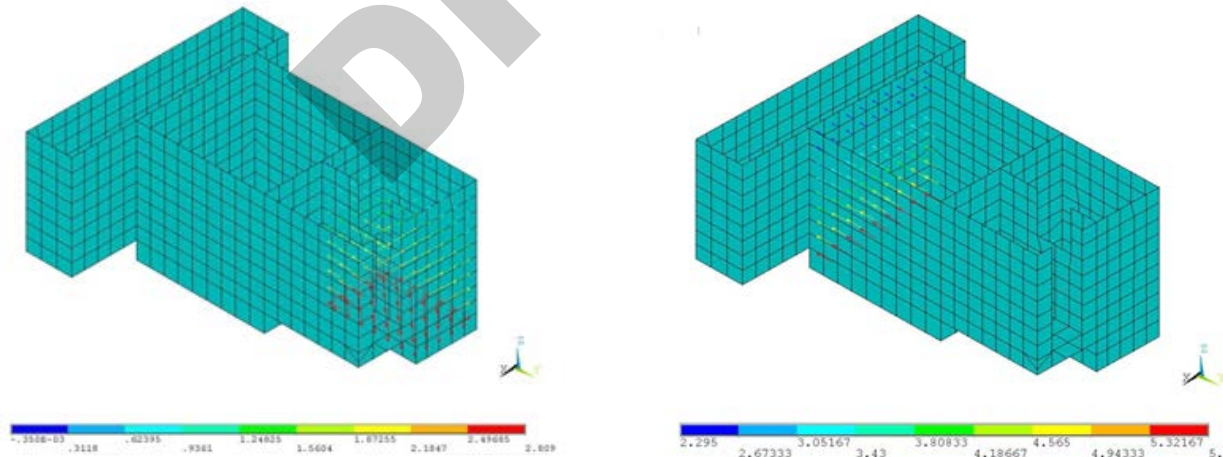

5. Design

- 1) Concrete Structure Design
- 2) Liner Design

DRAFT

1) Concrete Structure Design


West Wall of SFP

- ✓ Dimension : EL.114 ft. to EL.156 ft. in 7 ft. thickness
- ✓ Max. re-bar arrangement : 2#14 @ 9" in horizontal direction
- ✓ Max. shear re-bars : #5 @ 12"

DRAFT

2) Liner Design

- Form type of 1/4 inch thickness (wall)
- Wallpaper type of 3/16 inch thickness (slab)
- Leak Chase System

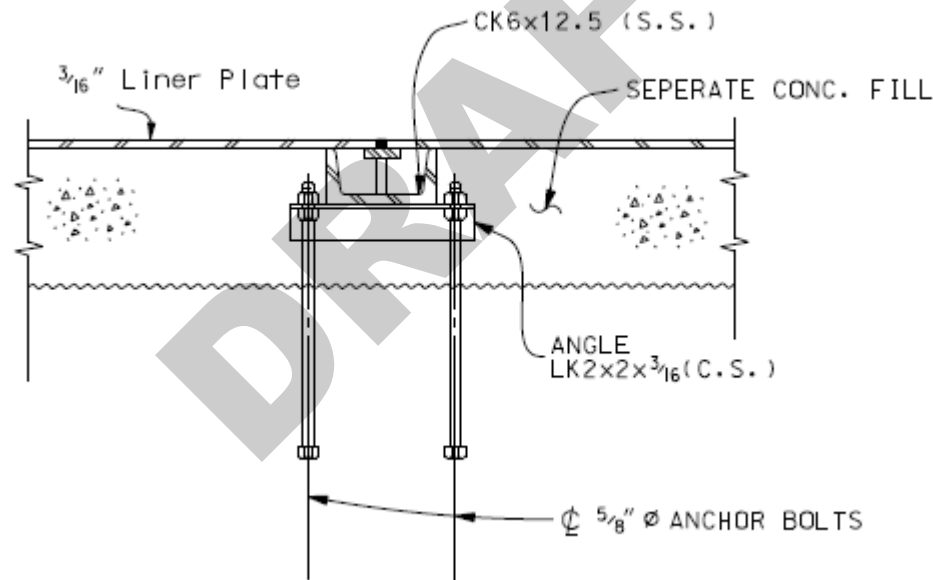

Details of Shin-Kori units 3&4