


Comparison of Suspension Logging Vs Results in Adjacent Boreholes at LNP 1: Mud Rotary (Borehole A-19) and Sonic (Borehole I-06)

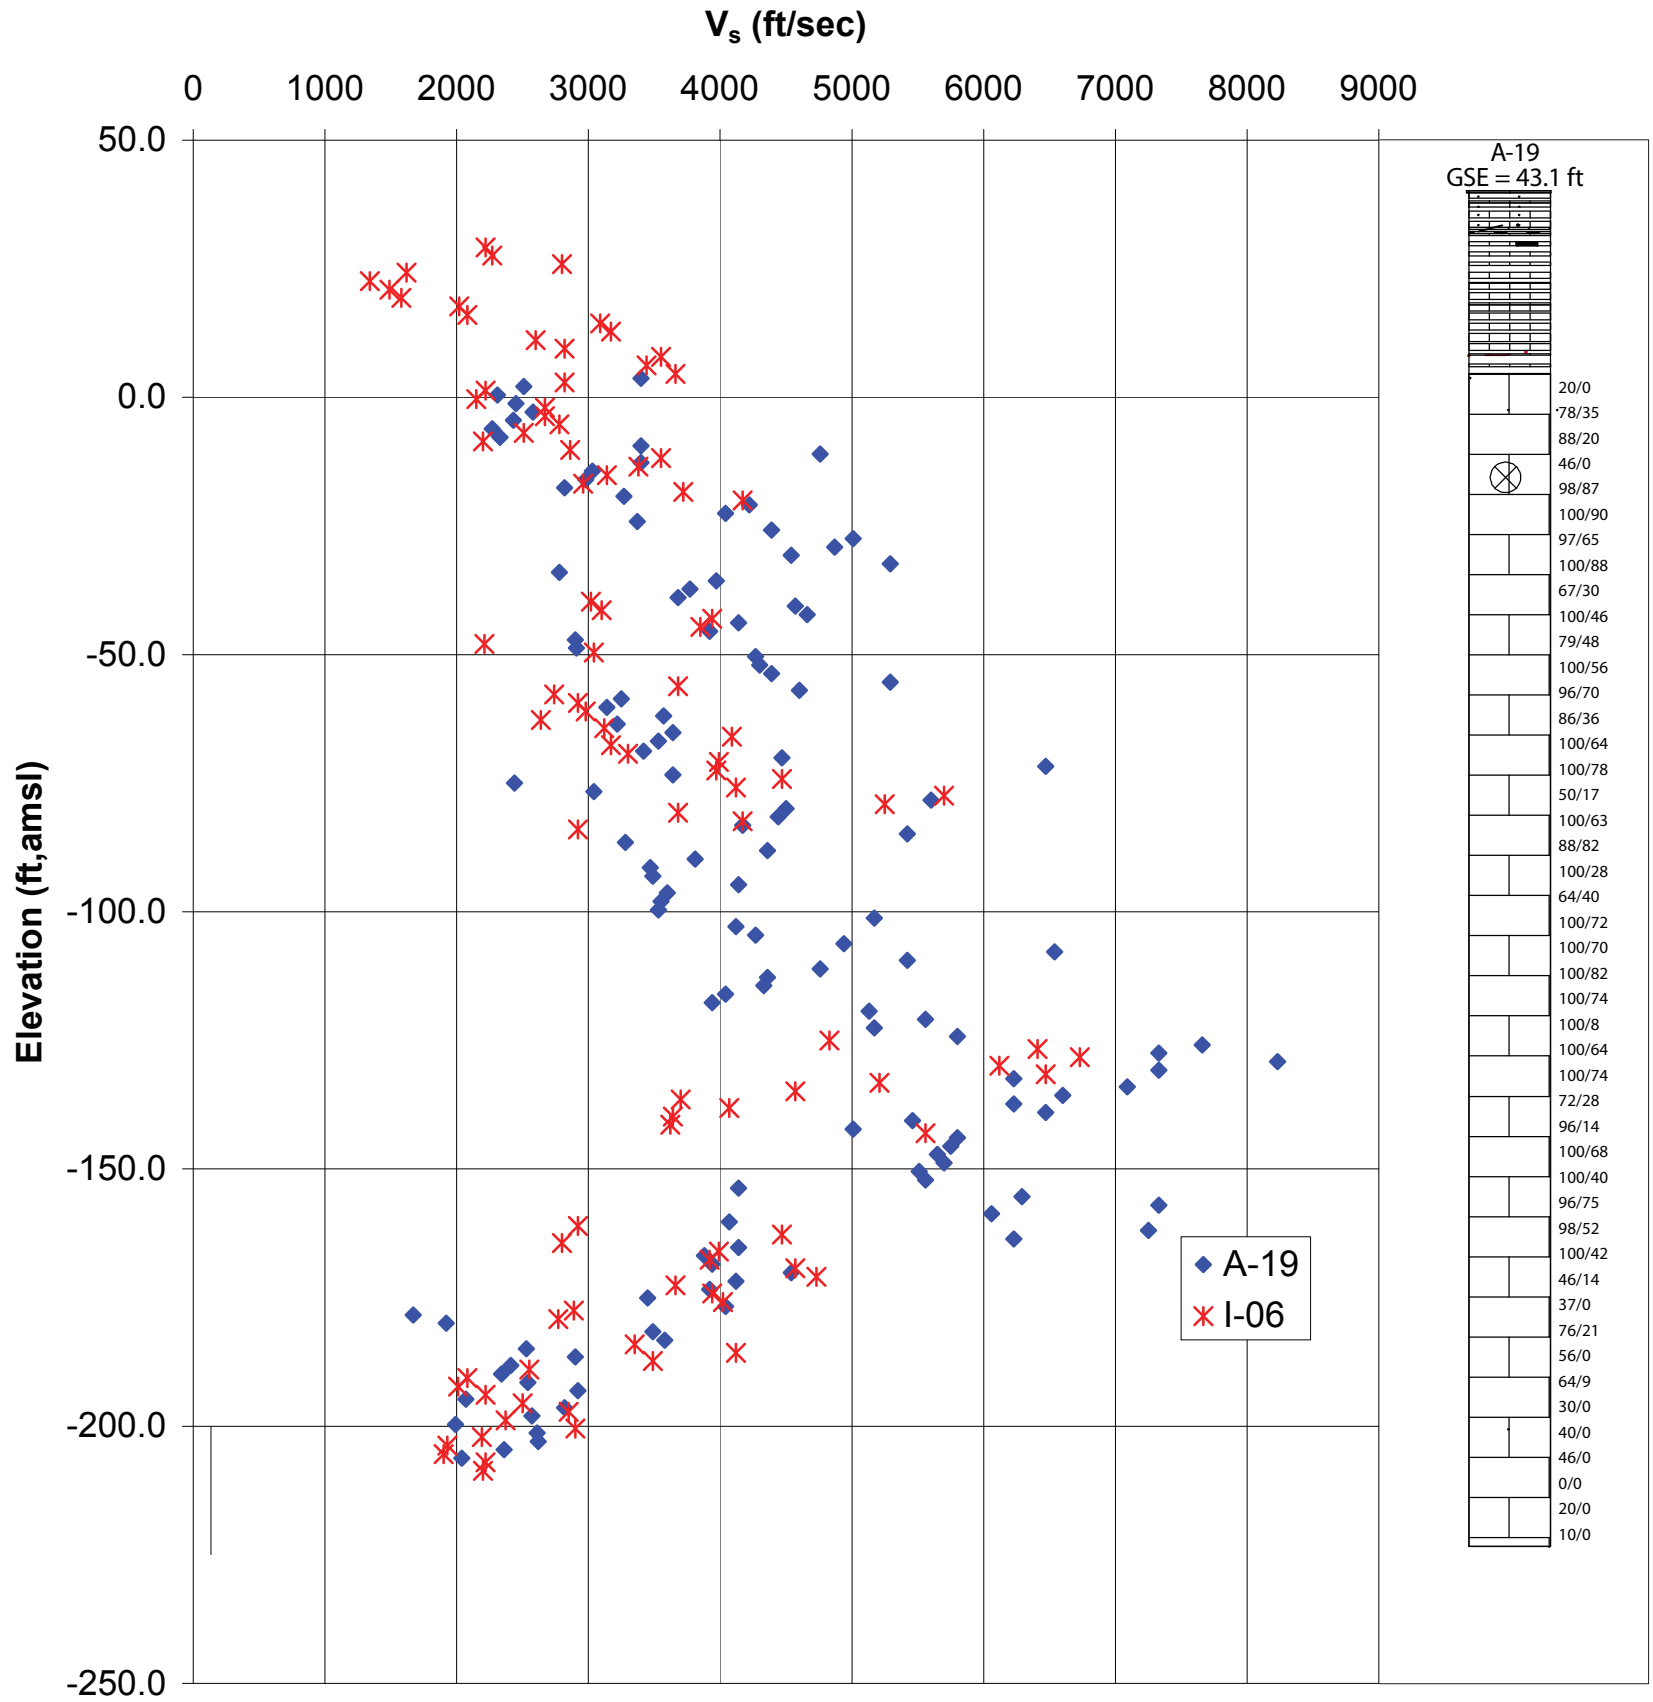

Duke Energy Florida
 Levy Nuclear Plant
 Units 1 and 2
 Part 2, Final Safety Analysis Report

Comparison of Suspension Logging V_s Results
 in Adjacent Boreholes at LNP 1: Mud Rotary
 (Borehole A-19) and Sonic (Borehole I-06)
 FIGURE 2.5.4.4-202 Rev 6