

DEC 4 1974

Docket Nos. 50-269 ✓
50-270 50-287
50-289 50-302
50-312 50-320
50-346

Babcock & Wilcox Co.
ATTN: James F. Malloy
Manager, Licensing
Power Generation Group
P. O. Box 1260
Lynchburg, Virginia 24505

Gentlemen:

Thank you for your two letters dated November 18, 1974 which forwarded generic evaluations on a) the design deficiency identified on the Control Rod Drive AC Breaker Cabinet Seismic Attachment, and b) the design deficiency on the Internals Handling Fixture Spherical Nut. These reports will be evaluated and should we require additional information, we will contact Mr. Williamson as requested.

Your cooperation on this matter is appreciated.

Sincerely,

Original signed by
J. G. Davis

John G. Davis, Deputy Director
for Field Operations
Directorate of Regulatory Operations

bcc: with copies of letters & reports:

- PDR
- LPDR All docket numbers
- NSIC referenced above
- DTIE
- RO: Files
- DR Central Files
- N.C. Moseley, Dir, RO:II
- J. P. O'Reilly, Dir, RO:I
- J. G. Keppler, Dir, RO:III
- R. H. Engelen, Dir, RO:V

CRESS E/W FICE	RO:ES&EB	RO:ES&EB	RO:DDFO		
MCII-	GGower	HDHernburg	JGDavis		Miss Jh
11/29 NAME					
DATE	12/4 174	12/4 174	12/4 174		

AEC DISTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)

CONTROL NO: 11100

FILE: _____

FROM: Duke Power Company Charlotte, N.C. 28201 A.C. Thies		DATE OF DOC 10-23-74	DATE REC'D 10-29-74	LTR X	TWX	RPT	OTHER
TO: Mr. Karl Goller		ORIG 1 signed	CC	OTHER	SENT AEC PDR <u>XX</u> SENT LOCAL PDR <u>XX</u>		
CLASS	UNCLASS XXX	PROP INFO	INPUT	NO CYS REC'D 1	DOCKET NO: 50-269		
DESCRIPTION: Ltr re our 7-23-74 ltr.....& re Duke Power Co's ltr of 8-22-74....trans the following:				ENCLOSURES: Program for Insertion of Zirconium Oxide Spaces in Oconee I, Batch 4..... (1 cy encl rec'd)			
PLANT NAME: Oconee I				ACKNOWLEDGED Do Not Remove			

FOR ACTION/INFORMATION

DHL 11-2-74

BUTLER (L) W/ Copies	SCHWENCER (L) W/ Copies	ZIEMANN (L) W/ Copies	REGAN (E) W/ Copies
CLARK (L) W/ Copies	STOLZ (L) W/ Copies	DICKER (E) W/ Copies	LEAR (L) W/ Copies
PARR (L) W/ Copies	VASSALLO (L) W/ Copies	KNIGHTON (E) W/ Copies	W/ Copies
KNIEL (L) W/ Copies	PURPLE (L) W/9Copies	YOUNGBLOOD (E) W/ Copies	W/ Copies

INTERNAL DISTRIBUTION

REG FILE AEC PDR OGC, ROOM P-506A MUNTZING/STAFF CASE GIAMBUSSO BOYD MOORE (L) (BWR) DEYOUNG (L) (PWR) SKOVHOLT (L) GOLLER (L) P. COLLINS DENISE REG OPR FILE & REGION (2) MORRIS STEELE	<u>TECH REVIEW</u> SCHROEDER MACCARY KNIGHT PAWLICKI SHAO STELLO HOUSTON NOVAK ROSS IPPOLITO TEDESCO LONG LAINAS BENAROYA VOLIMER	<u>DENTON</u> GRIMES GAMMILL KASTNER BALLARD SPANGLER <u>ENVIRO</u> MULLER DICKER KNIGHTON YOUNGBLOOD REGAN PROJECT LDR SCALETTE HARLESS	<u>LIC ASST</u> DIGGS (L) GEARIN (L) GOULBOURNE (L) KREUTZER (E) LEE (L) MAIGRET (L) REED (E) SERVICE (L) SHEPPARD (L) SLATER (E) SMITH (L) TEETS (L) WILLIAMS (E) WILSON (L)	<u>A/T IND</u> BRAITMAN SALTZMAN B. HURT <u>PLANS</u> MCDONALD CHAPMAN DUBE E. COUPE D. THOMPSON (2) KLECKER EISENHUT
--	--	--	--	---

EXTERNAL DISTRIBUTION

1 - LOCAL PDR <u>Walhalla, S.C.</u>	1 - NATIONAL LABS _____	1 - PDR-SAN/LA/NY
1 - TIC (ABERNATHY) (1)(2)(10)	1 - ASLBP(E/W Bldg, Rm 529)	1 - BROOKHAVEN NAT LAB
1 - NSIC (BUCHANAN)	1 - W. PENNINGTON, Rm E-201 GT	1 - G. ULRIKSON, ORNL
1 - ASLB	1 - B&M SWINEBROAD, Rm E-201 GT	1 - AGMED (RUTH GUSSMAN) Rm B-127 GT
1 - Newton Anderson	1 - CONSULTANTS	1 - R. D. MUELLER, Rm E-201 GT
16 - ACRS HOLDING SENT TO LIC. ASST. SHEPPARD FOR DIST	NEWMARK/BLUME/AGBABIAN	

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28201

A. C. THIES
SENIOR VICE PRESIDENT
PRODUCTION AND TRANSMISSION

P. O. Box 2178

October 23, 1974

Regulatory

Reg. Cy.

Mr. Karl R. Goller
Assistant Director for Operating Reactors
Directorate of Licensing
Office of Regulation
U. S. Atomic Energy Commission
Washington, D. C. 20545



Re: Oconee Unit 1
Docket No. 50-269

Dear Mr. Goller:

As additional response to your letter of July 23, 1974, please find attached the non-proprietary version of B&W's report describing the insertion of zirconium-oxide spacers in an Oconee 1, Batch 4 fuel assembly. My letter of August 22, 1974 provided you specific identification of information contained in this report considered to be proprietary, together with a full explanation of why that information should be withheld from public disclosure.


The attached non-proprietary version of B&W's report may be placed in the Public Document Room.

Very truly yours,

A handwritten signature in cursive script that reads "A. C. Thies".

A. C. Thies

ACT:vr
Attachment

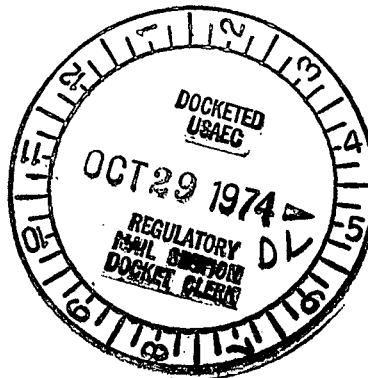

11100

PROGRAM FOR INSERTION OF ZIRCONIUM OXIDE SPACERS
IN OCONEE 1, BATCH 4

Received w/Ltr Dated 10-23-74

I. INTRODUCTION

The following is a description of a program for loading ZrO_2 spacers between UO_2 pellets in one fuel rod of an Oconee 1, Batch 4B fuel assembly. Displacement of fuel pellets with ZrO_2 spacers will create gaps of known size which can be used to further calibrate the movable incore detectors (MIDS). Such in-reactor data will confirm the ability of the MIDS to detect densification gaps and would thus be of significant benefit in the effort to reduce densification penalties. Inclusion of known gaps in a batch 4B assembly will not adversely affect full power operation during the core residence time of the assembly (cycles 2,3, and 4). ZrO_2 spacers have been irradiated previously in a similar test at Point Beach #1 (Ref. 1).

II. ANALYSIS

A. Spacer Loading

Three ZrO_2 spacers having lengths of 0.40, 0.70, and 1.00 inches will be loaded into a fuel rod adjacent to the instrument tube (see Figure 1) in a batch 4B (3.20 wt % 235 U) assembly. The axial locations of the spacers are indicated in Table 1 and Figure 2. The axial locations were chosen to place the larger gaps in the low power regions indicated by 3D PDQ calculations consistent with the fuel densification power spike factors currently accepted by the USAEC (Reference 2).

The assembly containing the spacers will be loaded into core position D-14 (see Figure 3). This position has a relatively low power during cycle 2 and is a position in which a MIDS drive can be mounted. The spacer assembly is scheduled to be moved to core position F-13 (or a position symmetric with F-13) at the end of cycle 2 and should remain in that position during cycles 3 and 4. The assembly will be discharged at the end of cycle 4. Both core locations D-14 and F-13 contain fixed incore detectors which will provide monitoring of the spacer assembly.

B. Power Peaking

Power peaking caused by the simulated gaps only (coplanar densification gaps not included) has been determined using data from Reference 2. Table 2 shows that the power increase in rods adjacent to the simulated gaps will be much less than the power increase imposed by the current power spike model (Ref. 2) for hypothetical gaps due to fuel densification. Table 2 also shows that the power increase in adjacent rods is less than is calculated with B&W's revised power spike model, which is currently being reviewed by the USAEC.

The effect on power peaking of additional gaps coplanar with the simulated gaps has been calculated using both the current and revised power spike models. Calculations were made for the spacer assembly by including gaps represented by the ZrO_2 and for a normal assembly in

which only gaps due to postulated densification were considered. The spacer assembly calculations include the effects of both the ZrO₂ gaps and gaps due to hypothetical densification. Batch 4B fuel parameters (3.20 wt% 235 U, initial density of 95% and final density of 96.5%) were used in the calculations. Results indicate a maximum power spike increase due to the spacers of 2.1% with the current power spike model and [value of spike] based on the revised model (Table 3).

The spacer assembly will be placed in low power positions to insure that even with a [value of spike] increase in local peaking the spacer assembly power will be significantly less than the power in the hottest assembly. Calculations for fuel cycles 2 and 3 indicate that the maximum power in the assembly containing the ZrO₂ spacers will be no greater than 1.26 times the core average assembly power and no greater than 0.85 times the maximum assembly power in the core. Relative power values for the spacer assembly for cycles 2 and 3 are given in Table 4. The power in the twice-burned spacer assembly during cycle 4 is expected to be no greater than the cycle 3 power. Application of the maximum increase in the power spike factor for the spacer assembly ([value of spike] - Table 3) yields a spacer assembly power that is no greater than [value of spike] times the maximum assembly power.

C. Materials Compatibility

Zirconia spacers can be used in zircaloy clad UO₂ fuel rods with no adverse effects due to materials incompatibility. The spacers proposed for use in Oconee 1 are stabilized zirconia containing 3 wt% CaO in solid solution. The spacers are to be used to create axial gaps in the fuel column by inserting a set of annular zirconia spacers with a zirconia disk at the top (see Figure 2). The spacers will be in contact with the zircaloy cladding and the fuel pellets. The compatibility of the zirconia with the cladding has been demonstrated by a test conducted at the Lynchburg Research Center in which zirconia and zircaloy were kept in intimate contact for 2, 3, and 4 months at 700 F.

There will be no compatibility problem with the zirconia disk and the UO₂ pellet. The maximum fuel temperature expected is 2260°C (4100°F). At that temperature there will be a solid state reaction of the zirconia with the UO₂. In the reaction zone, the melting point will be lowered to 2550°C (4622°F). The presence of CaO will also lower the melting point. The melting point of the calcia-zirconia-urania system in the reaction zone has been found to be greater than 2450°C. No gross structural changes are expected except for a slight increase in volume (6% maximum) at a UO₂ concentration of 12 wt.%.

The increase in volume will be more than offset by high temperature sintering. The length change of the gap fabricated by the addition of zirconia spacers will be confined to a UO₂-ZrO₂ reaction in the spacer disk and will be limited to an observable length change of approximately 0.1 inch during the three cycles of irradiation.

Babcock & Wilcox has irradiation experience with UO₂ fuel and stabilized zirconia spacers. B&W conducted a high and low burnup irradiation program in which experimental fuel rods containing foamed zirconia spacers were run at high linear heat ratings (up to 26 kw/ft) in the Babcock and Wilcox test reactor. These fuel rods were irradiated to burnups of up to 60,000 MWD/MTM. The post irradiation examination showed no evidence of incompatibility of the zirconia with the zircaloy 4 cladding. A solid-state reaction occurred between the UO₂ fuel pellets and zirconia as expected, but no adverse effects were noted.

D. REFERENCES

1. Hellman, J. M., "Fuel Densification Experimental Results and Model for Reactor Application," WCAP-8219, October, 1973 (p. 2. 6-1).
2. Fuel Densification Report, BAW-10054, Rev. 2, May 1973.

TABLE 1

SPACER AXIAL LOCATIONS

Spacer Length, Inches

0.40 [Tolerance
on spacer
length]

Between 3rd and 4th Spacer Grids -
73 [tolerance on location] from lower end of
active fuel

0.70 ["]

Between 4th and 5th Spacer Grids -
95 [tolerance on location] from lower end
of active fuel

1.00 ["]

Between 5th and 6th Spacer Grids -
117 [tolerance on location] from lower end
of active fuel

TABLE 3

POWER PEAKING WITH COPLANAR GAPS

Spacer Length, in.	Distance From Lower End of Active Fuel, in.	Current Power Spike Model (reference 2)			Power Spike Factor			Revised Power Spike Model		
		Normal Assembly	Spacer Assembly	% Increase	Normal Assembly	Spacer Assembly	% Increase	Normal Assembly	Spacer Assembly	% Increase
.40	73	1.053	1.066	1.2						
.70	95	1.070	1.088	1.7						
1.00	117	1.090	1.113	2.1						

tolerance
on
location

Power Spike
Factor
% Increase

TABLE 2

POWER PEAKING DUE TO GAPS

ZrO ₂ Simulated Gaps (Effect of hypothetical coplanar, gaps not included)			Power Spike Factor for 95%TD Fuel Based on Current Power Spike Model**	Power Spike Factor for 95%TD Fuel Based on Revised Power Spike Model***
Spacer Length, inches	Distance from Lower End of Fuel, inches	Power Spike Factor in Adjacent Rod*		
.40	73	1.015	1.053	[Power Spike Factor]
.70	95	1.023	1.070	
1.00	117	1.031	1.090	

*From figure 2.4-2, reference 2

**Calculated for 3.2 wt.% 235 U, TDI = 95.0, TDF = 96.5 as per reference 2


***Calculated for 3.2 wt.% 235 U, TDI = 95.0, TDF = 96.5 as per reference 3

TABLE 4

EFPD	<u>Power in Assy. with ZrO₂ Spacer/Max Assy. Power</u>		<u>Power in Assy. with ZrO₂ Spacer/Avg Assy. Power</u>	
	Cycle 2	Cycle 3	Cycle 2	Cycle 3
0	.53	.74	.83	1.15
4	.52	.74	.81	1.14
25	.51	.76	.80	1.14
50	.58	.79	.89	1.15
100	.57	.81	.86	1.14
150	.57	.82	.86	1.14
200	.57	.83	.85	1.14
265/267	.36	.83	.59	1.26
290/292	.43	.85	.65	1.23
CY2/CY3				

FIGURE 1

LOCATION IN ASSEMBLY OF ROD CONTAINING SPACERS

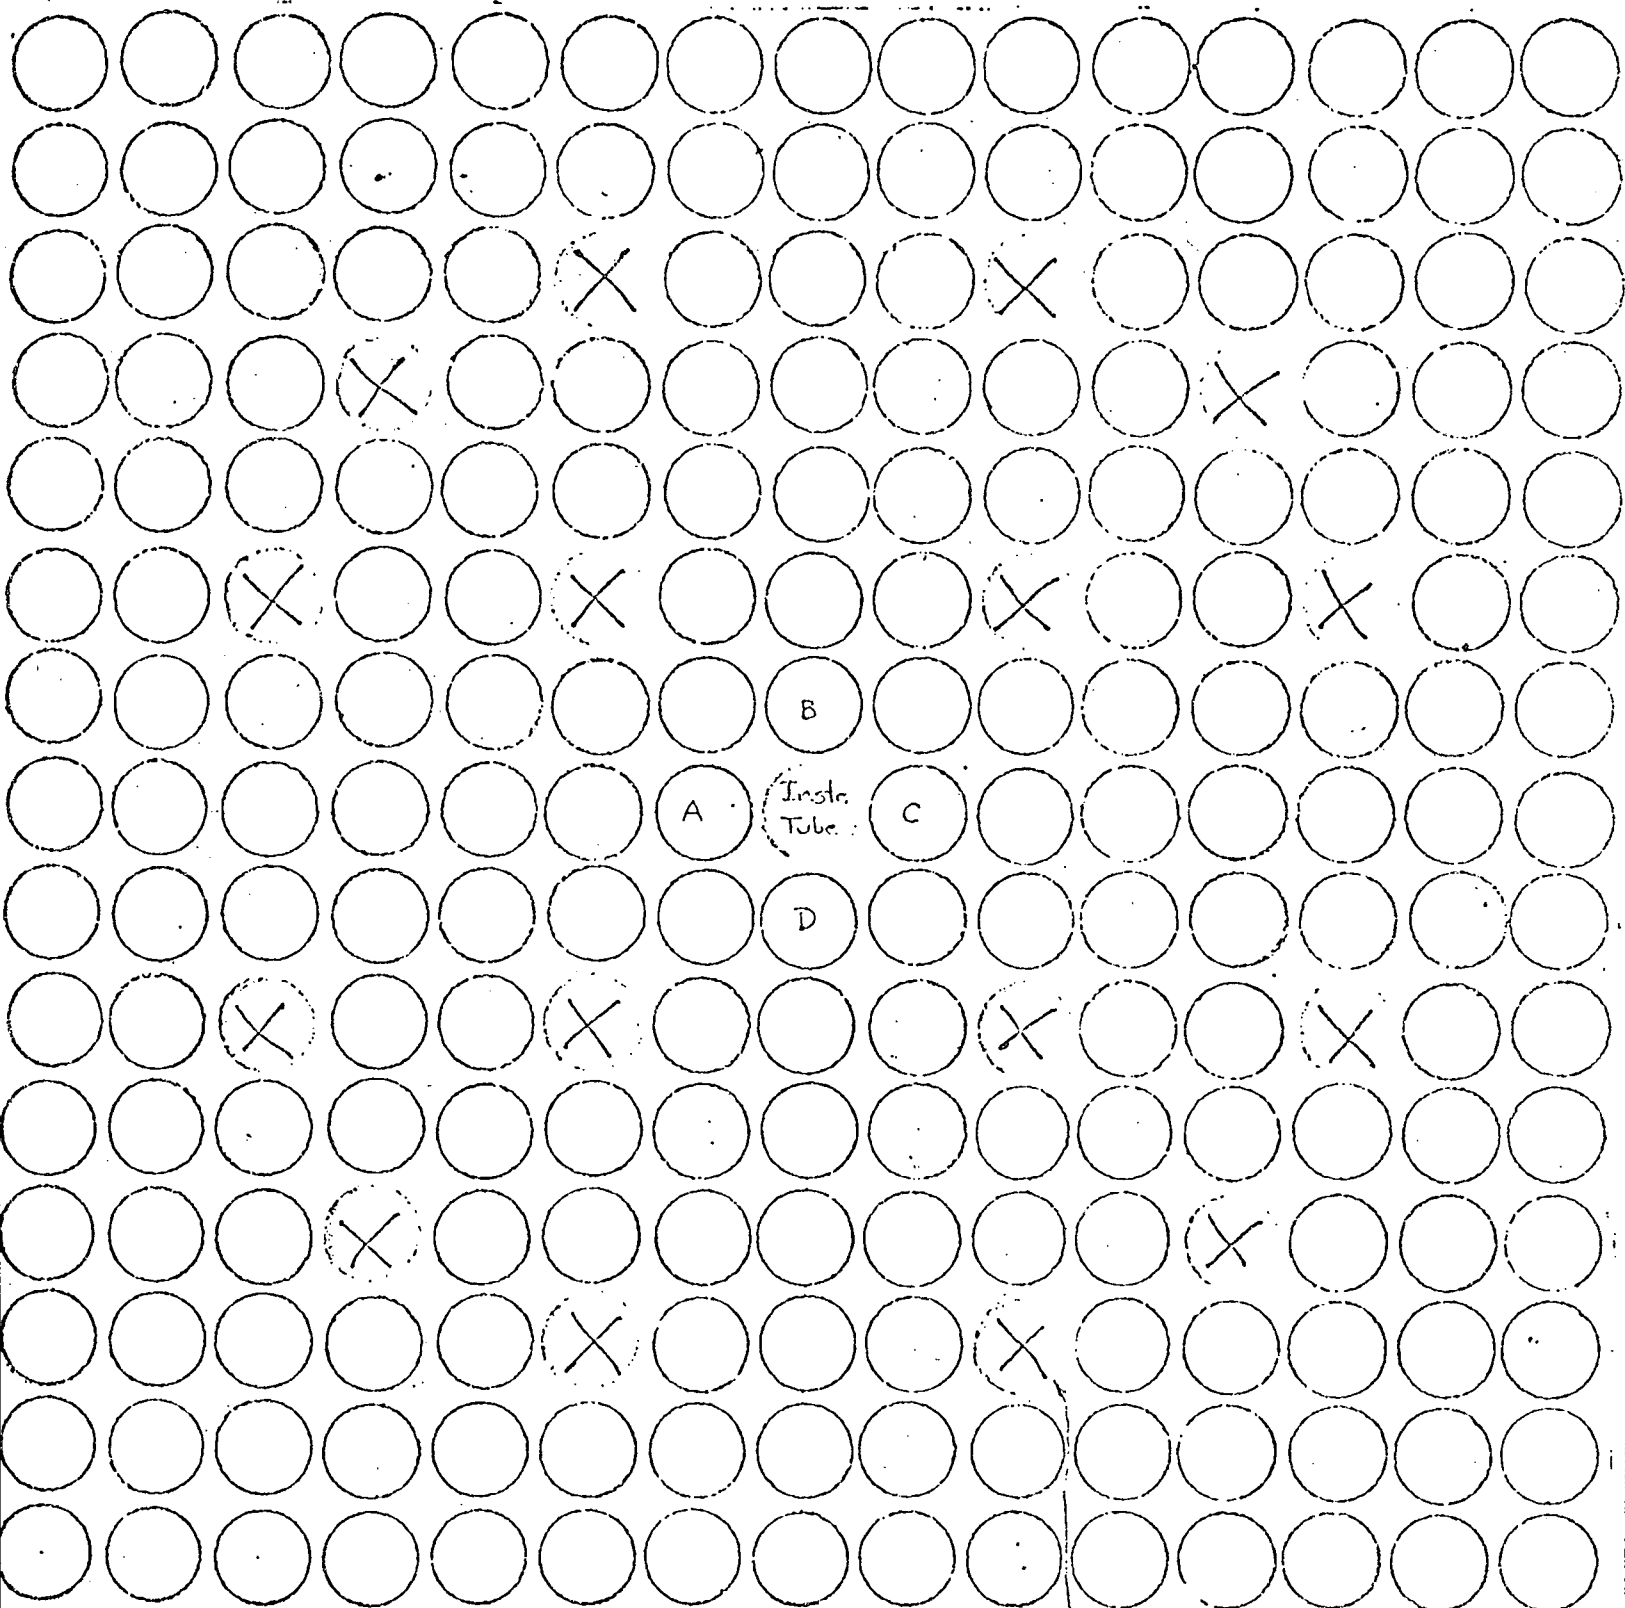

Fuel Rod
Control Rod Guide Tube

Rod Containing ZrO_2 Spacers should be placed
immediately adjacent to instrument tube position
A or B or C or D

FIGURE 2

SPACER CONFIGURATION

ALL DIMENSIONS IN INCHES


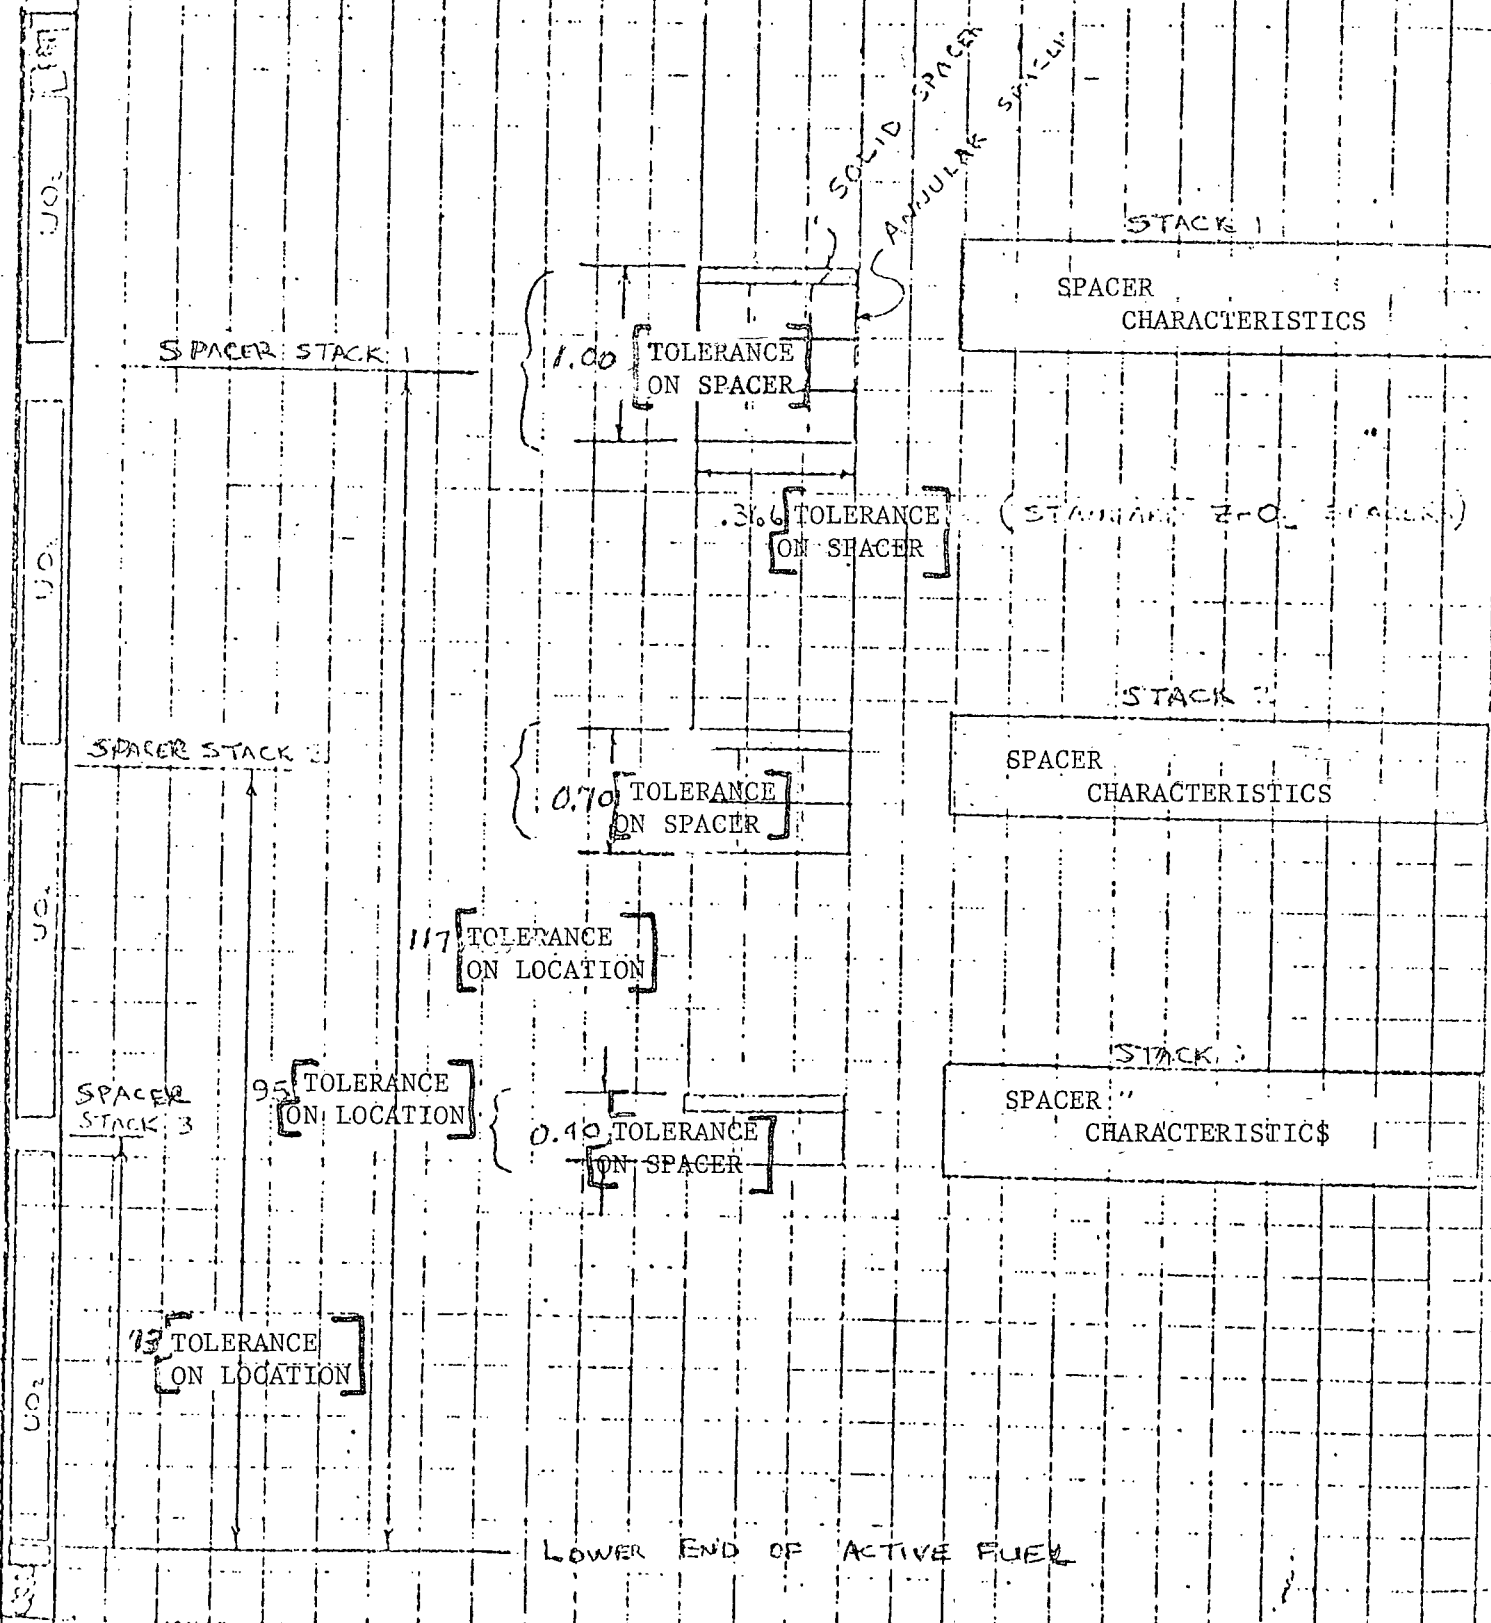


FIGURE 3 CORE LOCATIONS FOR MIDS CO DETECTOR FLUX MAPPING

MOVABLE INCORE DETECTOR SYSTEM
DRIVE MECHANISM/FUEL ASSEMBLY
IDENTIFICATION

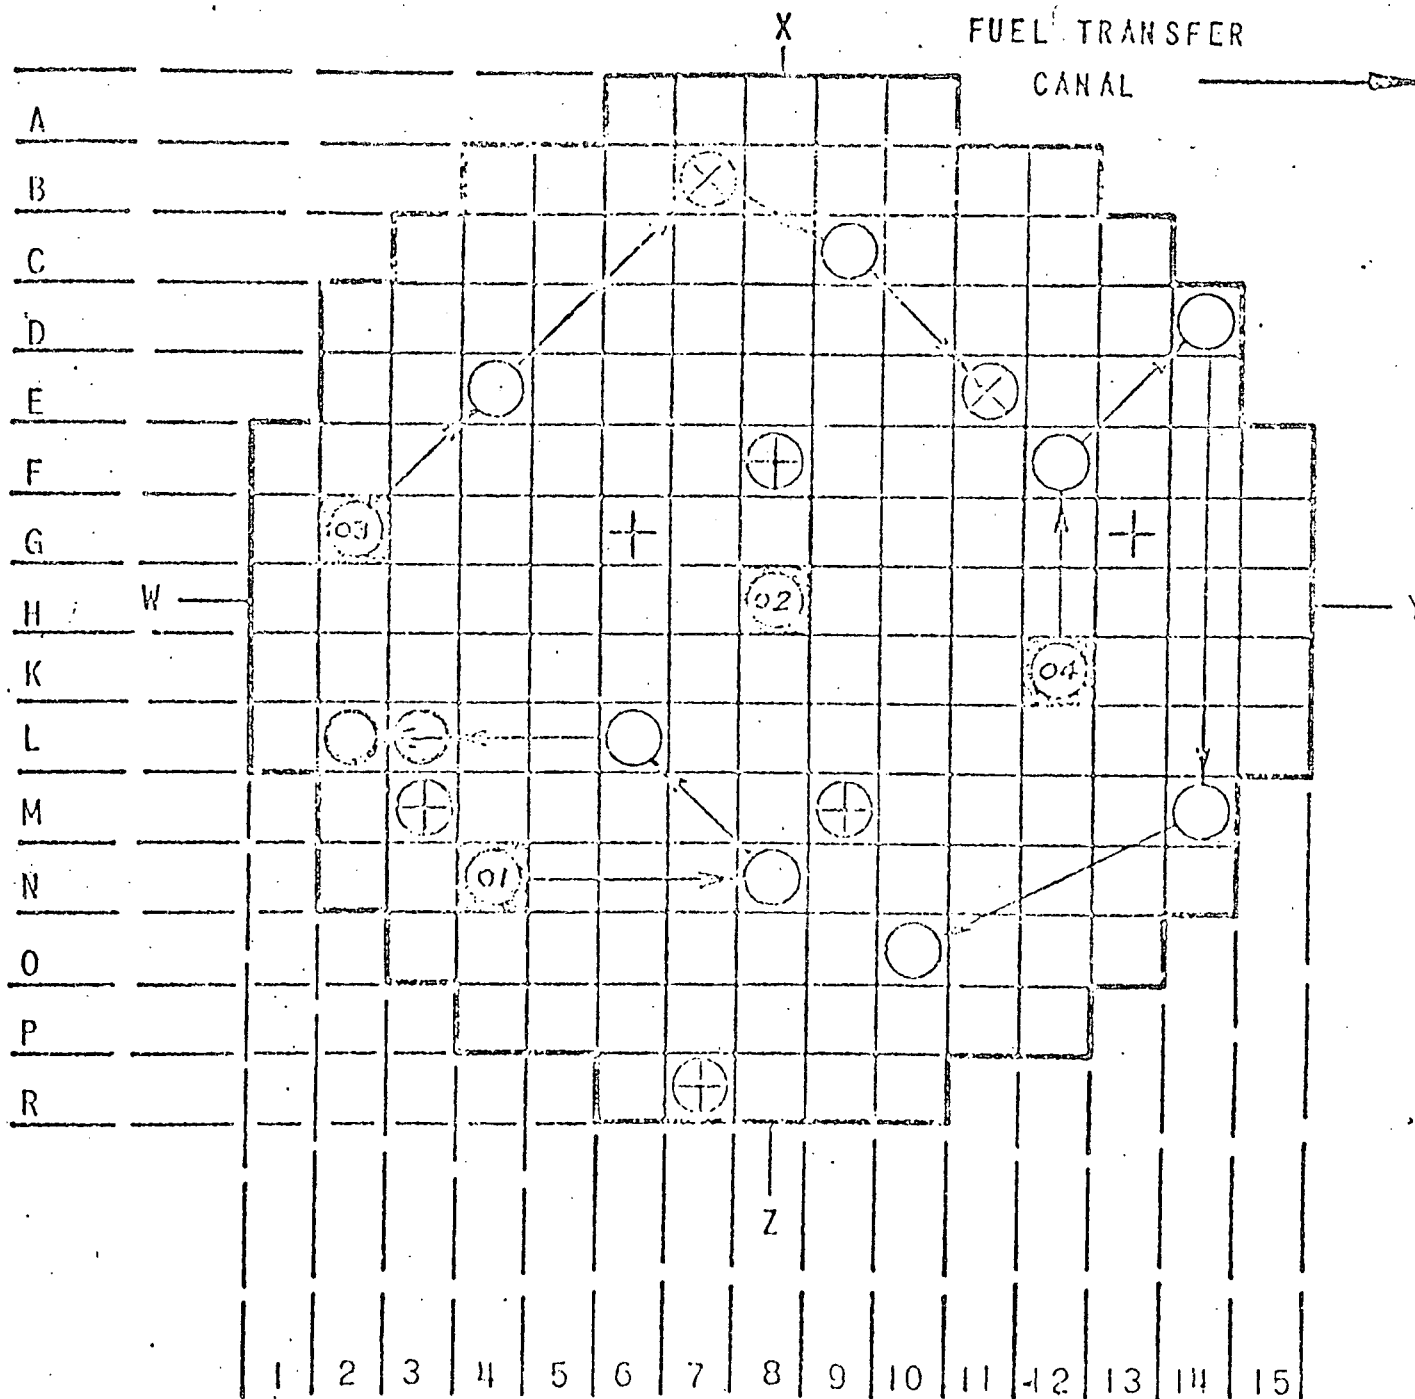

○ DRIVE MOUNTING LOCATION

⊗ INSTALLED DRIVE

xx- DRIVE CONTROL NUMBER

⊕ LOCATION OF RH

⊗ LOCATION OF BKG