

13 05/02/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)
DISTRIBUTION FOR INCOMING MATERIAL

50-269/270/287

REC: CASE E G
NRC

ORG: PARKER W O
DUKE PWR

DOCDATE: 04/27/78
DATE RCVD: 05/01/78

DOCTYPE: LETTER NOTARIZED: NO

COPIES RECEIVED
LTR 3 ENCL 40

SUBJECT:
FORWARDING REVISED TECH SPEC PAGE INCORPORATING NECESSARY OPERATING PROCEDURE
REQUIREMENTS, AND SHOULD BE INCLUDED IN APPLICANT'S TECH SPEC REVISION
SUBMITTAL OF 04/20/78, RE APPARENT ERROR IN THE B&W SMALL BREAK ECCS ANALYSIS
APPLICABLE TO SUBJECT FACILITY

PLANT NAME: OCONEE - UNIT 1
OCONEE - UNIT 2
OCONEE - UNIT 3

REVIEWER INITIAL: XJM
DISTRIBUTER INITIAL: M

***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

NOTES:
1. M. CUNNINGHAM - ALL AMENDMENTS TO FSAR AND CHANGES TO TECH SPECS

GENERAL DISTRIBUTION FOR AFTER ISSUANCE OF OPERATING LICENSE.
(DISTRIBUTION CODE A001)

FOR ACTION: BR CHIEF REID**W/7 ENCL

INTERNAL: REG FILE**W/ENCL
I & E**W/2 ENCL
HANAUER**W/ENCL
EISENHUT**W/ENCL
BAER**W/ENCL
EEB**W/ENCL
J. MCGOUGH**W/ENCL

NRC PDR**W/ENCL
OELD**LTR ONLY
CHECK**W/ENCL
SHAO**W/ENCL
BUTLER**W/ENCL
J COLLINS**W/ENCL

EXTERNAL: LPDR'S
WALHALLA, SC**W/ENCL
TIC**W/ENCL
NSIC**W/ENCL
ACRS CAT B**W/16 ENCL

DISTRIBUTION: LTR 40 ENCL 39
SIZE: 2P+1P

CONTROL NBR: 781220077

***** THE END *****

7

DUKE POWER COMPANY
POWER BUILDING
422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION


April 27, 1978

TELEPHONE: AREA 704
373-4083

Mr. Edson G. Case, Acting Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Attention: Mr. R. Reid, Chief
Operating Reactors Branch #4

Reference: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287

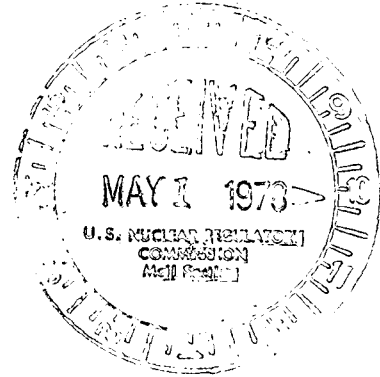


Dear Sir:

My letter of April 21, 1978 provided certain pertinent information to the staff concerning the apparent error in the B&W small break ECCS analysis applicable to Oconee Nuclear Station. Additionally, a commitment was made to provide a facility operating license amendment to require necessary procedures to implement the required corrective actions.

Please find attached a revised Technical Specification page, which incorporates the necessary operating procedure requirements, and should be included in our original Technical Specification revision submittal of April 20, 1978.

Inasmuch as this submittal supplements our previous submittal of April 20, 1978 and does not represent another license amendment request, additional license fees are not included.

Very truly yours,

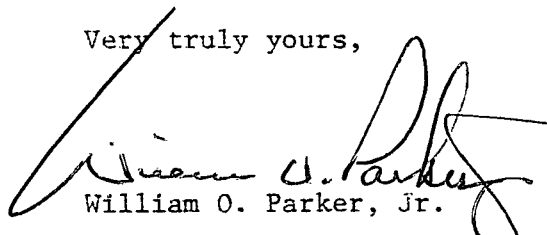
William O. Parker, Jr.

REGULATORY DOCKET FILE COPY


RLG:ge
Attachment

781220077

A001/5
3/40

Mr. Edson G. Case
Page 2
April 27, 1978

WILLIAM O. PARKER, JR., being duly sworn, states that he is Vice President of Duke Power Company; that he is authorized on the part of said Company to sign and file with the Nuclear Regulatory Commission this request for amendment of the Oconee Nuclear Station Technical Specifications, Appendix A to Facility Operating Licenses DPR-38, DPR-47 and DPR-55; and that all statements and matters set forth therein are true and correct to the best of his knowledge.

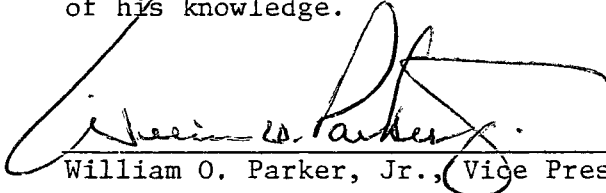

William O. Parker, Jr., Vice President

Subscribed and sworn to before me this 27th day of April, 1978.



Notary Public

My Commission Expires:

February 15, 1982

6.4 STATION OPERATING PROCEDURES

Specification

- 6.4.1 The station shall be operated and maintained in accordance with approved procedures. Written procedures with appropriate check-off lists and instructions shall be provided for the following conditions:
- a. Normal startup, operation and shutdown of the complete facility and of all systems and components involving nuclear safety of the facility.
 - b. Refueling operations.
 - c. Actions taken to correct specific and foreseen potential malfunctions of systems or components involving nuclear safety and radiation levels, including responses to alarms, suspected primary system leaks and abnormal reactivity changes.
 - d. Emergency procedures involving potential or actual release of radioactivity.
 - e. Preventive or corrective maintenance which could affect nuclear safety or radiation exposure to personnel.
 - f. Station survey following an earthquake.
 - g. Radiation control procedures.
 - h. Operation of radioactive waste management systems.
 - i. Control of pH in recirculated coolant after loss-of-coolant accident. Procedure shall state that pH will be measured and the addition of appropriate caustic to coolant will commence within 30 minutes after switchover to recirculation mode of core cooling to adjust the pH to a range of 7.0 to 8.0 within 24 hours.
 - j. Nuclear safety-related periodic test procedures.
 - k. Long-term emergency core cooling systems. Procedures shall include provision for remote or local operation of system components necessary to establish high and low pressure injection within 15 minutes after a line break.
 - l. Fire Protection Program implementation.
- 6.4.2 Quarterly selected drills shall be conducted on site emergency procedures including assembly preparatory to evacuation off site and a check of the adequacy of communications with off-site support groups.
- 6.4.3 A respiratory protective program approved by the Commission shall be in force.