

AEC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

(TEMPORARY FORM)

CONTROL NO: 8042

FILE:

FROM: Duke Power Company Charlotte, N.C. 28201 Mr. A.C. Thies		DATE OF DOC 7-26-74	DATE REC'D 8-1-74	LTR X	TWX	RPT	OTHER
TO: A. Giambusso		ORIG 3 signed	CC	OTHER	SENT AEC PDR XXX SENT LOCAL PDR XXX		
CLASS UNCLASS XXX	PROP INFO	INPUT XXX	NO CYS REC'D 40	DOCKET NO: 50-269/270/287			

DESCRIPTION:
 Ltr notarized 7-28-74.....requesting a change to tech specs....trans the following.....

ENCLOSURES:
 PROPOSED CHANGE TO TECH SPEC.....concerning maintenance on the Personnel and emergency hatches.....

ACKNOWLEDGED

(40 cvs ea encl rec'd)

DO NOT REMOVE

PLANT NAME: Oconee 1, 2 & 3

FOR ACTION/INFORMATION 8-1-74 JB

BUTLER (L) W/ CYS	SCHWENCER (L) W/ CYS	ZIEMANN (L) W/ CYS	REGAN (E) W/ CYS
CLARK (L) W/ CYS	STOLZ (L) W/ CYS	DICKER (E) W/ CYS	W/ CYS
DAVE (L) W/ CYS	VASSALLO (L) W/ CYS	KNIGHTON (E) W/ CYS	W/ CYS
KNIEL (L) W/ CYS	✓ PURPLE (L) W/ CYS	YOUNGBLOOD (E) W/ CYS	W/ CYS

INTERNAL DISTRIBUTION

✓ <u>REG FILE</u> ✓ AEC PDR ✓ OGC ✓ MUNTZING/STAFF CASE GIAMBUSSO BOYD MOORE (L)(LWR-2) DEYOUNG (L)(LWR-1) SKOVHOLT (L) ✓ GOLLER (L) P. COLLINS DENISE ✓ REG OPR FILE & REGION (3) MORRIS STEELE	✓ <u>TECH REVIEW</u> HENDRIE SCHROEDER MACCARY KNIGHT PAWLICKI SHAO STELLO HOUSTON NOVAK ROSS IPPOLITO TEDESCO LONG LAINAS BENAROYA VOLLNER	✓ <u>ENVIRO</u> DENION GRIMES GAMMILL KASTNER BALLARD SPANGLER MULLER DICKER KNIGHTON YOUNGBLOOD REGAN ✓ PROJECT MGR Scaletti HARLESS	✓ <u>LIC ASST</u> DIGGS (L) GEARIN (L) GOULBOURNE (L) KREUTZER (E) LEE (L) MAIGRET (L) REED (E) SERVICE (L) ✓ SHEPPARD (L) SLATER (E) SMITH (L) TEETS (L) WILLIAMS (E) WILSON (L)	✓ <u>A/T IND</u> BRAITMAN SALTZMAN B. HURT ✓ <u>PLANS</u> MCDONALD CHAPMAN ✓ DUBE w/input ✓ E. COUPE ✓ Schemel D. THOMPSON (2) KLECKER EISENHUT
--	---	---	---	---

EXTERNAL DISTRIBUTION

✓ 1 - LOCAL PDR Walhalla, S.C. ✓ 1 - TIC (ABERNATHY) ✓ 1 - NSIC (BUCHANAN) 1 - ASLB 1 - P. R. DAVIS ✓ 16 - ACRS XXXXXXXX Sent to Sheppard 8-2-74	(1)(2)(10)-NATIONAL LABS 1-ASLBP(E/W Bldg, Rm 529) 1-W. PENNINGTON, Rm E-201 GT 1-B&M SWINEBROAD, Rm E-201 GT 1-CONSULTANTS NEWMARK/BLUME/ACBARIAN	1-PDR-SAN/LA/NY 1-BROOKHAVEN NAT LAB 1-G. ULRIKSON, GRNL 1-ACMED (RUTH GUSMAN) Rm B-127 CT 1-RD..MUELLER, Rm F-50- GT
---	---	---

Rg.

Regulatory Docket File

DUKE POWER COMPANY



POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28201

A. C. THIES
SENIOR VICE PRESIDENT
PRODUCTION AND TRANSMISSION

July 26, 1974

P. O. Box 2178

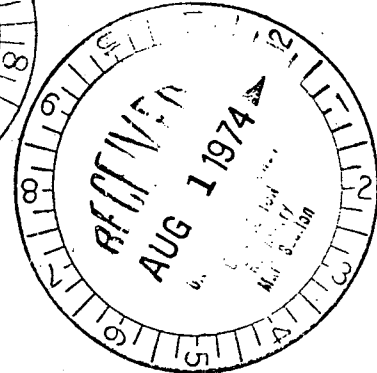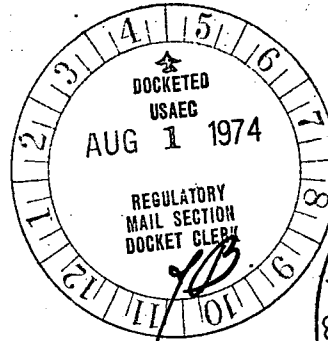

Mr. Angelo Giambusso
Deputy Director for Reactor Projects
Directorate of Licensing
Office of Regulation
U. S. Atomic Energy Commission
Washington, D. C. 20545

Re: Oconee Nuclear Station
Docket Nos. 50-269, -270, 287

Dear Mr. Giambusso:

Oconee Nuclear Station Technical Specification 3.6 requires containment integrity be maintained when all three of the following conditions exist:

1. Reactor coolant pressure is 300 psig or greater
2. Reactor coolant temperature is 200°F or greater
3. Nuclear fuel is in the core

Containment integrity is defined by Section 1.7 of the Technical Specifications. It is required that both doors of the personnel hatch and emergency hatch be closed and sealed except that at least one door of the personnel hatch and the emergency hatch must be closed and sealed during refueling or during personnel passage through these hatches. There are no provisions under the current definition which permit preventative or corrective maintenance to be performed on one of these doors when containment integrity must exist.

Pursuant to 10CFR 50.59, it is requested that Section 1.7 of the Oconee Nuclear Station Technical Specifications be revised such that maintenance on one door of either the personnel or emergency hatch is permitted for 48 hours provided the remaining door is closed and sealed. This proposed change is shown on the attached replacement page for the Oconee Technical Specifications.

A maintenance period of up to 48 hours is considered acceptable since the other door will be kept closed and sealed. Containment integrity is not impaired since either door meets the design specifications for structural integrity and leak rate. The period of 48 hours is requested

8042

Mr. Angelo Giambusso

Page 2

July 26, 1974


to permit completion of any maintenance action, and the performance of a local leak rate test following the maintenance.

Very truly yours,




A. C. Thies

A. C. THIES, being duly sworn, states that he is Senior Vice President of Duke Power Company; that he is authorized on the part of said Company to sign and file with the Atomic Energy Commission this request for amendment of the Oconee Nuclear Station Technical Specifications, Appendix A to Facility Operating Licenses DPR-38, DPR-47, and DPR-55; and that all statements and matters set forth therein are true and correct to the best of his knowledge.




A. C. Thies, Senior Vice President

ATTEST:

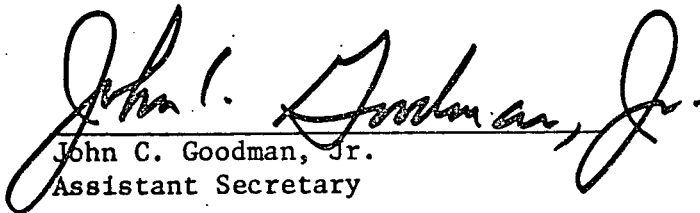


John C. Goodman, Jr.
Assistant Secretary

Subscribed and sworn to before me this 26th day of July, 1974.

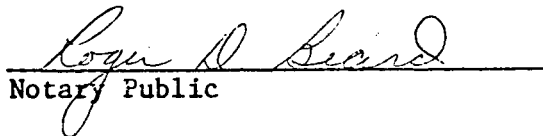

Logan D. Beard
Notary Public

My Commission Expires:



June 28, 1978