

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)

CONTROL NO: 8748

FILE: _____

FROM: Duke Power Company Charlotte, NC W O Parker Jr		DATE OF DOC <u>8-15-75</u>	DATE REC'D <u>8-18-75</u>	LTR <u>xxx</u>	TWX	RPT	OTHER
TO: Mr Giambusso		ORIG 3 signed	CC	OTHER	SENT NRC PDR <u>XX</u>		SENT LOCAL PDR <u>XX</u>
CLASS	UNCLASS XXXXXXXX	PROP INFO	INPUT	NO CYS REC'D 3	DOCKET NO: <u>50-269/279/287</u>		

DESCRIPTION:
Ltr notarized 8-15-75...trans the following:

ENCLOSURES:

Amdt to OL/Change to Tech Specs: Consisting of revisions with regard to limiting conditions associated with SNUBBERS....

ACKNOWLEDGED

PLANT NAME: Oconee 1, 2, & 3

FOR ACTION/INFORMATION 8-19-75 ehf

BUTLER (L) W/ Copies	SCHWENCER (L) W/ Copies	ZIEMANN (L) W/ Copies	REGAN (E) W/ Copies	REID (L) W/ COPIES
CLARK (L) W/ Copies	STOLZ (L) W/ Copies	DICKER (E) W/ Copies	LEAR (L) W/ Copies	
PARR (L) W/ Copies	VASSALLO (L) W/ Copies	KNIGHTON (E) W/ Copies	SPIES W/ Copies	
KNIEL (L) W/ Copies	PURPLE (L) W/6Copies	YOUNGBLOOD (E) W/ Copies	LPM W/ Copies	

INTERNAL DISTRIBUTION

<u>REG FILE</u> NRC PDR	TECH REVIEW SCHROEDER	DENTON GRIMES	LIC ASST R. DIGGS (L)	A/T IND. BRAITMAN
OGC, ROOM P-506A	MACCARY	GAMMILL	H. GEARIN (L)	SALTZMAN
GOSSICK/STAFF	KNIGHT	KASTNER	E. GOULBOURNE (L)	MELTZ
CASE	PAWLICKI	BALLARD	P. KREUTZER (E)	
GIAMBUSO	SHAO	SPANGLER	J. LEE (L)	PLANS
BOYD	STELLO		M. RUSHBROOK (L)	MCDONALD
MOORE (L)	HOUSTON	ENVIRO	S. REED (E)	CHAPMAN
DEYOUNG (L)	NOVAK	MULLER	M. SERVICE (L)	DUBE (Ltr)
SKOVHOLT (L)	ROSS	DICKER	S. SHEPPARD (L)	E. COUPE
GOLLER (L) (Ltr)	IPPOLITO	KNIGHTON	M. SLATER (E)	PETERSON
P. COLLINS	TEDESCO	YOUNGBLOOD	H. SMITH (L)	HARTFIELD (2)
DENISE	J. COLLINS	REGAN	S. TEETS (L)	KLECKER
REG OPR	LAINAS	PROJECT LDR	G. WILLIAMS (E)	EISENHUT
FILE & REGION (2)	BENAROYA	<u>M. Au</u>	V. WILSON (L)	WIGGINTON
MIPC	VOLLMER	HARLESS	R. INGRAM (L)	
			M. DUNCAN (E)	<u>appl 2</u>

EXTERNAL DISTRIBUTION

1 - LOCAL PDR <u>Walthalla S.C.</u>	1 - NATIONAL LABS	1 - PDR-SAN/LA/NY
1 - TIC (ABERNATHY) (1)(2)(10)	1 - W. PENNINGTON, Rm E-201 GT	1 - BROOKHAVEN NAT LAB
1 - NSIC (BUCHANAN)	1 - CONSULTANTS	1 - G. ULRIKSON ORNL
1 - ASI	1 - <u>ARK/BLUME/AGBBIAN</u>	

16 - ACRS HOLDING/SENT
TO L.A. Sheppard

J.H.

DUKE POWER COMPANY

POWER BUILDING


422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

TELEPHONE: AREA 704
373-4083

August 15, 1975

Mr. Angelo Giambusso, Director
Division of Reactor Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

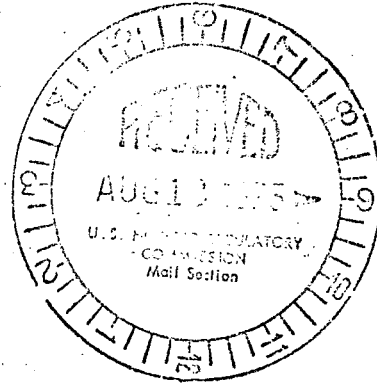

Re: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287


Dear Mr. Giambusso:

Mr. R. A. Purple's letter of June 30, 1975 described the incidence of hydraulic shock suppressor failure at many reactor facilities. It was requested that we provide a technical specification requiring a limiting condition for operation for hydraulic shock suppressor operability and appropriate surveillance requirements to assure satisfactory suppressor performance and reliability.


Pursuant to 10CFR 50.90, please find attached a proposed amendment to the Technical Specifications for the Oconee Nuclear Station which is in basic agreement with the model specification which you supplied concerning hydraulic shock suppressors. Note that the provision for functional testing of the suppressors has not been incorporated into our proposal. Functional testing of suppressors is performed at the vendor's factory to verify proper design and fabrication. The visual inspections and disassembly required by proposed Specification 4.18 are intended to verify the continued operability of the suppressors. Therefore, it is considered that functional testing at the station is not necessary.

Suppressor surveillance will continue as presently required in Oconee Nuclear Station Technical Specification 4.1 until such time that this request for amendment of operating license is approved. Suppressor surveillance subsequent to approval of this amendment will be performed within six months of the date of issuance of these technical specifications or within the previous surveillance frequency, whichever is sooner.

Very truly yours,

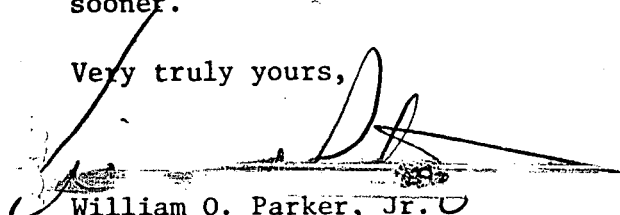
William O. Parker, Jr.

MST:vr
Attachments

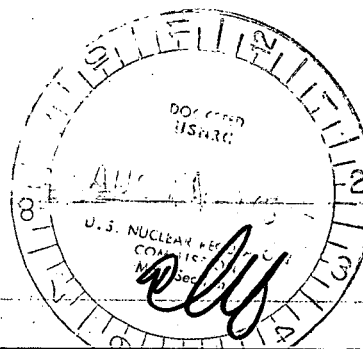

8748