

PROJECT NO. ^{(50-269) 70-1231}
^{50-270 70-1231}
~~50-287~~

DUKE POWER COMPANY

REGULATORY FILE CY

P. O. BOX 2178

GENERAL OFFICES
422 SOUTH CHURCH STREET
CHARLOTTE, N. C. 28201

TELEPHONE: AREA 704
374-4011

January 11, 1973

Mr. James Saltzman
Division of Reactor Licensing
Atomic Energy Commission
Washington, D. C. 20545

Subject: Oconee Units 1, 2 and 3
NELIA Pol.#NF-182 1-20-73
MAELU - Under Binder 1-20-73

Dear Mr. Saltzman:

Attached you will find six (6) copies of Endorsements No. 22 and 23 to above NELIA policy and Binder No. 92 effective January 20, 1973, bringing our total liability insurance on Oconee Station to maximum available of \$95,000,000.

Yours very truly,

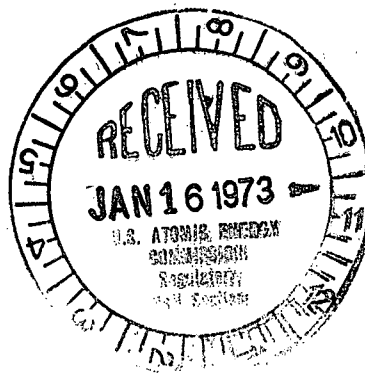
John W. Fox

John W. Fox, Manager
Insurance

JWF:mej

Enclosure

CC: Mr. Paul Barton
Steam Production



409
RW

Nuclear Energy Liability Insurance

NUCLEAR ENERGY LIABILITY INSURANCE ASSOCIATION

INCREASE OF LIMIT OF LIABILITY ENDORSEMENT

It is agreed that:

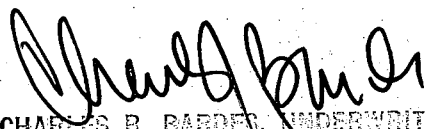
1. The limit of liability stated in Item 4 of the declarations of the policy is amended to read \$73,625,000.
2. This amended limit applies with respect to obligations assumed or expenses incurred because of bodily injury or property damage caused, during the period from the effective date of this endorsement to the date of termination of the policy, by the nuclear energy hazard.
2. The limit of liability stated in Item 4 of the declarations and the amended limit of liability stated in paragraph 1 above shall not be cumulative, and each payment made by the companies after the effective date of this endorsement for any loss or expense covered by the policy shall reduce by the amount of such payment both the limit of liability stated in Item 4 of the declarations and the amended limit stated in paragraph 1 above, regardless of which limit of liability applies with respect to the bodily injury or property damage out of which such loss or expense arises.

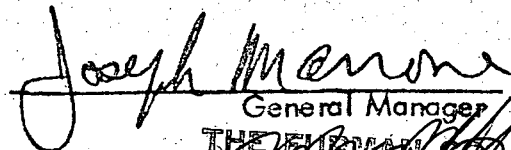

This is to certify that this Endorsement No. 22 is a true copy of the original Endorsement No. 22 of the Nuclear Energy Liability Policy (Facility Form) No. NF-182. No insurance is afforded hereunder.

Effective Date of this Endorsement January 20, 1973 To form a part of Policy No. NF-182
12:01 A.M. Standard Time

Issued to Duke Power Company

Date of Issue December 27, 1972 For the Subscribing Companies


 CHARLES R. BARDET, UNDERWRITING MANAGER
 NUCLEAR ENERGY LIABILITY INSURANCE ASSOCIATION

By 
 General Manager
 THE FURNACE CO.
 Countersigned by 

Endorsement No. 22

Nuclear Energy Liability Insurance
NUCLEAR ENERGY LIABILITY INSURANCE ASSOCIATION

ADVANCE PREMIUM AND STANDARD PREMIUM ENDORSEMENT

Calendar Year 1973

It is agreed that Items 1a. and 1b. of Endorsement No. 21 are amended to read:

- 1a. ADVANCE PREMIUM: It is agreed that the Advance Premium due the companies for the period designated above is: \$ 9,140.81
- 1b. STANDARD PREMIUM AND RESERVE PREMIUM: In the absence of a change in the Advance Premium indicated above, it is agreed that, subject to the provisions of the Industry Credit Rating Plan, the Standard Premium is said Advance Premium and the Reserve Premium is: \$ 6,192.59

Additional Premium: \$7,140.81

This is to certify that this Endorsement No. 23 is a true copy of the original Endorsement No. 23 a part of Nuclear Energy Liability Policy (Facility Form) No. NF-182. No insurance is afforded hereunder.

Effective Date of this Endorsement January 1, 1973 To form a part of Policy No. NF-182
12:01 A.M. Standard Time
Issued to Duke Power Company
Date of Issue December 27, 1972 For the Subscribing Companies

Joseph Marone
JOSEPH MARONE, GENERAL MANAGER
NUCLEAR ENERGY LIABILITY INSURANCE ASSOCIATION

By Joseph Marone
General Manager
THE FURMAN CO.

Endorsement No. 23

Countersigned by [Signature]

MUTUAL ATOMIC ENERGY LIABILITY UNDERWRITERS

One East Wacker Drive, Chicago, Illinois 60601

American Mutual Liability Insurance Company
Employers Mutual Liability Insurance Company of Wisconsin
Hardware Mutual Casualty Company
Liberty Mutual Insurance Company
Lumbermens Mutual Casualty Company
Michigan Mutual Liability Company

NUCLEAR ENERGY LIABILITY INSURANCE BINDER NO. 92
(Facility Form)

Mutual Atomic Energy Liability Underwriters (herein called Underwriters), acting on behalf of its members, hereby binds nuclear energy liability insurance in favor of

DUKE POWER COMPANY
Named Insured OCONEE NUCLEAR STATION, OCONEE COUNTY, SOUTH CAROLINA

Address P. O. BOX 2178, CHARLOTTE, NORTH CAROLINA 28201

with respect to the facility described below, subject to the limits of liability and other terms of this binder:

1. Limit of Liability The total aggregate liability of Underwriters' members under this binder and any policy issued in replacement hereof is \$ 21,375,000.
2. Description of Insurance Afforded Except with respect to cancellation, the insurance afforded by this binder shall be in accordance with the terms of the Nuclear Energy Liability Policy (Facility Form) in use by Underwriters on the effective date of this binder. Issuance by Underwriters of a Nuclear Energy Liability Policy (Facility Form) with respect to the facility described below terminates this binder as of the effective date of such binder.
3. Premium The deposit premium stated below is payable at the time of acceptance of this binder. By acceptance of this binder, the named insured agrees to pay Underwriters when billed the premium for the period of this binder, and the deposit premium paid shall be credited against such billed premium. Any premium paid under this binder shall be credited against the premium for any policy issued in replacement of this binder.
4. Cancellation of Binder This binder may be canceled either by the named insured or Underwriters by mailing to the other at its address stated in this binder, and to the Atomic Energy Commission,

Nuclear Energy Liability Insurance Binder

761-1416

written notice stating when, not less than 30 days thereafter, such cancellation shall be effective. The mailing of notice as aforesaid shall be sufficient proof of notice. Delivery of such written notice shall be equivalent to mailing.

If the named insured cancels, the earned premium for this binder shall be computed in accordance with the customary short rate table and procedures; provided, if the named insured cancels after knowledge of bodily injury or property damage caused by the nuclear energy hazard, all premiums theretofore paid or payable shall be fully earned. If Underwriters cancel, the earned premium for this binder shall be computed pro rata.

Premium adjustment may be made either at the time cancellation is effected or as soon as practicable after cancellation becomes effective, but payment or tender of unearned premium is not a condition of cancellation.

5. Period of Binder Beginning at NOON, on the 20th day of January, 1973, and continuing through March 23, 1973, standard time at the address of the named insured as stated herein, unless sooner terminated in accordance with the terms hereof. Such period may be extended for an additional period by endorsement issued by Underwriters to form a part hereof.

6. Description of the Facility

Location PREMISES KNOWN AS THE OCONEE NUCLEAR STATION - UNITS 1, 2 & 3, LOCATED WITHIN THE AREA OUTLINED IN RED ON THE ATTACHED SITE PLAN, BOUND ON THE EAST BY THE ROAD ADJACENT TO THE 230 KV AND 500 KV SWITCHYARDS AND ON THE NORTH, WEST, AND SOUTH BY THE SECURITY FENCE, 8 MILES, NORTHEAST OF SENECA, OCONEE COUNTY, SOUTH CAROLINA

Type NUCLEAR REACTORS

The operator of the facility is DUKE POWER COMPANY

7. Deposit Premium \$ TO BE DETERMINED

Nuclear Energy Liability Insurance Binder

MUTUAL ATOMIC ENERGY LIABILITY UNDERWRITERS

By LUMBERMANS MUTUAL CASUALTY COMPANY

Countersigned JAN.4, 1973
(Date)

at LONG GROVE, ILLINOIS

By *Laurenz*
Authorized Representative

Accepted _____ :

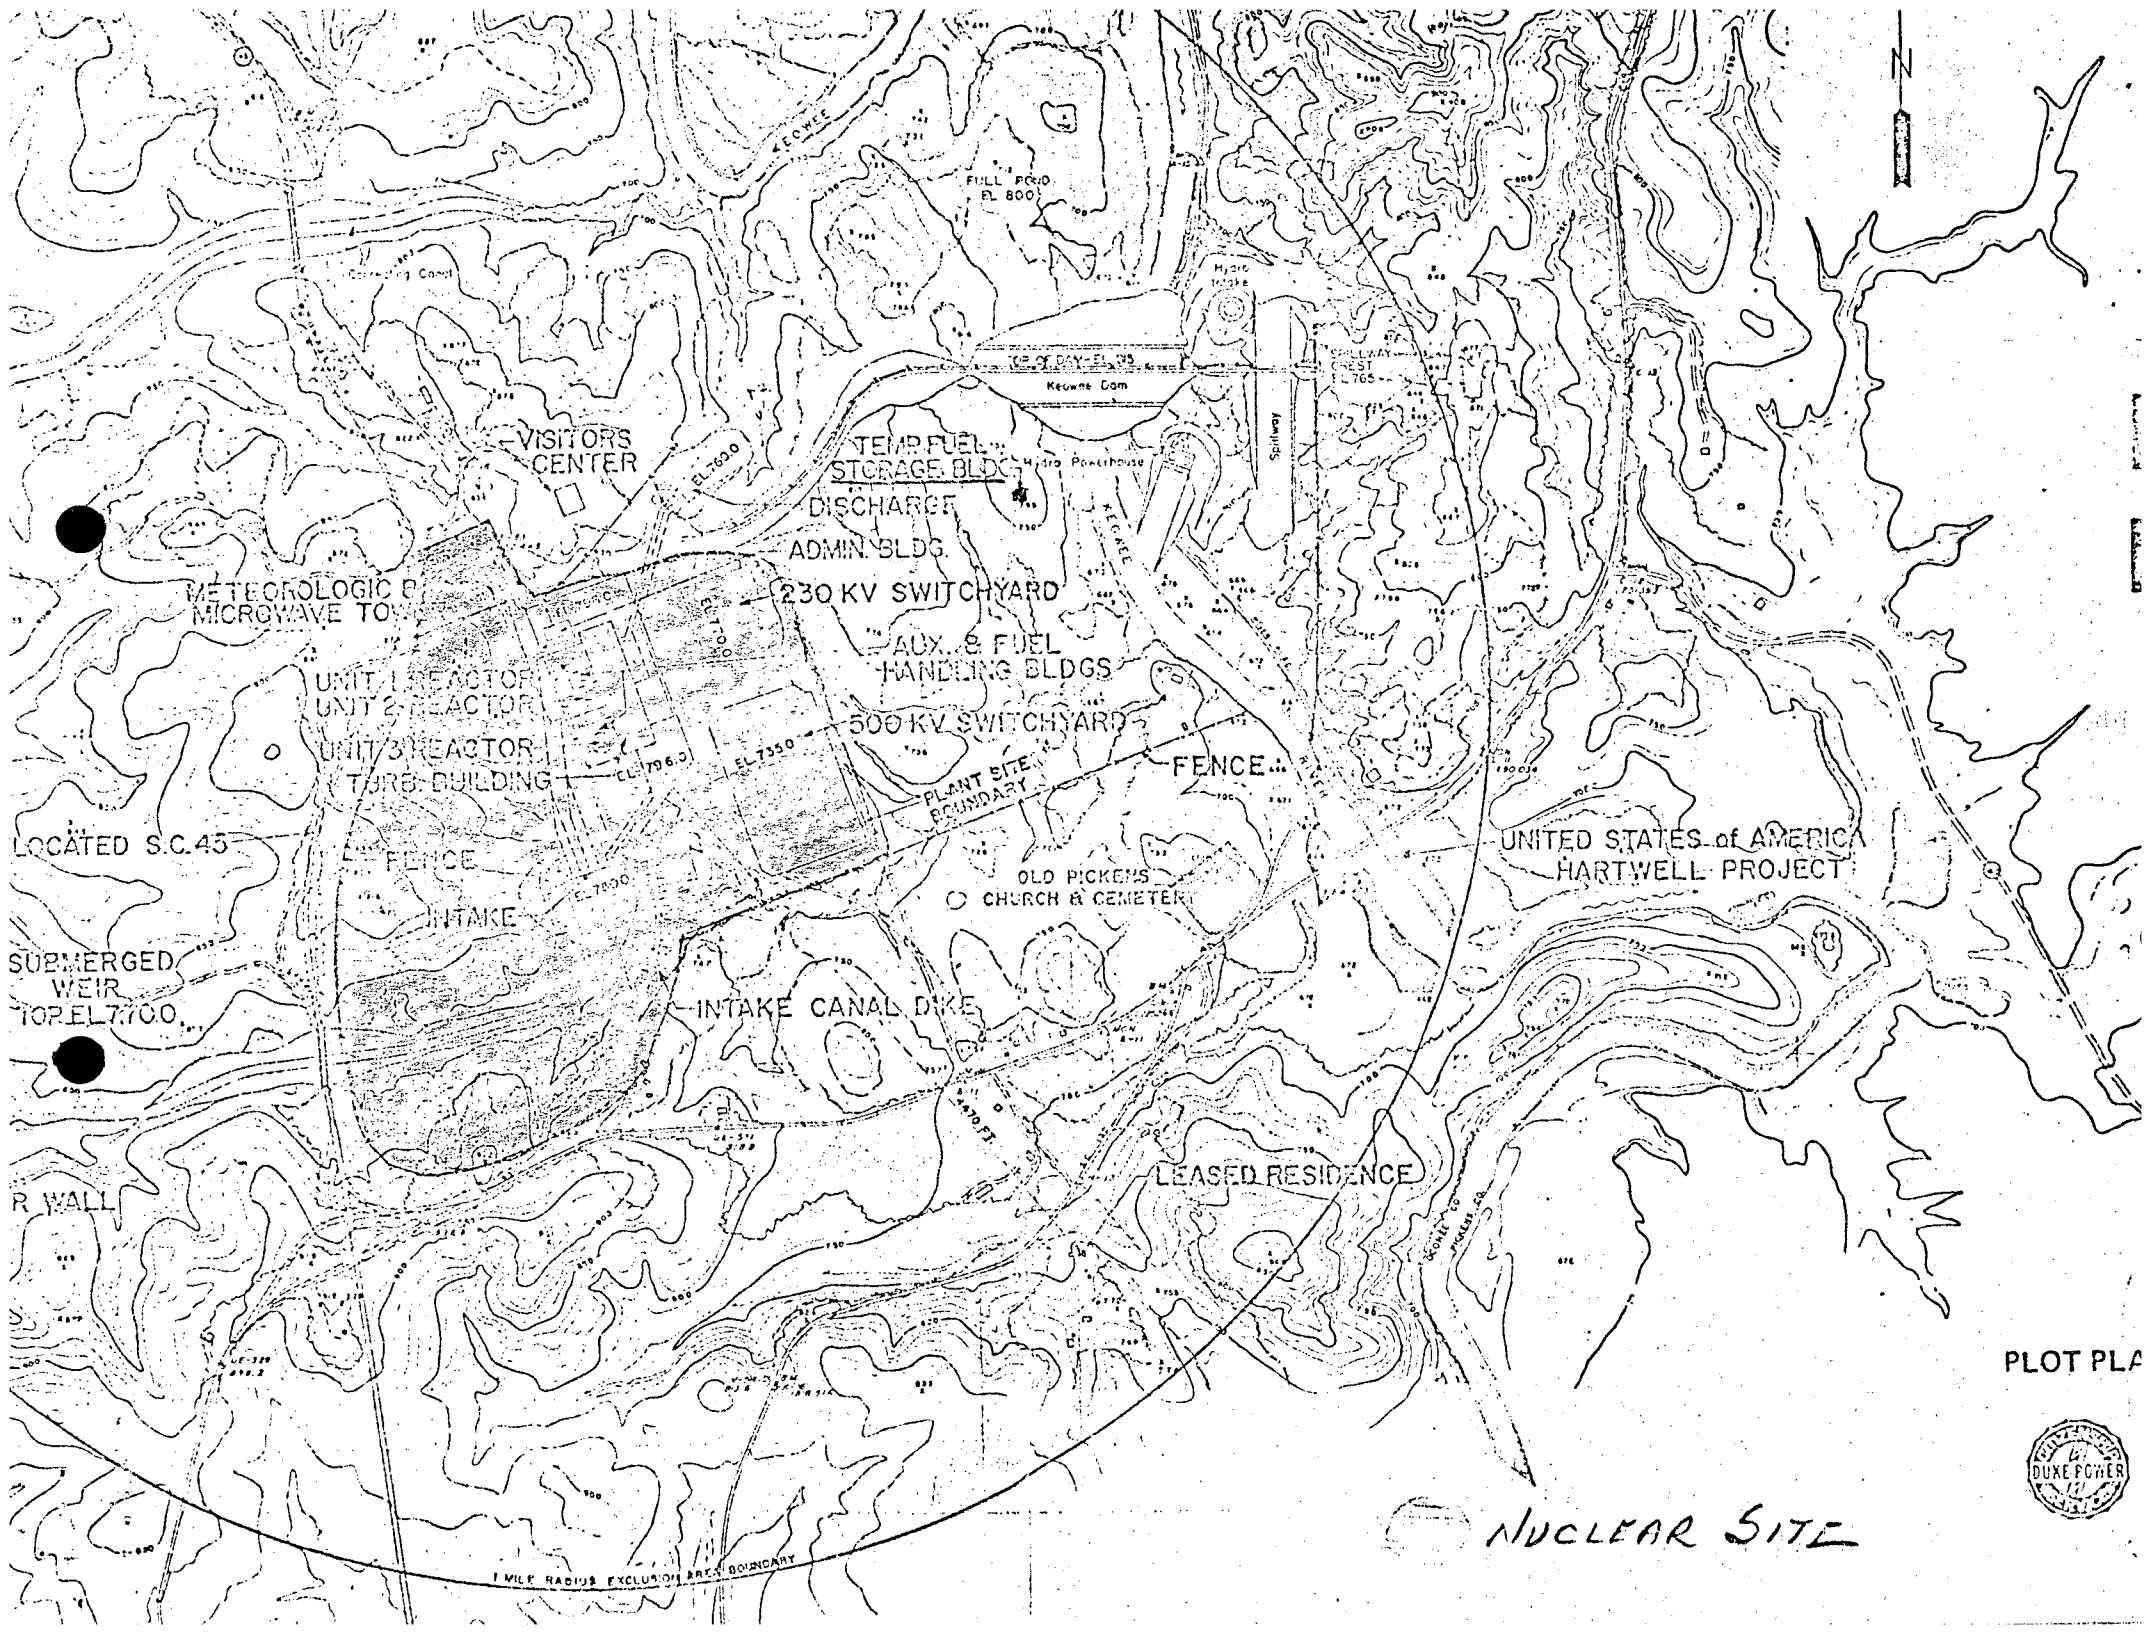
DUKE POWER COMPANY
Named Insured

By _____

COUNTERSIGNED BY

Robert S. C. Agent
ROBERT S. C. AGENT

Nuclear Energy Liability Insurance Binder



PLOT PL



NUCLEAR SITE

1 MILE RADIUS EXCLUSION AREA BOUNDARY

ROUTE TO PICKENS CO.

UNITED STATES OF AMERICA
HARTWELL PROJECT

OLD PICKENS
CHURCH & CEMETERY

LEASED RESIDENCE

INTAKE CANAL DIKE

PLANT SITE BOUNDARY

FENCE

500 KV SWITCHYARD

AUX. & FUEL HANDLING BLDGS

230 KV SWITCHYARD

DISCHARGE ADMIN. BLDG.

TEMP FUEL STORAGE BLDG

VISITORS CENTER

UNIT 1 REACTOR

UNIT 2 REACTOR

UNIT 3 REACTOR

TURB. BUILDING

METEOROLOGIC & MICROWAVE TOWER

LOCATED S.C. 43

SUBMERGED WEIR
TOP EL. 7700

R WALL

FULL POND
EL. 800

ICE OF DAY - EL. 765

Keowee Dam

Hydro Powerhouse

Spillway

KEOWEE

CONCRETE CANAL

EL. 7000

EL. 7960

EL. 7550

EL. 7060

EL. 7000

EL. 7000

EL. 6900

EL. 6800

EL. 6700

EL. 6600

EL. 6500

EL. 6400

EL. 6300

EL. 6200

EL. 6100

EL. 6000

EL. 5900

EL. 5800

EL. 5700

EL. 5600

EL. 5500

EL. 5400

EL. 5300

EL. 5200

EL. 5100

EL. 5000

EL. 4900

EL. 4800

EL. 4700

EL. 4600

EL. 4500

EL. 4400

EL. 4300

EL. 4200

EL. 4100

EL. 4000

EL. 3900

EL. 3800

EL. 3700

EL. 3600

EL. 3500

EL. 3400

EL. 3300

EL. 3200

EL. 3100

EL. 3000

EL. 2900

EL. 2800

EL. 2700

EL. 2600

EL. 2500

EL. 2400

EL. 2300

EL. 2200

EL. 2100

EL. 2000

EL. 1900

EL. 1800

EL. 1700

EL. 1600

EL. 1500

EL. 1400

EL. 1300

EL. 1200

EL. 1100

EL. 1000

EL. 900

EL. 800

EL. 700

EL. 600

EL. 500

EL. 400

EL. 300

EL. 200

EL. 100

EL. 0