

**NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL**  
(TEMPORARY FORM)

CONTROL NO: 2467

FILE: \_\_\_\_\_

FROM: Duke Power Company Charlotte, NC A C Thies		DATE OF DOC 2-27-75	DATE REC'D 3-5-75	LTR XX	TWX	RPT	OTHER
TO: Mr Giambusso		ORIG one signed	CC	OTHER	SENT AEC PDR <u>XX</u>		SENT LOCAL PDR <u>XX</u>
CLASS	UNCLASS XXXXXX	PROP INFO	INPUT	NO CYS REC'D 1	DOCKET NO: 50-269/270/287'		
DESCRIPTION: Ltr re their 8-30-74 ltr.....furnishing comments concerning their steam generator tubing surveillance program.....				ENCLOSURES:			
PLANT NAME: Oconee 1, 2, &3							

FOR ACTION/INFORMATION 3-5-75 ehf

BUTLER (L) W/ Copies	SCHWENCER (L) W/ Copies	ZIEMANN (L) W/ Copies	REGAN (E) W/ Copies
CLARK (L) w/ Copies	STOLZ (L) w/ Copies	DICKER (E) w/ Copies	LEAR (L) w/ Copies
PARR (L) W/ Copies	VASSALLO (L) W/ Copies	KNIGHTON (E) W/ Copies	SPELS W/ Copies
KNIEL (L) W/ Copies	PURPLE (L) W/ Copies	YOUNGBLOOD (E) W/ Copies	W/ Copies

**INTERNAL DISTRIBUTION**

<del>REG FILE</del>	TECH REVIEW	DENTON	LIC ASST	A/T IND
<del>NRC PDR</del>	SCHROEDER	GRIMES	R. DIGGS (L)	BRAITMAN
<del>OGC, ROOM P-506A</del>	MACCARY	GAMMILL	H. GEARIN (L)	SALTZMAN
<del>GOSSICK/STAFF</del>	KNIGHT	KASTNER	E. GOULBOURNE (L)	MELTZ
<del>CASE</del>	PAWLICKI	BALLARD	P. KREUTZER (E)	PLANS
GIAMBUSO	SHAO	SPANGLER	J. LEE (L)	MCDONALD
BOYD	STELLO		M. MAIGRET (L)	CHAPMAN
MOORE (L)	HOUSTON	ENVIRO	S. REED (E)	DUBE (Ltr)
DEYOUNG (L)	NOVAK	MULLER	M. SERVICE (L)	E. COUPE
SKOVHOLT (L)	ROSS	DICKER	S. SHEPPARD (L)	PETERSON
GOLLER (L) (Ltr)	IPPOLITO	KNIGHTON	M. SLATER (E)	HARTFIELD (2)
P. COLLINS	TEDESCO	YOUNGBLOOD	H. SMITH (L)	KLECKER
DENISE	LONG	REGAN	S. TEETS (L)	EISENHUT
REG OPR	LAINAS	PROJECT LDR	G. WILLIAMS (E)	WIGGINTON
FILE & REGION (2)	BENAROYA		V. WILSON (L)	
T.R. WILSON	VOLLMER	HARLESS	R. INGRAM (L)	
STEELE				

**EXTERNAL DISTRIBUTION**

1 - LOCAL PDR <u>Walhalla, S.C.</u>	1 - NATIONAL LABS	1 - PDR-SAN/LA/NY
1 - TIC (ABERNATHY) (1)(2)(10)	1 - W. PENNINGTON, Rm E-201 GT	1 - BROOKHAVEN NAT LAB
1 - NSIC (BUCHANAN)	1 - CONSULTANTS	1 - G. ULRIKSON, ORNL
1 - ASLB	1 - NEWMARK/BLUME/AGBABIAN	1 - AGMED (RUTH GUSSMAN) Rm B-127-GT
1 - Newton Anderson		1 - J. D. RUNKLES, Rm E-201 GT
14 - ACRS HOLDING/SENT To L.A. Sheppard		

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28201

A. C. THIES  
SENIOR VICE PRESIDENT  
PRODUCTION AND TRANSMISSION

P. O. Box 2178

February 27, 1975



Mr. Angelo Giambusso, Director  
Division of Reactor Licensing  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555


Re: Oconee Nuclear Station  
Docket Nos. 50-269, -270, -287

Dear Mr. Giambusso:

On August 30, 1974, a proposed revision to the Oconee Nuclear Station Technical Specifications was submitted to incorporate a program for steam generator tubing surveillance consistent with Regulatory Guide 1.83. This proposed technical specification revision was in response to Mr. Karl R. Goller's letter of July 18, 1974. Subsequent to this submittal, additional information concerning once-through steam generator (OTSG) tubing surveillance has become available to us and should be incorporated into the proposed technical specification. Therefore, it is requested that my submittal of August 30, 1974 be withdrawn from further consideration and review.

The Babcock & Wilcox Company forwarded comments on Regulatory Guide 1.83 to the Secretary of the Commission on August 26, 1974. It was B&W's position that Regulatory Guide 1.83 did not adequately reflect the important design and operating features of the OTSG which contribute to steam generator tube integrity. The essential differences between the OTSG and recirculation type steam generators as described in this submittal are:

1. The OTSG is not as susceptible to steam side corrosion attack because of the use of full flow condensate polishing with volatile chemical additives.
2. Solids, such as sodium phosphate, are not added.
3. The straight tube, straight shell configuration and broached tube support plate design minimize possible locations of stagnation.

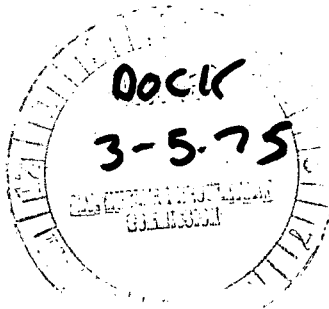

2467


Mr. Angelo Giambusso  
Page 2  
February 27, 1975

4. The once-through mode of operation eliminates bulk concentrations of impurities.
5. Testing has been performed to assure freedom from vibration damage.

During refueling of Oconee Unit 1, the steam generators were inspected using the program described in Regulatory Guide 1.83. Information from this inspection is being evaluated; however, preliminary results indicate that the Unit 1 steam generators are exceptionally clean and free of detectable defects.

Duke Power Company is presently re-evaluating its program for steam generator tubing surveillance to properly reflect the design and operating features of the once-through steam generator and to incorporate experience gained during the Oconee Unit 1 steam generator inspection. Upon completion of this program re-evaluation, appropriate technical specifications for steam generator tubing surveillance will be submitted. Therefore, the request for amendment of the Oconee Nuclear Station Technical Specifications dated August 30, 1974 is rescinded.

Very truly yours,



A. C. Thies

ACT:vr