

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

TO: Mr. E. Case	FROM: Duke Power Co. Charlotte, N.C. 28242 W. O. Parker, Jr.	DATE OF DOCUMENT 3-10-78
<input checked="" type="checkbox"/> LETTER <input checked="" type="checkbox"/> ORIGINAL <input type="checkbox"/> COPY	<input type="checkbox"/> NOTORIZED <input checked="" type="checkbox"/> UNCLASSIFIED	DATE RECEIVED 3-22-78
PROP	INPUT FORM	NUMBER OF COPIES RECEIVED 151620

DESCRIPTION Ltr trans the following: 1P

REACTOR VESSEL OVERPRESSURIZATION
DISTRIBUTION PER G. ZECH 10-21-76

PLANT NAME: Oconee Units 1-2-3 JCM 3-31-78

ENCLOSURE Description of a preliminary design concept & preliminary drawings of the over-pressure system modification..... 20P est.

Dist PER ROBERTA INGRAM 3/31/78 DRWGS TO FILES TO BE CHARGED

SAFETY FOR ACTION/INFORMATION OUT TO G. ZECH

BRANCH CHIEF: (7) REID	<i>ALL OTHERS RECEIVE LTR'S & REG ENCL ONLY.</i>
LIC. ASST:	
PROJECT MANAGER:	

INTERNAL DISTRIBUTION	
<i>REG FILE w/ DRWGS - CHARGE OUT TO ZECH</i>	
NRC PDR	
I & E (2)	
OELD	
GOSSICK & STAFF	
BOSNAK	
PAWLICKI	
NOVAK	
EISENHUT	
SHAO	
BAER	
BUTLER	
ZECH - <i>see FILES</i>	

EXTERNAL DISTRIBUTION		CONTROL NUMBER
LPDR: <i>WALHALLA SC</i>		780900056
TIC:		
NSIC:		
ACRS <i>16 CYS HOLDING/SENT TO LA CAT B</i>		

may 4

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

March 10, 1978

TELEPHONE: AREA 704
373-4083

Mr. Edson G. Case, Acting Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Attention: Mr. R. Reid, Chief
Operating Reactors Branch #4

Reference: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287

REGULATORY BUCKET FILE COPY

Dear Sir:

In your February 2, 1978 letter, additional information was requested concerning a conceptual design of an overpressure protection system modification. Please find attached a description of a preliminary design concept and the preliminary drawings of the system modification.

This overpressure protection system is a conceptual design only. It is our position that installation of this system would not provide any significant, additional protection for the public's health and safety above that currently provided by installed protection systems and administrative procedures.

Very truly yours,

William O. Parker, Jr.
William O. Parker, Jr. *By [Signature]*

RLG:ge
Attachments

780900056

ATTACHMENT 1

OVERPRESSURE PROTECTION SYSTEM PRELIMINARY DESIGN CONCEPT

The purpose of this design concept is to describe an additional redundant means to prevent an overpressurization incident caused by High Pressure Injection System (HPI) actuation.

This design concept includes an alarm which activates upon reaching an RCS temperature above Minimum Pressurization Temperature (MPT) to alert the operator to activate the overpressure protection system. This alarm monitors reactor coolant system temperature. Once this system is activated, a pressure switch, located on the HPI system as shown on attached Figure 1, senses RCS pressure. If RCS pressure exceeds the limiting value of approximately 500 psi, the pressure switch closes to energize a relay which trips the breakers to the HPI pumps.

The overpressure protection system is activated by valving into service the pressure switch and operating an electrical key-lock switch (S45/1VB2) in the control room. The pressure switch is valved out during normal operation abot MPT to prevent generation of the electrical signal indicating a high pressure condition. Both the pressure switch contact and the key-lock switch contact are required to energize the lock-out relay (1LOR/1VB2). During normal operation a fault in either the pressure switch or the key-lock switch will not cause the lock-out relay to be energized. Additionally, energizing the lock-out relay will not in itself cause a trip of the HPI pump breakers. The key-lock switch contact and the lock-out relay contact in the HPI pump breaker trip circuit must both be closed in order to trip the HPI pump by this means. Other trip features are not affected.

The following is a description of the series of events that would occur during a cooldown with this system installed:

Initial conditions: Normal cooldown in progress; HPI pump in operation to provide RCP seal water and RCS makeup water.

1. At a specific temperature above MPT, a warning alarm is energized. This statalarm monitors RCS temperature from a indicator located in the control room (See drawings OEE-118-31, -32).
2. After the alerting statalarm is energized and as directed by the station procedure for cooldown, the control operator activates the overpressure protection system. The HPI isolation valve, HP-26, is verified shut, its breaker racked out and tagged as required by the procedure. The overpressure protection system is activated by valving into service the pressure switch (See design Figure 1) and operating the key-lock switch. The overpressure protection system is now aligned for operation. As normal cooldown continues, if the setpoint of the pressure switch is not exceeded, a normal cold shutdown condition is achieved without further overpressure protection system actions.

3. However, if the setpoint of the pressure switch is exceeded, a pair of contacts in the circuit to the lock-out relay (1LOR/1VB2) are closed. See Elementary Diagram, H. P. Injection System, Overpressure Trip, OEE-XXX. Contacts S34/1VB2 2a, 2b had been previously closed by operation of the key-lock switch. Thus, lock-out relay, 1LOR/1VB2, is energized causing contacts in the trip circuit of each HPI pump breaker to close. See drawings OEE-117-47, -76, -62.

In this trip circuit, contacts from both the lock-out relay and the key-lock switch are required to energize the trip coil. (Contacts 1LOR/1VB2 1F, 1Fa and S45/1VB2 4a, 4b for HPI pump 1A; 1LOR/1VB2 2F, 2Fa and S45/1VB2 6a, 6b for 1B; 1LOR/1VB2 3F, 3Fa and S45/1VB2 8a, 8b for 1C).

4. When RCS pressure has been reduced below its reset value, the control operator must manually reset the lock-out relay. Upon doing this, the HPI pumps may be re-started.
5. When a heatup from cold shutdown commences, the overpressure protection system remains in operation until the deactivate alarm is energized. This statalarm monitors RCS temperature and energizes at a specific temperature above MPT. Please see drawings OEE-118-29, -30. When directed by the station procedure for heatup, the control operator will deactivate the overpressure protection system by valving out of service the pressure switch and de-energizing the key-lock switch.

Elementary drawings have been provided for Unit 1 systems only; a similar design could be utilized for Unit 2 and Unit 3.

ATTACHMENT 2

PRELIMINARY DESIGN DRAWINGS

Location of pressure switch	Figure 1
"Activate" Statalarm	OEE-118-31, -32
Overpressure Trip (Lock-out Relay)	OEE-XXX
HPI Pump Motor Control Circuit, No. 1A	OEE-117-47
No. 1B	OEE-117-76
No. 1C	OEE-117-62
"De-activate" Statalarm	OEE-118-29, -30

TO BE ADDED FOR
RX VESSEL NDT OVER PRESS.
PROTECTION

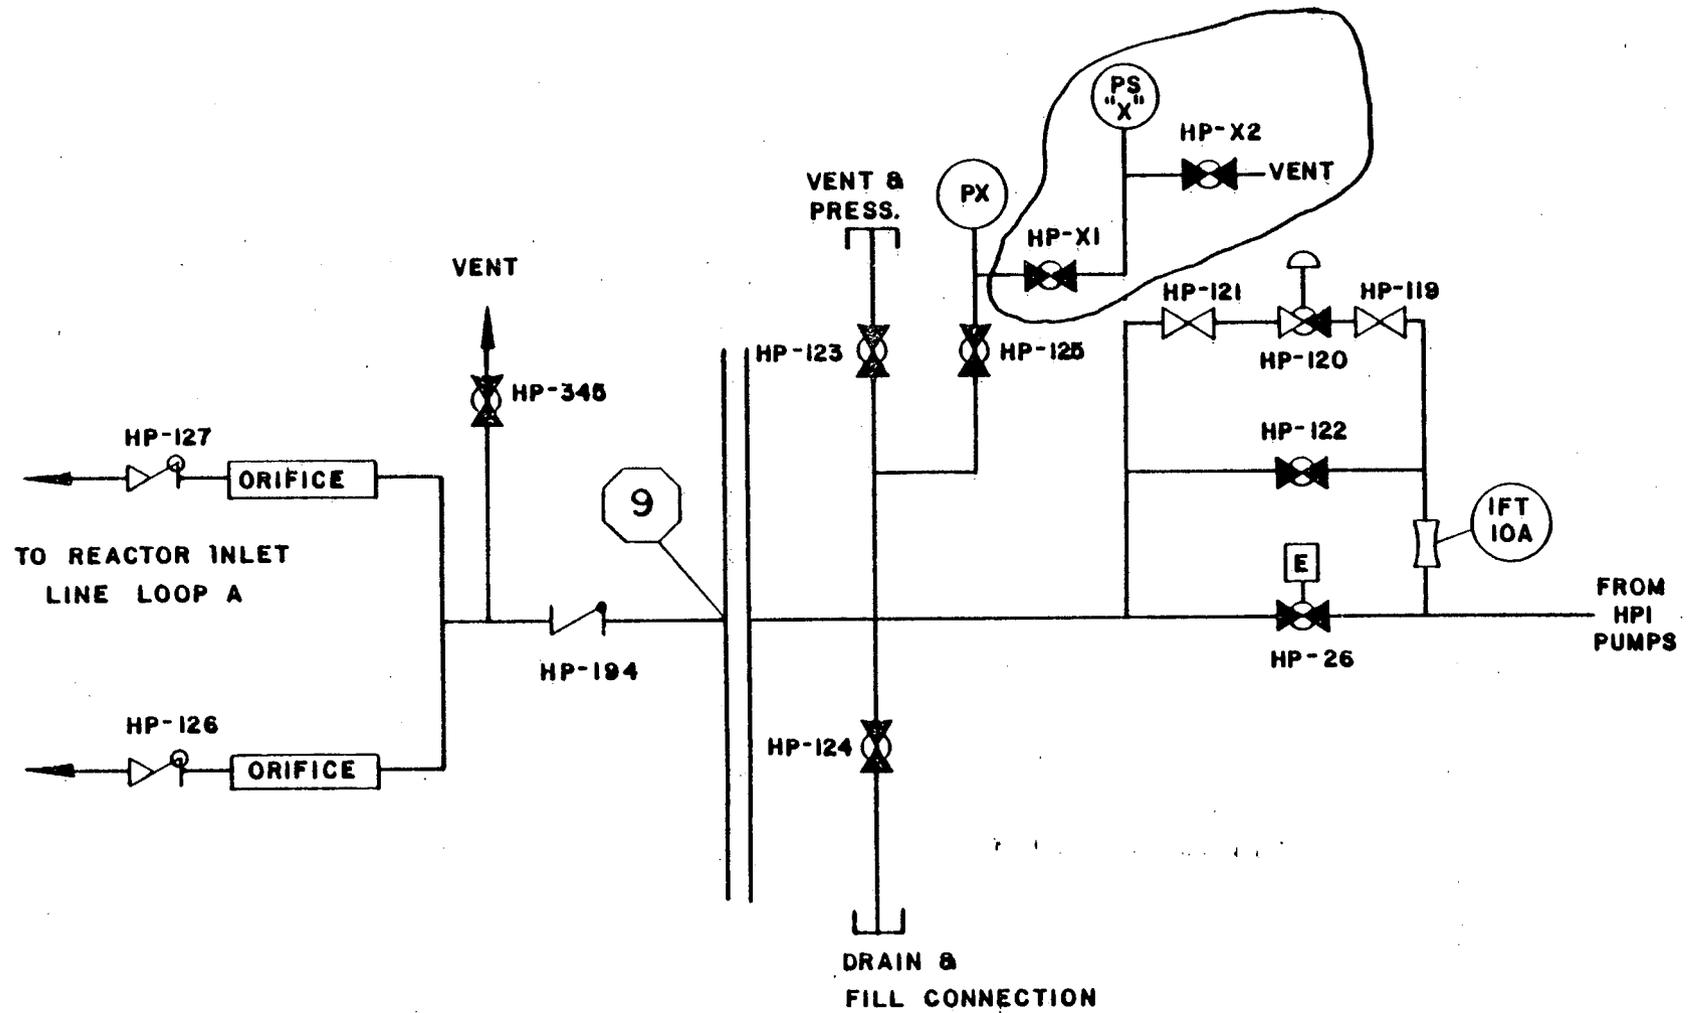


FIGURE 1