




Fort Mims Dr

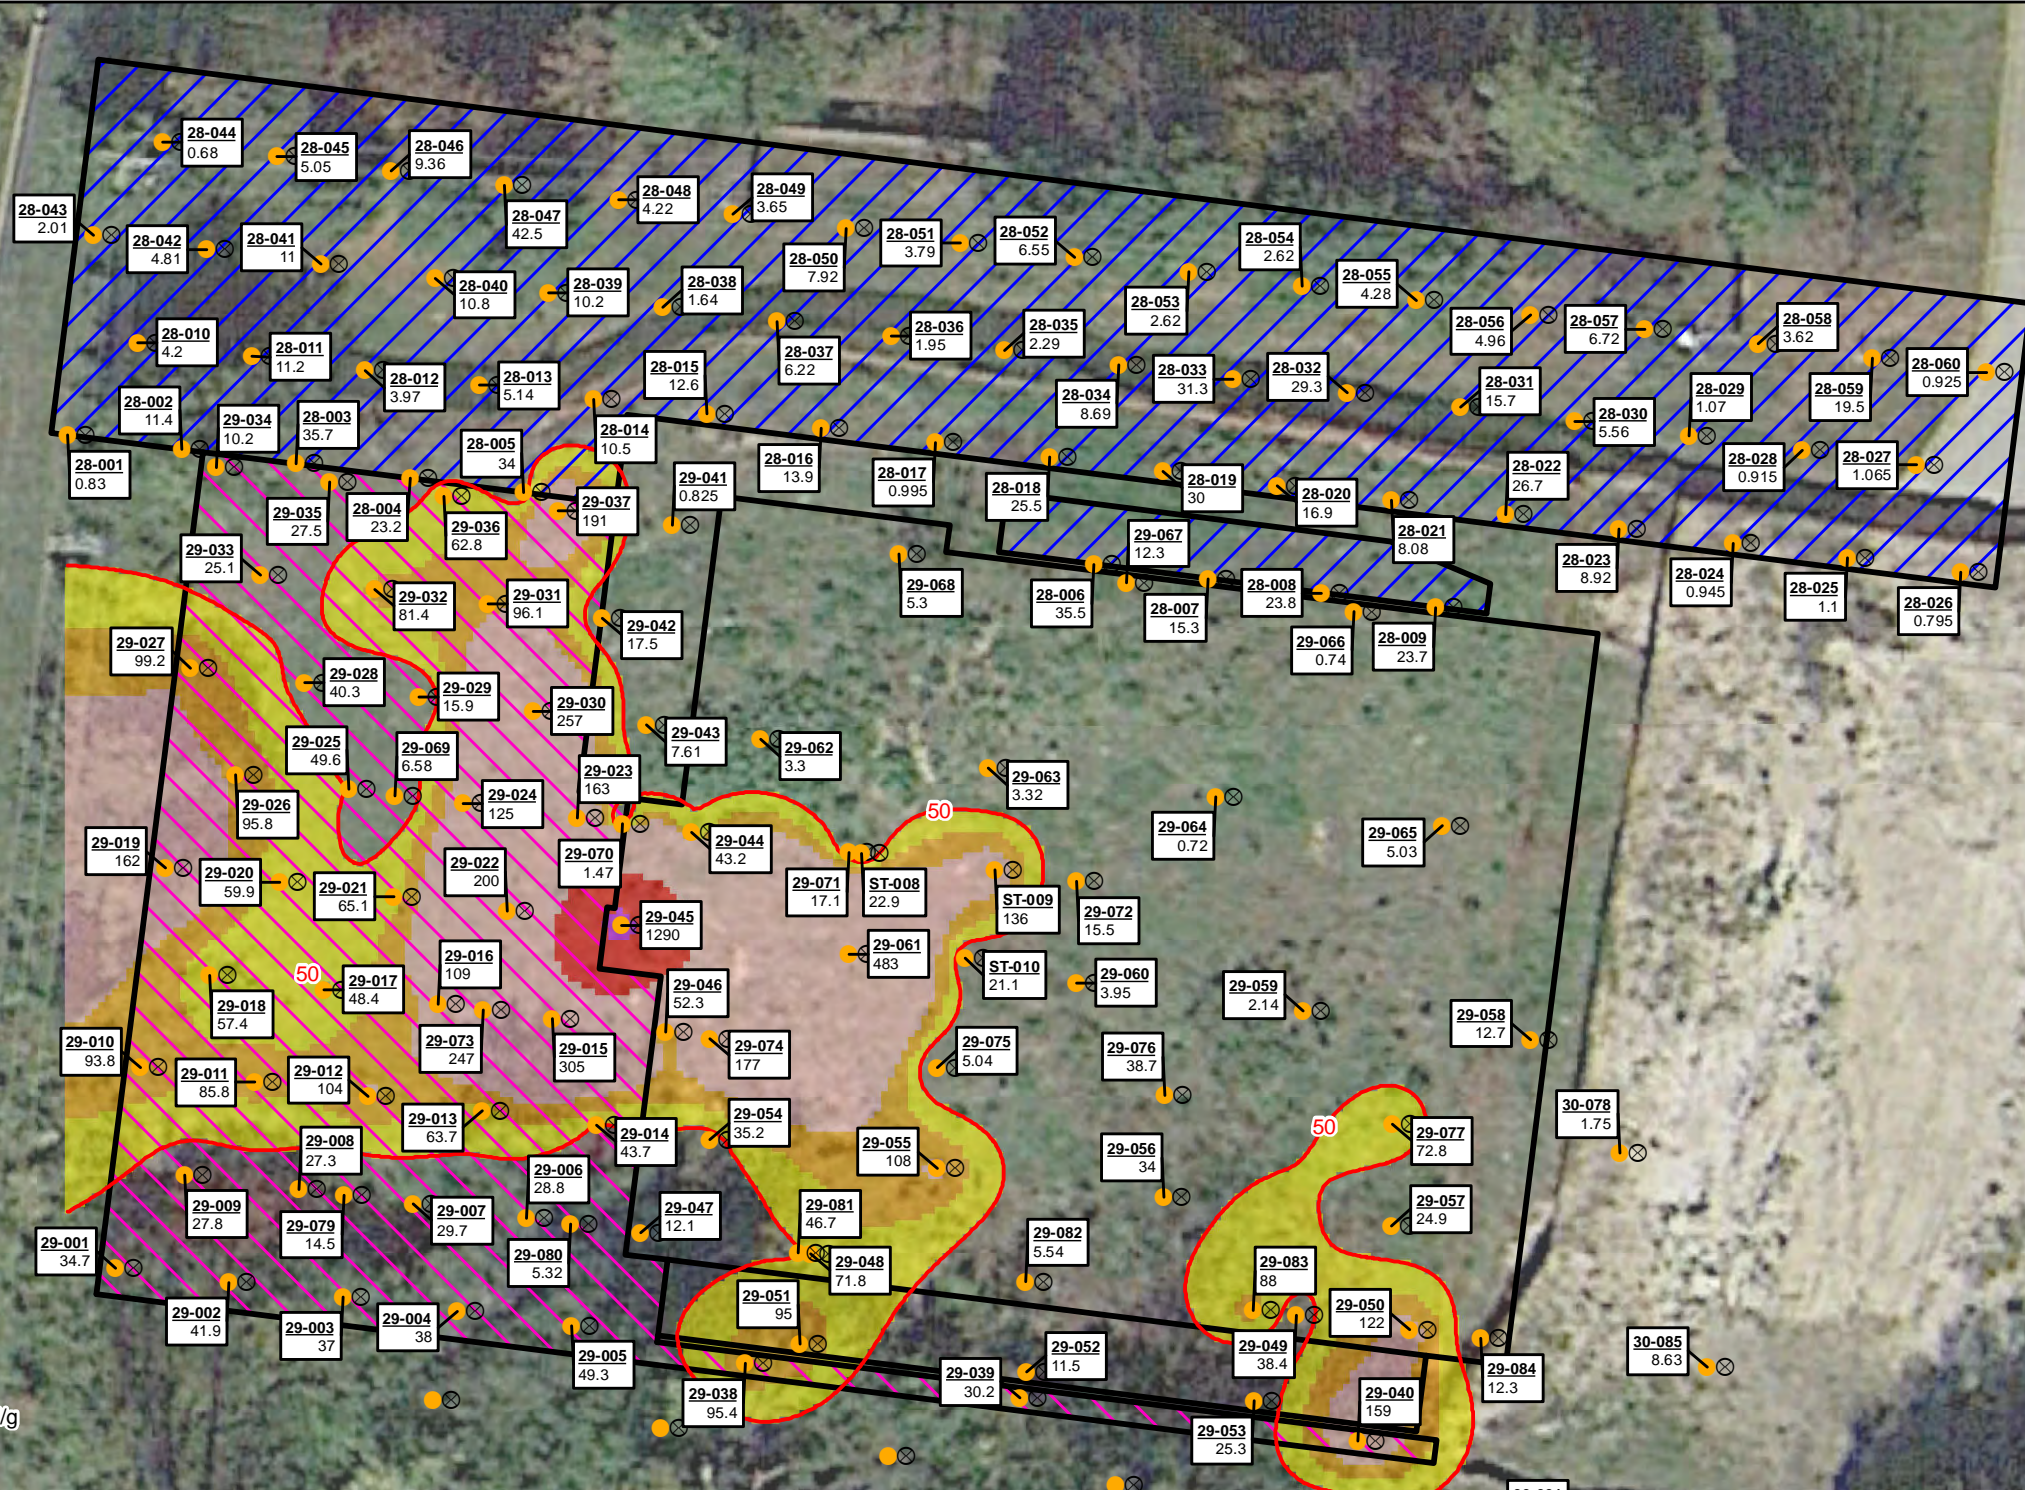


Note:  
-All Sample Units are in pCi/g  
-<sup>14</sup>C Site Screening Level (SSL) = 50 pCi/g

**Legend**

- ⊗ Soil Sample Location
- <sup>14</sup>C SSL Isocontour (pCi/g)
- ▨ FMF-28
- ▨ FMF-29

**<sup>14</sup>C Isoconcentrations (pCi/g)**

- 0 - 50
- 50 - 75
- 75 - 100
- 100 - 500
- 500 - 1,000
- 1,000 - 1,500



**Sigman Aldrich Soil Results**  
**<sup>14</sup>C - 0.15 Meter Depth**  
Sigman Aldrich Fort Mims Facility  
11542 Fort Mims drive  
Maryland Heights, Missouri

REQUESTED BY: M. Norton	
DRAWN BY: N. Rinehart	
DATE: 2/2/2016	
PROJECT NO: 0888818163	

X:\DD\ES\Results\02015\_C14\_0\_15.mxd