




Fort Mims Dr

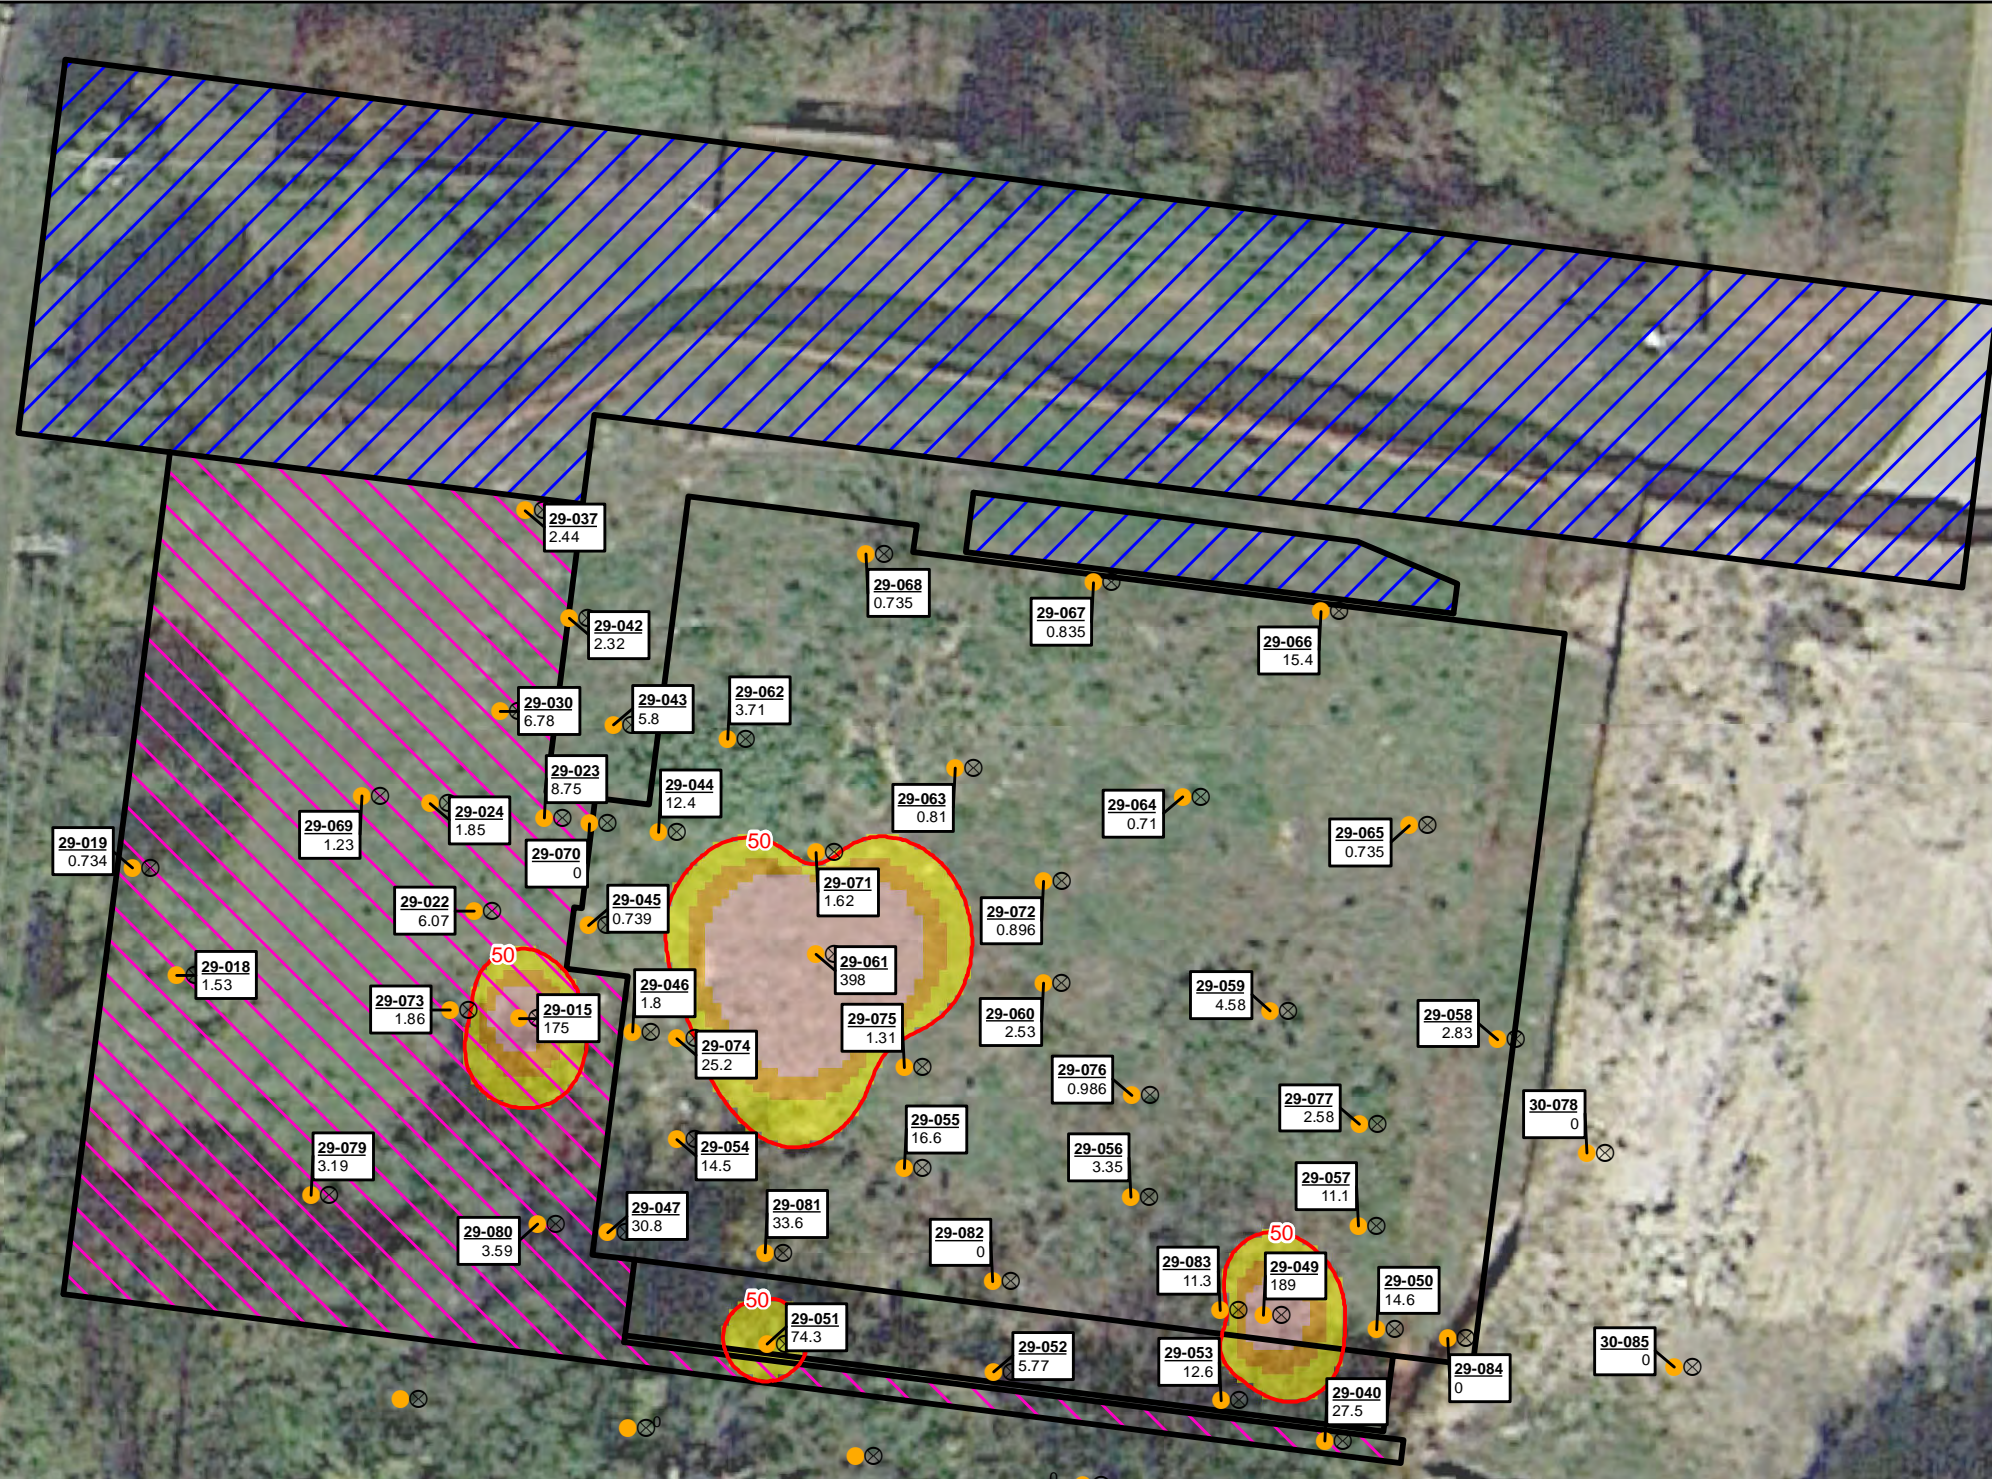


Note:
-All Sample Units are in pCi/g
-¹⁴C Site Screening Level (SSL) = 50 pCi/g

Legend

- ⊗ Soil Sample Location
- ¹⁴C SSL Isocontour (pCi/g)
- ▨ FMF-28
- ▨ FMF-29

¹⁴C Isoconcentrations (pCi/g)

0 - 50
50 - 75
75 - 100
100 - 500
500 - 1,000
1,000 - 1,500



Sigman Aldrich Soil Results
¹⁴C - 2 Meter Depth
Sigman Aldrich Fort Mims Facility
11542 Fort Mims drive
Maryland Heights, Missouri

REQUESTED BY: M. Norton	
DRAWN BY: N. Rinehart	
DATE: 2/2/2016	
PROJECT NO: 0888818163	

X:\DDSES\Results\022015_C14_2.mxd