LNP COL 2.4-4

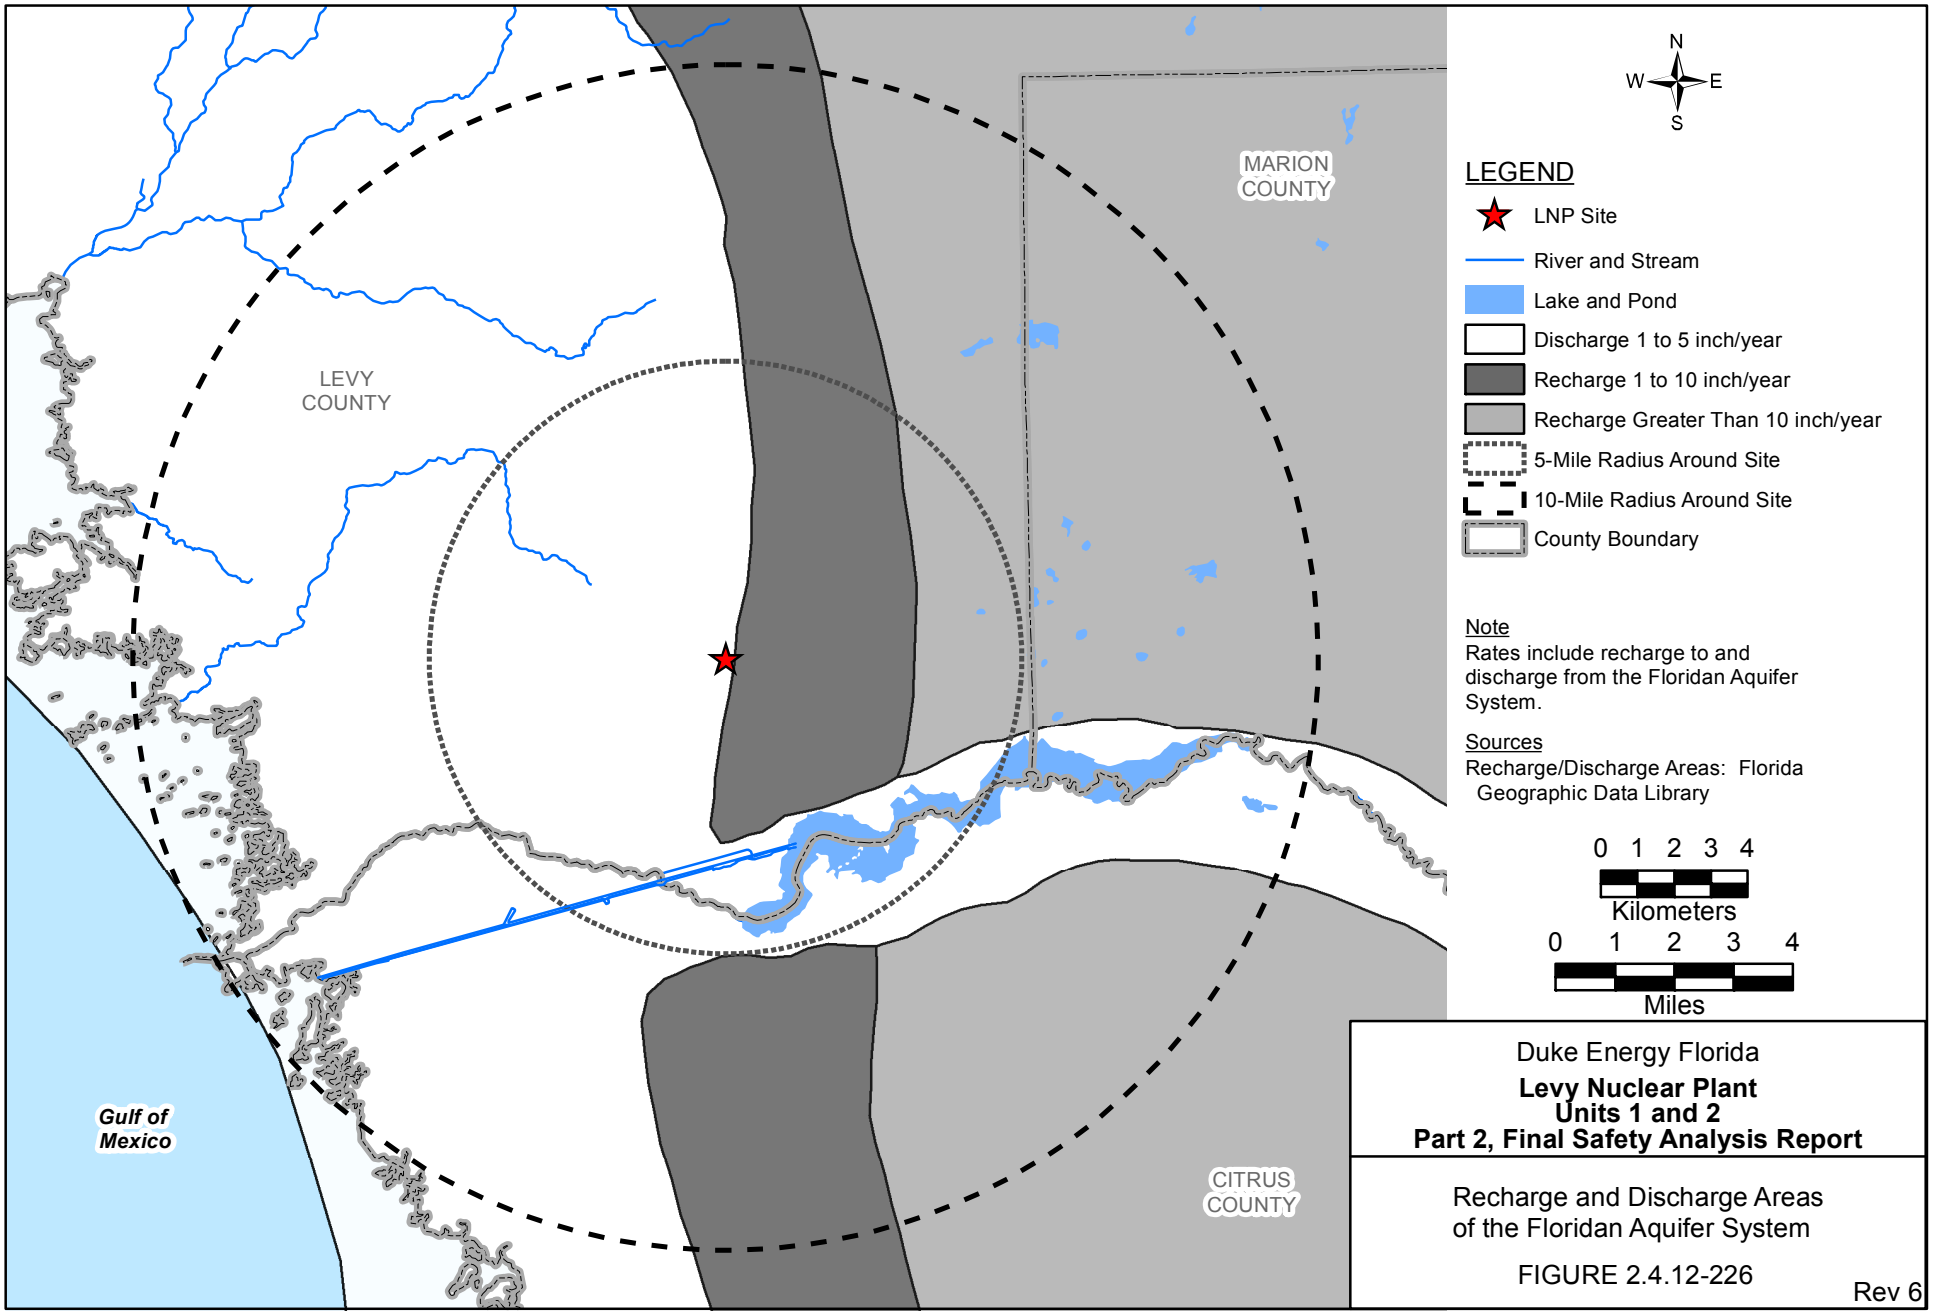

Duke Energy Florida

Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

Recharge and Discharge Areas of the Floridan Aquifer System

FIGURE 2.4.12-226

Rev 6