


# LNP DEP 6.4-2

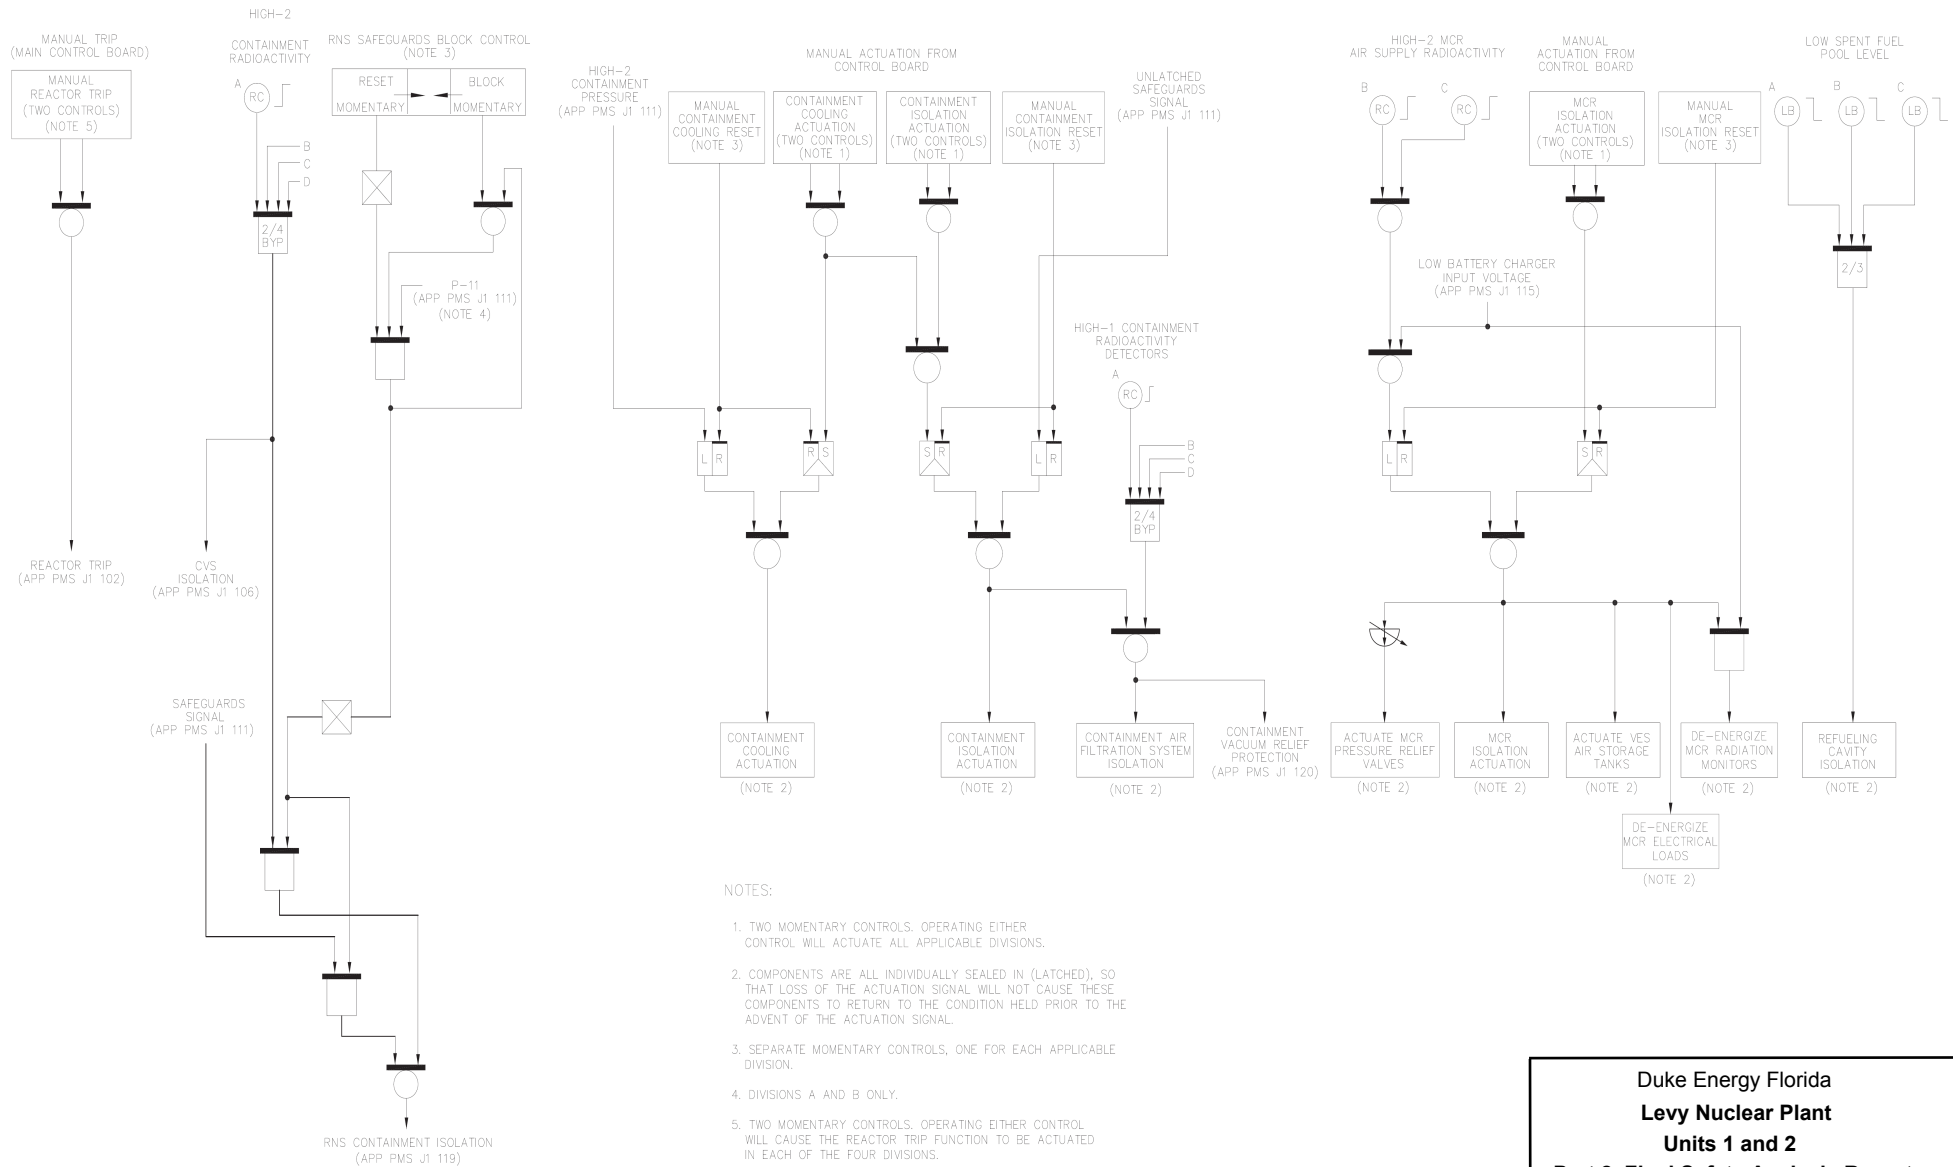

**NOTES:**

1. TWO MOMENTARY CONTROLS. OPERATING EITHER CONTROL WILL ACTUATE ALL APPLICABLE DIVISIONS.
2. COMPONENTS ARE ALL INDIVIDUALLY SEALED IN (LATCHED), SO THAT LOSS OF THE ACTUATION SIGNAL WILL NOT CAUSE THESE COMPONENTS TO RETURN TO THE CONDITION HELD PRIOR TO THE ADVENT OF THE ACTUATION SIGNAL.
3. SEPARATE MOMENTARY CONTROLS, ONE FOR EACH APPLICABLE DIVISION.
4. DIVISIONS A AND B ONLY.
5. TWO MOMENTARY CONTROLS. OPERATING EITHER CONTROL WILL CAUSE THE REACTOR TRIP FUNCTION TO BE ACTUATED IN EACH OF THE FOUR DIVISIONS.

**Duke Energy Florida**  
**Levy Nuclear Plant**  
**Units 1 and 2**  
**Part 2, Final Safety Analysis Report**

Functional Diagram:  
 Containment and Other Protection  
 Figure 7.2-202