


2998-G-082
SH 2

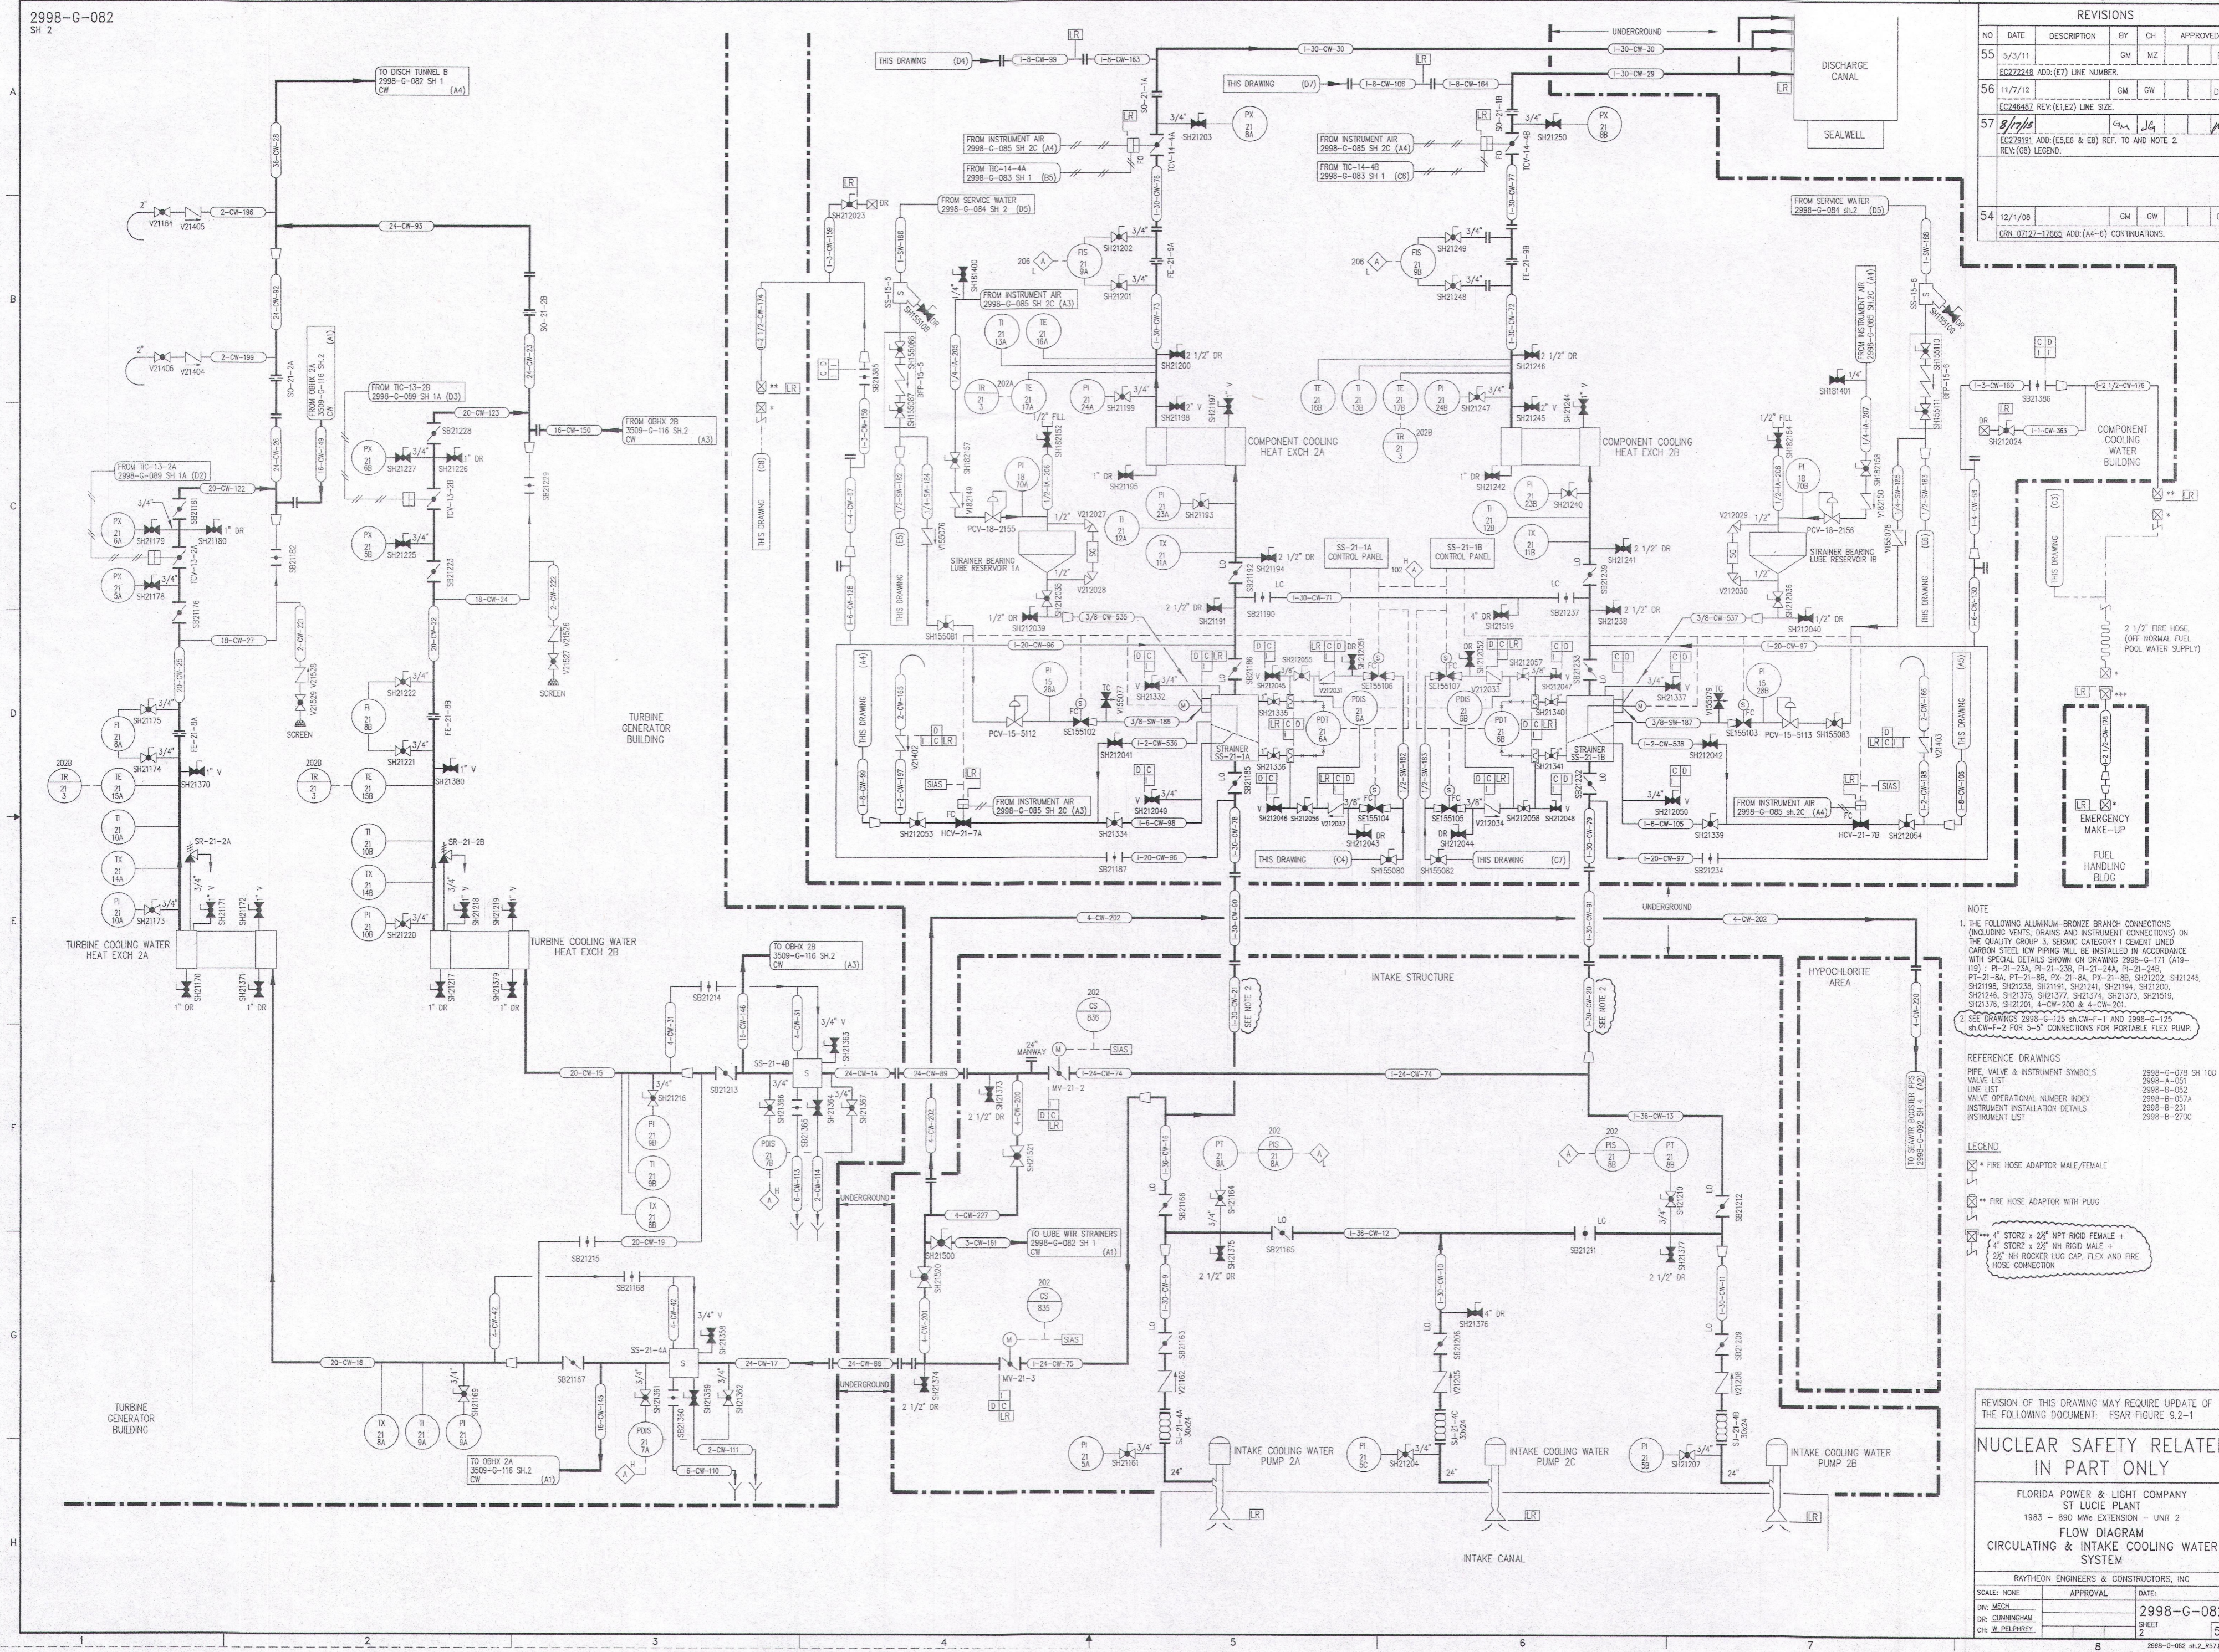

REVISIONS						
NO	DATE	DESCRIPTION	BY	CH	APPROVED	
55	5/3/11	EC272248 ADD: (E7) LINE NUMBER.	GM	MZ		DG
56	11/7/12	EC246482 REV: (E1, E2) LINE SIZE.	GM	CW		DG
57	8/7/13	EC279191 ADD: (E5, E6 & E8) REF TO AND NOTE 2. REV: (G8) LEGEND.	GM	JL		DG
54	12/1/08	CNR 07127-17665 ADD: (A4-6) CONTINUATIONS.	GM	CW		DC

NOTE
 1. THE FOLLOWING ALUMINUM-BRONZE BRANCH CONNECTIONS (INCLUDING VENTS, DRAINS AND INSTRUMENT CONNECTIONS) ON THE QUALITY GROUP 3, SEISMIC CATEGORY I CEMENT UNED CARBON STEEL, LOW PIPING WILL BE INSTALLED IN ACCORDANCE WITH SPECIAL DETAILS SHOWN ON DRAWING 2998-G-171 (A19-119) : PI-21-23A, PI-21-23B, PI-21-24A, PI-21-24B, PI-21-84, PI-21-88, PI-21-8A, PI-21-8B, SH21202, SH21245, SH21198, SH21238, SH21191, SH21244, SH21194, SH21200, SH21246, SH21375, SH21377, SH21374, SH21373, SH21519, SH21376, SH21201, 4-CW-200 & 4-CW-201.
 2. SEE DRAWINGS 2998-G-172 SH-CW-1 AND 2998-G-173 SH-CW-2 FOR 3-5 CONNECTIONS FOR PORTABLE FLEX PUMP.

REFERENCE DRAWINGS	
PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-678 SH 100
VALVE LIST	2998-A-051
LINE LIST	2998-B-052
VALVE OPERATIONAL NUMBER INDEX	2998-B-057A
INSTRUMENT INSTALLATION DETAILS	2998-B-231
INSTRUMENT LIST	2998-B-270C

LEGEND
FIRE HOSE ADAPTOR MALE/FEMALE
FIRE HOSE ADAPTOR WITH PLUG

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.2-1

**NUCLEAR SAFETY RELATED
IN PART ONLY**

FLORIDA POWER & LIGHT COMPANY
 ST LUCIE PLANT
 1983 - 890 MWe EXTENSION - UNIT 2
 FLOW DIAGRAM
 CIRCULATING & INTAKE COOLING WATER SYSTEM

SCALE:	APPROVAL:	DATE:
NONE		

DATE: 2998-G-082
 SHEET: 2
 OF 2

D44