


2998-G-089
SH 1A

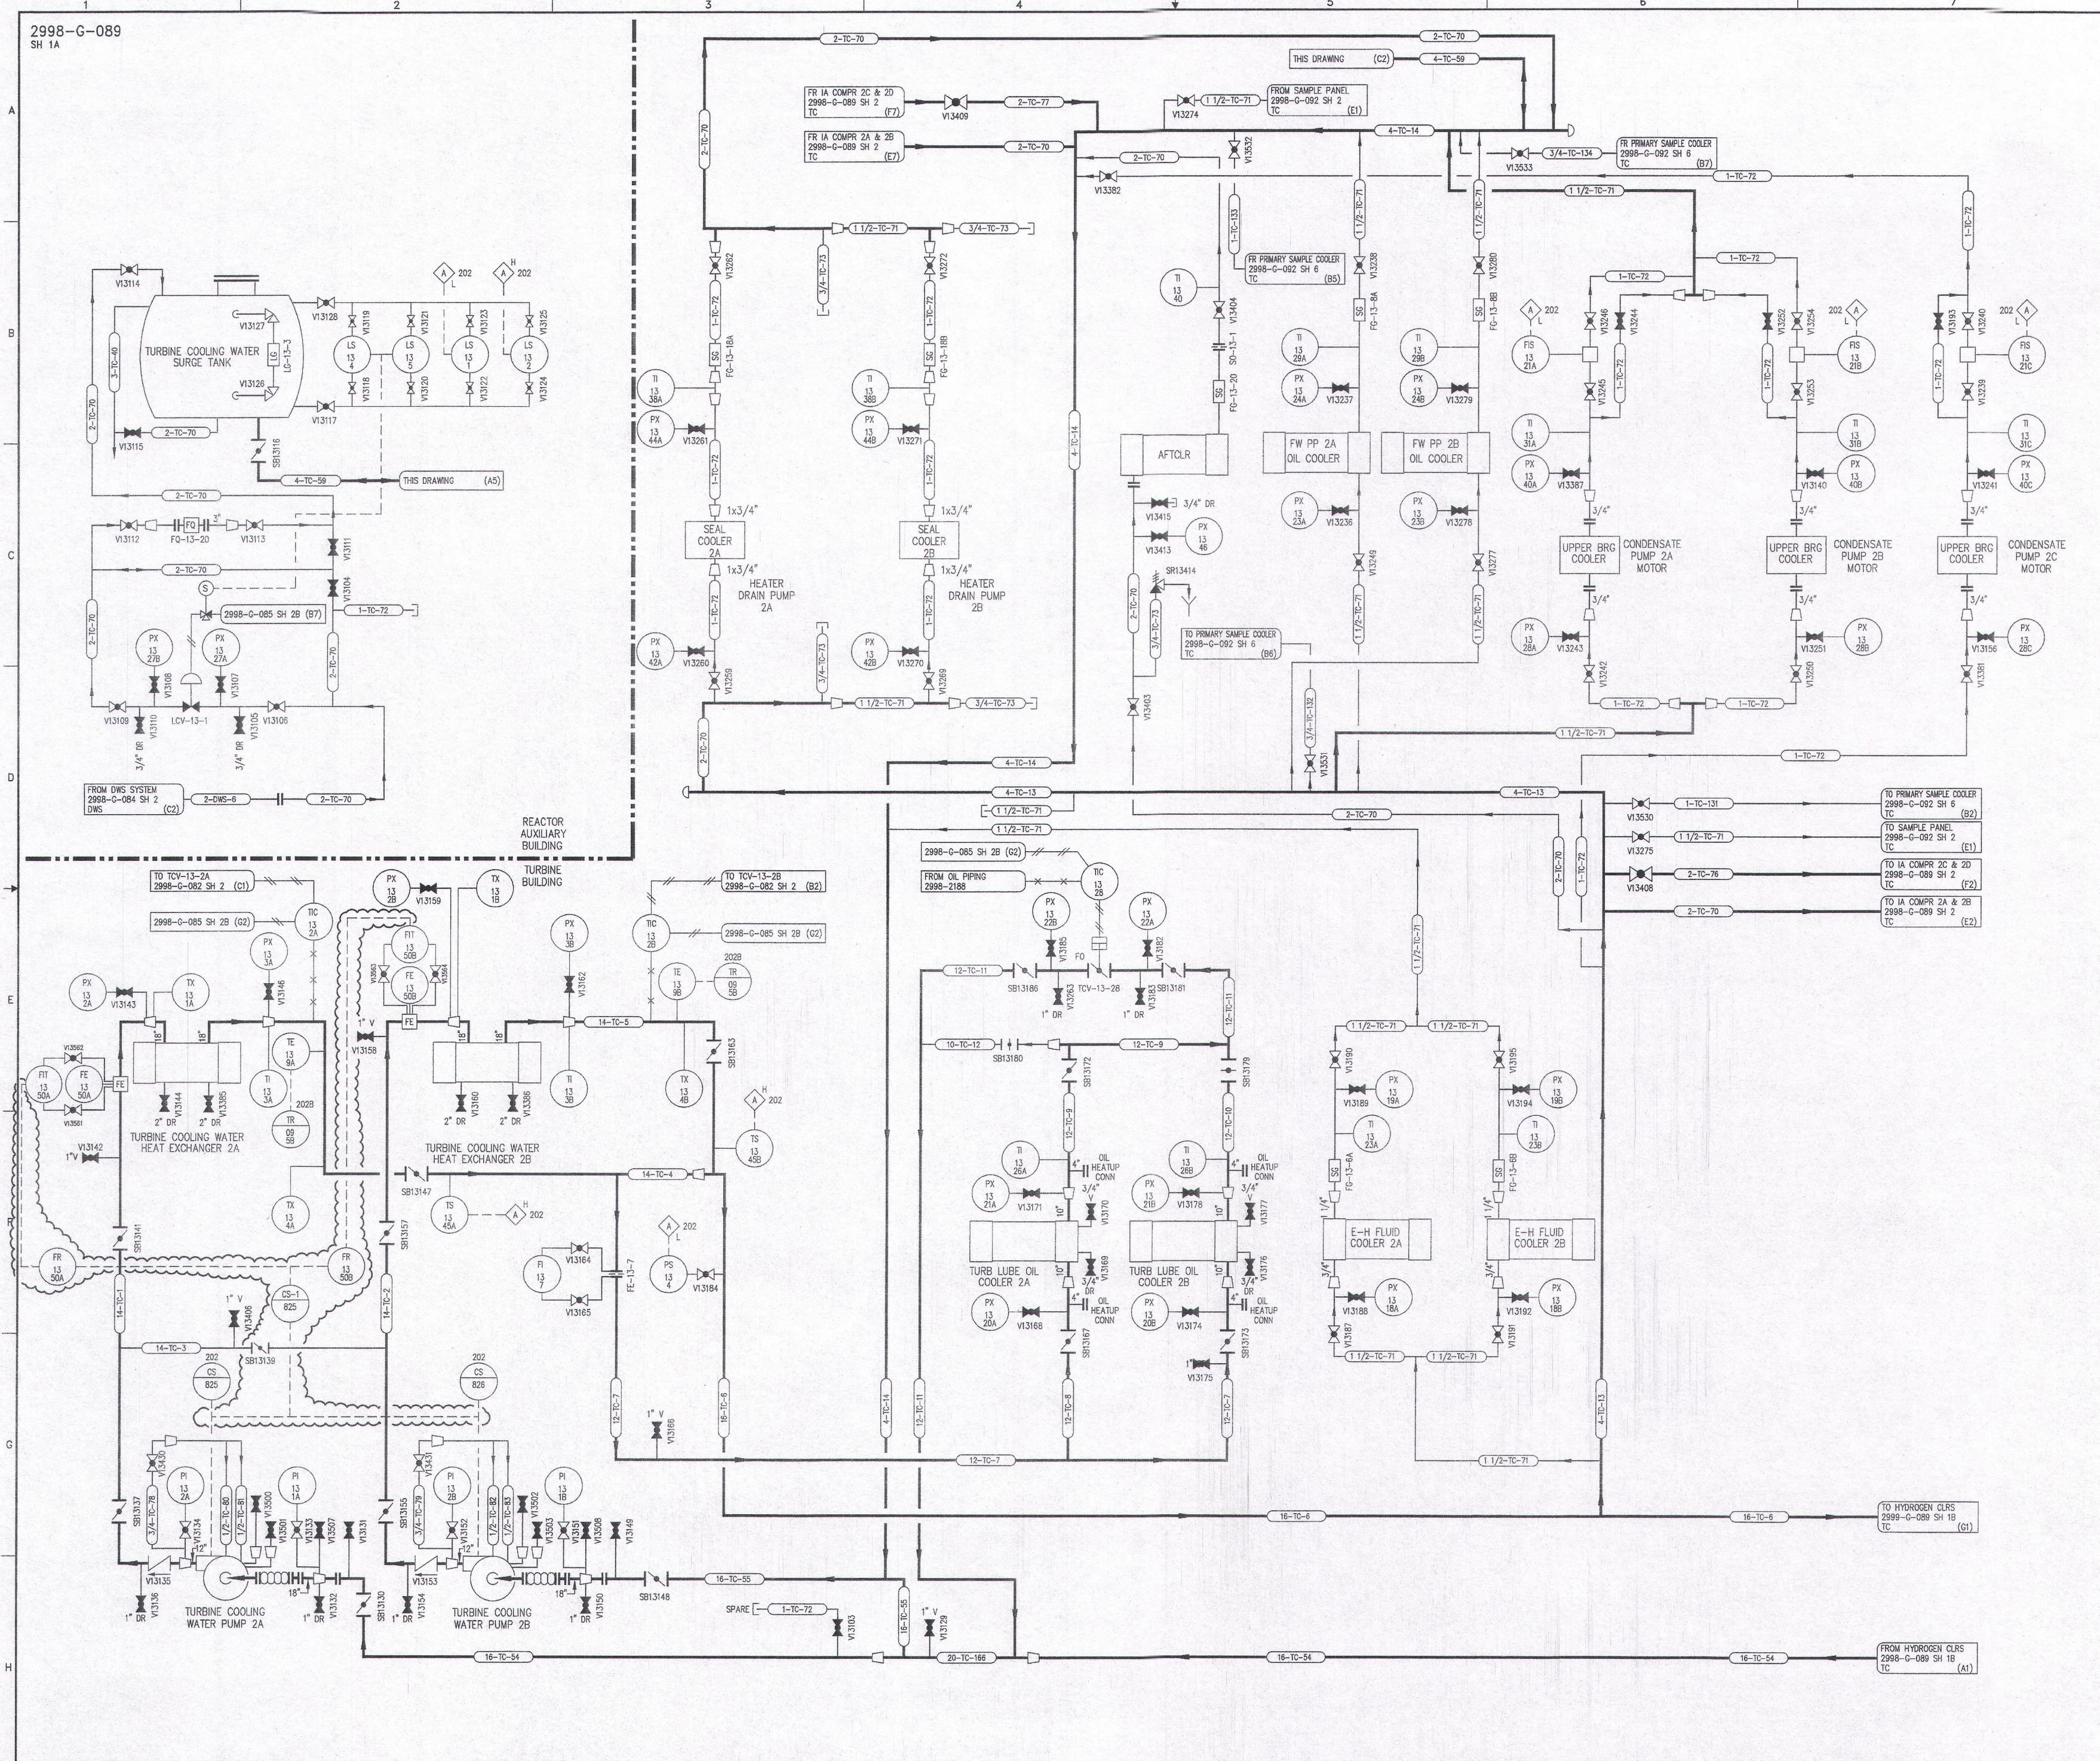

REVISIONS						
NO	DATE	DESCRIPTION	BY	CH	APPROVED	
19	8/2/95		JCG	WJH		JJZ
DCR-SUM-94-057; REDRAWN						
20	12/5/07		GM	GW		PGB
PCM 06179 ADD: (A5,D5 & D6) VALVES & PIPING.						
21	7/23/08		GM	GW		DG
PCM 08086 REV: (F2 & E3) INST. NUMBERS. PCM 06149 ADD: (B5,A6,C5 & D7) CONTINUATIONS. REV: (A5-B5,A5-B6,C5 & D6) VALVE MODES & PIPING LAYOUT.						
22	6/28/12		GM	GW		DG
EC271672 ADD: (C2,H3) CAPS. DEL: (A2-H3) PIPING, VALVES & CHEM. FEED TANK.						
23	11/7/12		GM	GW		DG
EC246487 ADD: (E1,E2) INSTRUMENTS, PIPING & VALVES. REV: (E3) LINE NUMBER, (F3,H4) PIPING LINE UP.						
24	11/13/12		PDB	MZ		DG
EC249893 DEL: (B3-D3)(B4-D4) PIPING & VALVES. ADD: (C3,C4) REDUCERS						
25	2/1/13		PDB	GM		JJZ
EC277490 REV: (G2) VALVE MODE. ADD: (E1-G1)(E2-G2) INSTRUMENTATION						

REFERENCE DRAWINGS
 PIPING, VALVES & INSTRUMENT SYMBOLS 2998-G-078 SH 100
 VALVE LIST 2998-A-051
 LINE LIST 2998-B-052
 VALVE OPERATIONAL NUMBER INDEX 2998-B-057A
 INSTRUMENT INSTALLATION DETAILS 2998-B-231
 INSTRUMENT LIST 2998-B-270C

NOTE:
 THIS DRAWING IS MADE FROM REV. 18
 OF DRAWING 2998-G-089 SH 1

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.2-9

FLORIDA POWER & LIGHT COMPANY
 ST LUCIE PLANT
 1983 - 890 MWe EXTENSION - UNIT 2
FLOW DIAGRAM
TURBINE COOLING WATER SYSTEM

RAYTHEON ENGINEERS & CONSTRUCTORS, INC		
SCALE: NONE	APPROVAL	DATE:
DR: MCH	2998-G-089	SHEET 1A
DR: J. GIBB		
CH: M. PULPHERY		25

D49