


WLS SUP 9.2-4

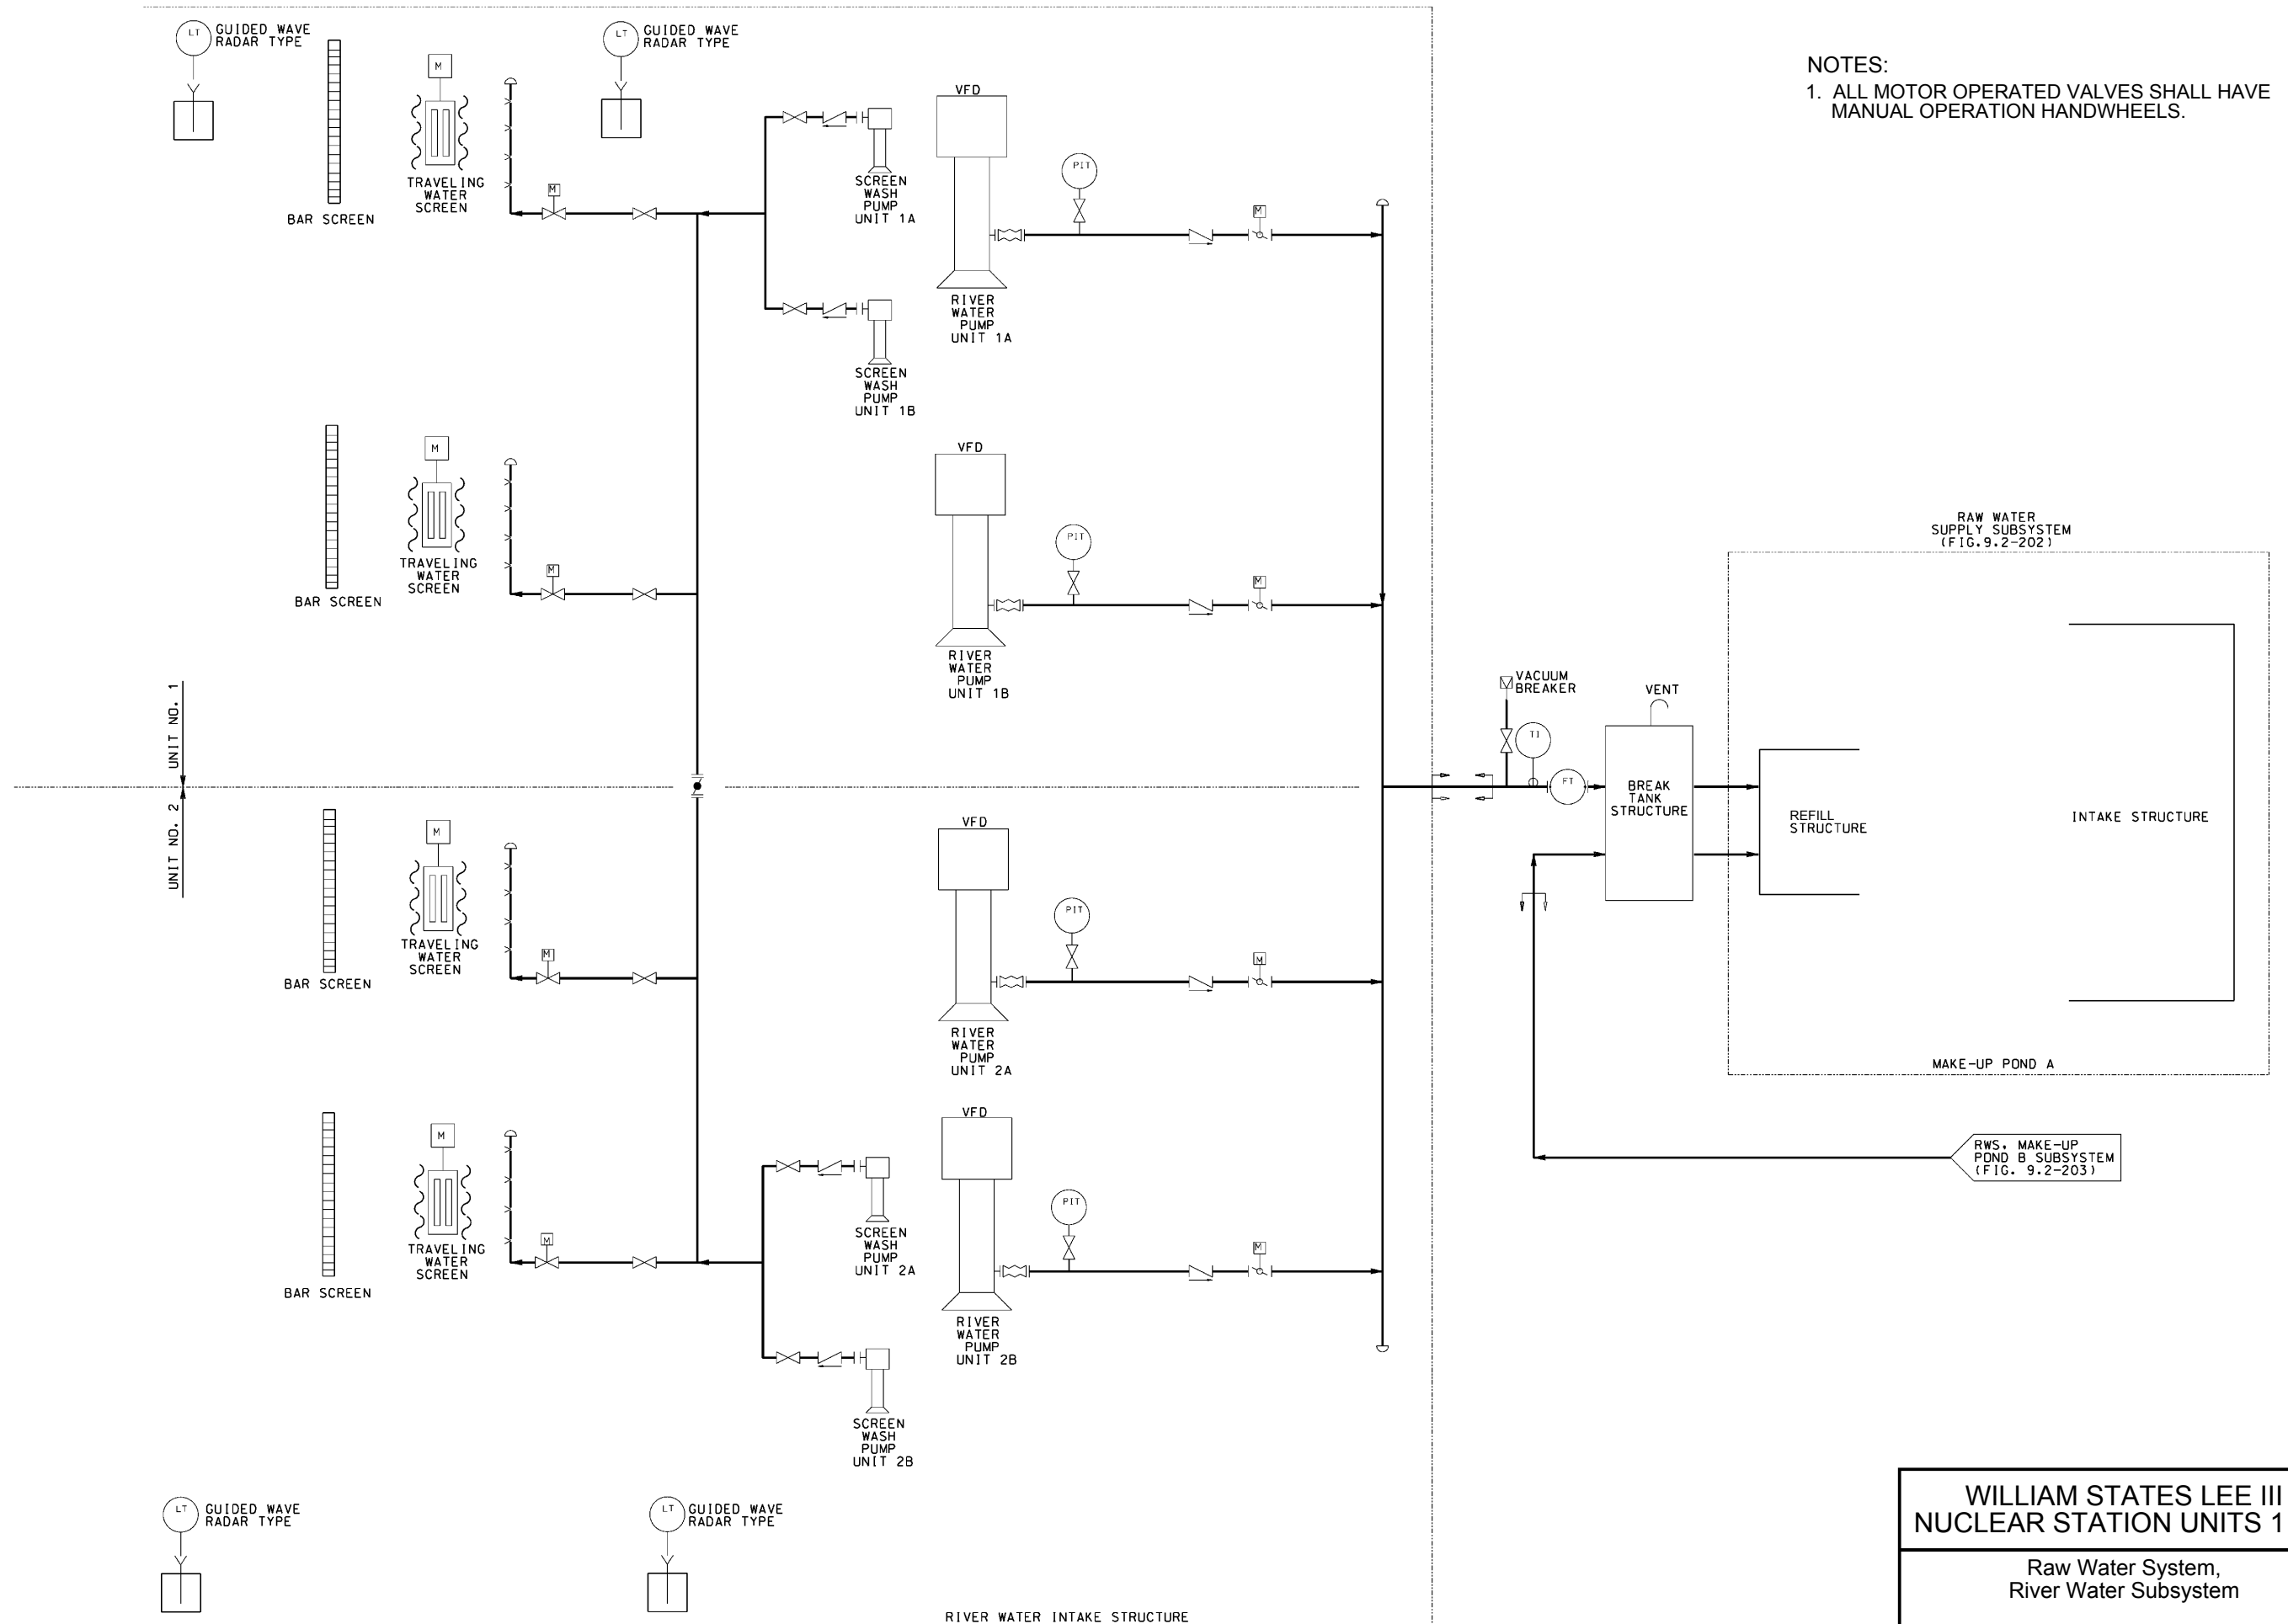

NOTES:  
 1. ALL MOTOR OPERATED VALVES SHALL HAVE MANUAL OPERATION HANDWHEELS.

WILLIAM STATES LEE III  
 NUCLEAR STATION UNITS 1 & 2

Raw Water System,  
 River Water Subsystem

FIGURE 9.2-201 Rev 5