


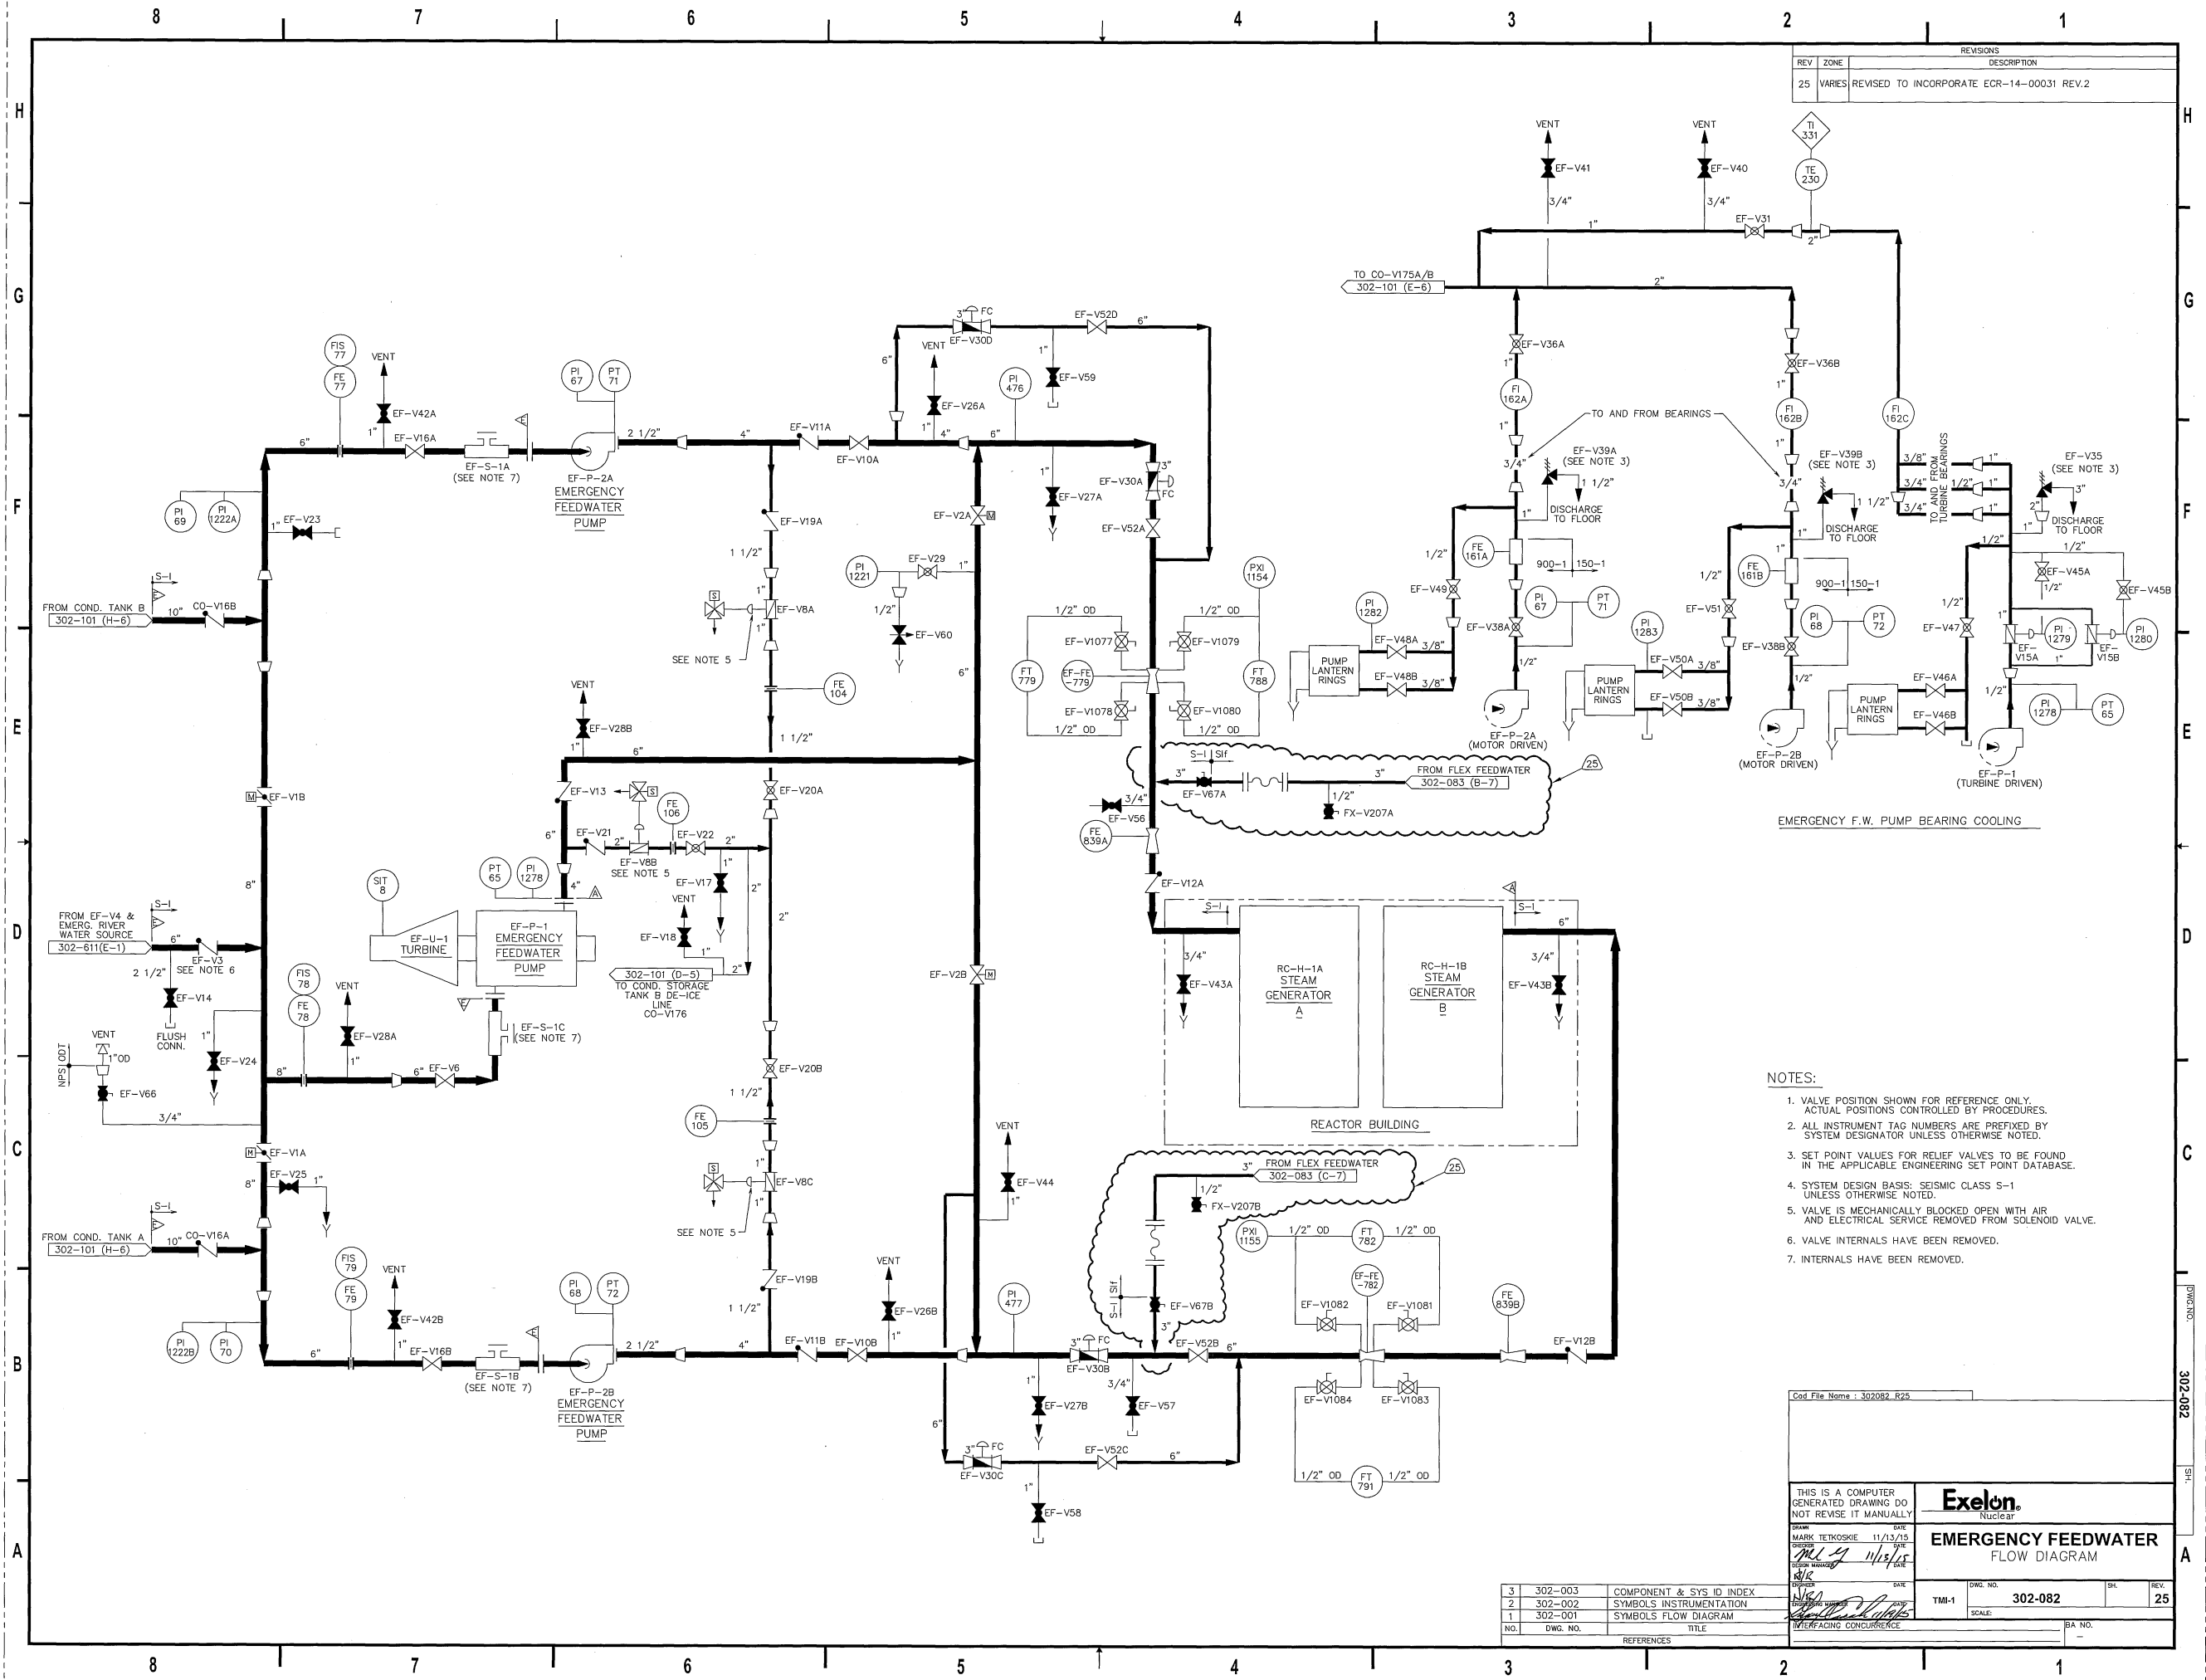

REV		ZONE	DESCRIPTION
25	VARIES	REVISED TO INCORPORATE ECR-14-00031	REV.2

- NOTES:
1. VALVE POSITION SHOWN FOR REFERENCE ONLY. ACTUAL POSITIONS CONTROLLED BY PROCEDURES.
 2. ALL INSTRUMENT TAG NUMBERS ARE PREFIXED BY SYSTEM DESIGNATOR UNLESS OTHERWISE NOTED.
 3. SET POINT VALUES FOR RELIEF VALVES TO BE FOUND IN THE APPLICABLE ENGINEERING SET POINT DATABASE.
 4. SYSTEM DESIGN BASIS: SEISMIC CLASS S-1 UNLESS OTHERWISE NOTED.
 5. VALVE IS MECHANICALLY BLOCKED OPEN WITH AIR AND ELECTRICAL SERVICE REMOVED FROM SOLENOID VALVE.
 6. VALVE INTERNALS HAVE BEEN REMOVED.
 7. INTERNALS HAVE BEEN REMOVED.

3	302-003	COMPONENT & SYS. ID INDEX
2	302-002	SYMBOLS INSTRUMENTATION
1	302-001	SYMBOLS FLOW DIAGRAM
NO.	DWG. NO.	TITLE

Cod File Name : 302082_R25

THIS IS A COMPUTER GENERATED DRAWING DO NOT REVISE IT MANUALLY

DATE

11/13/15

DATE

11/18/15

DATE

11/18/15

Exelon Nuclear

EMERGENCY FEEDWATER FLOW DIAGRAM

TM-1

DWG. NO. 302-082

SH. 25

SCALE:

BA NO.