


REV	ZONE	DESCRIPTION
49	E-3	REVISED TO INCORPORATE ECR-07-00174 REV. 1

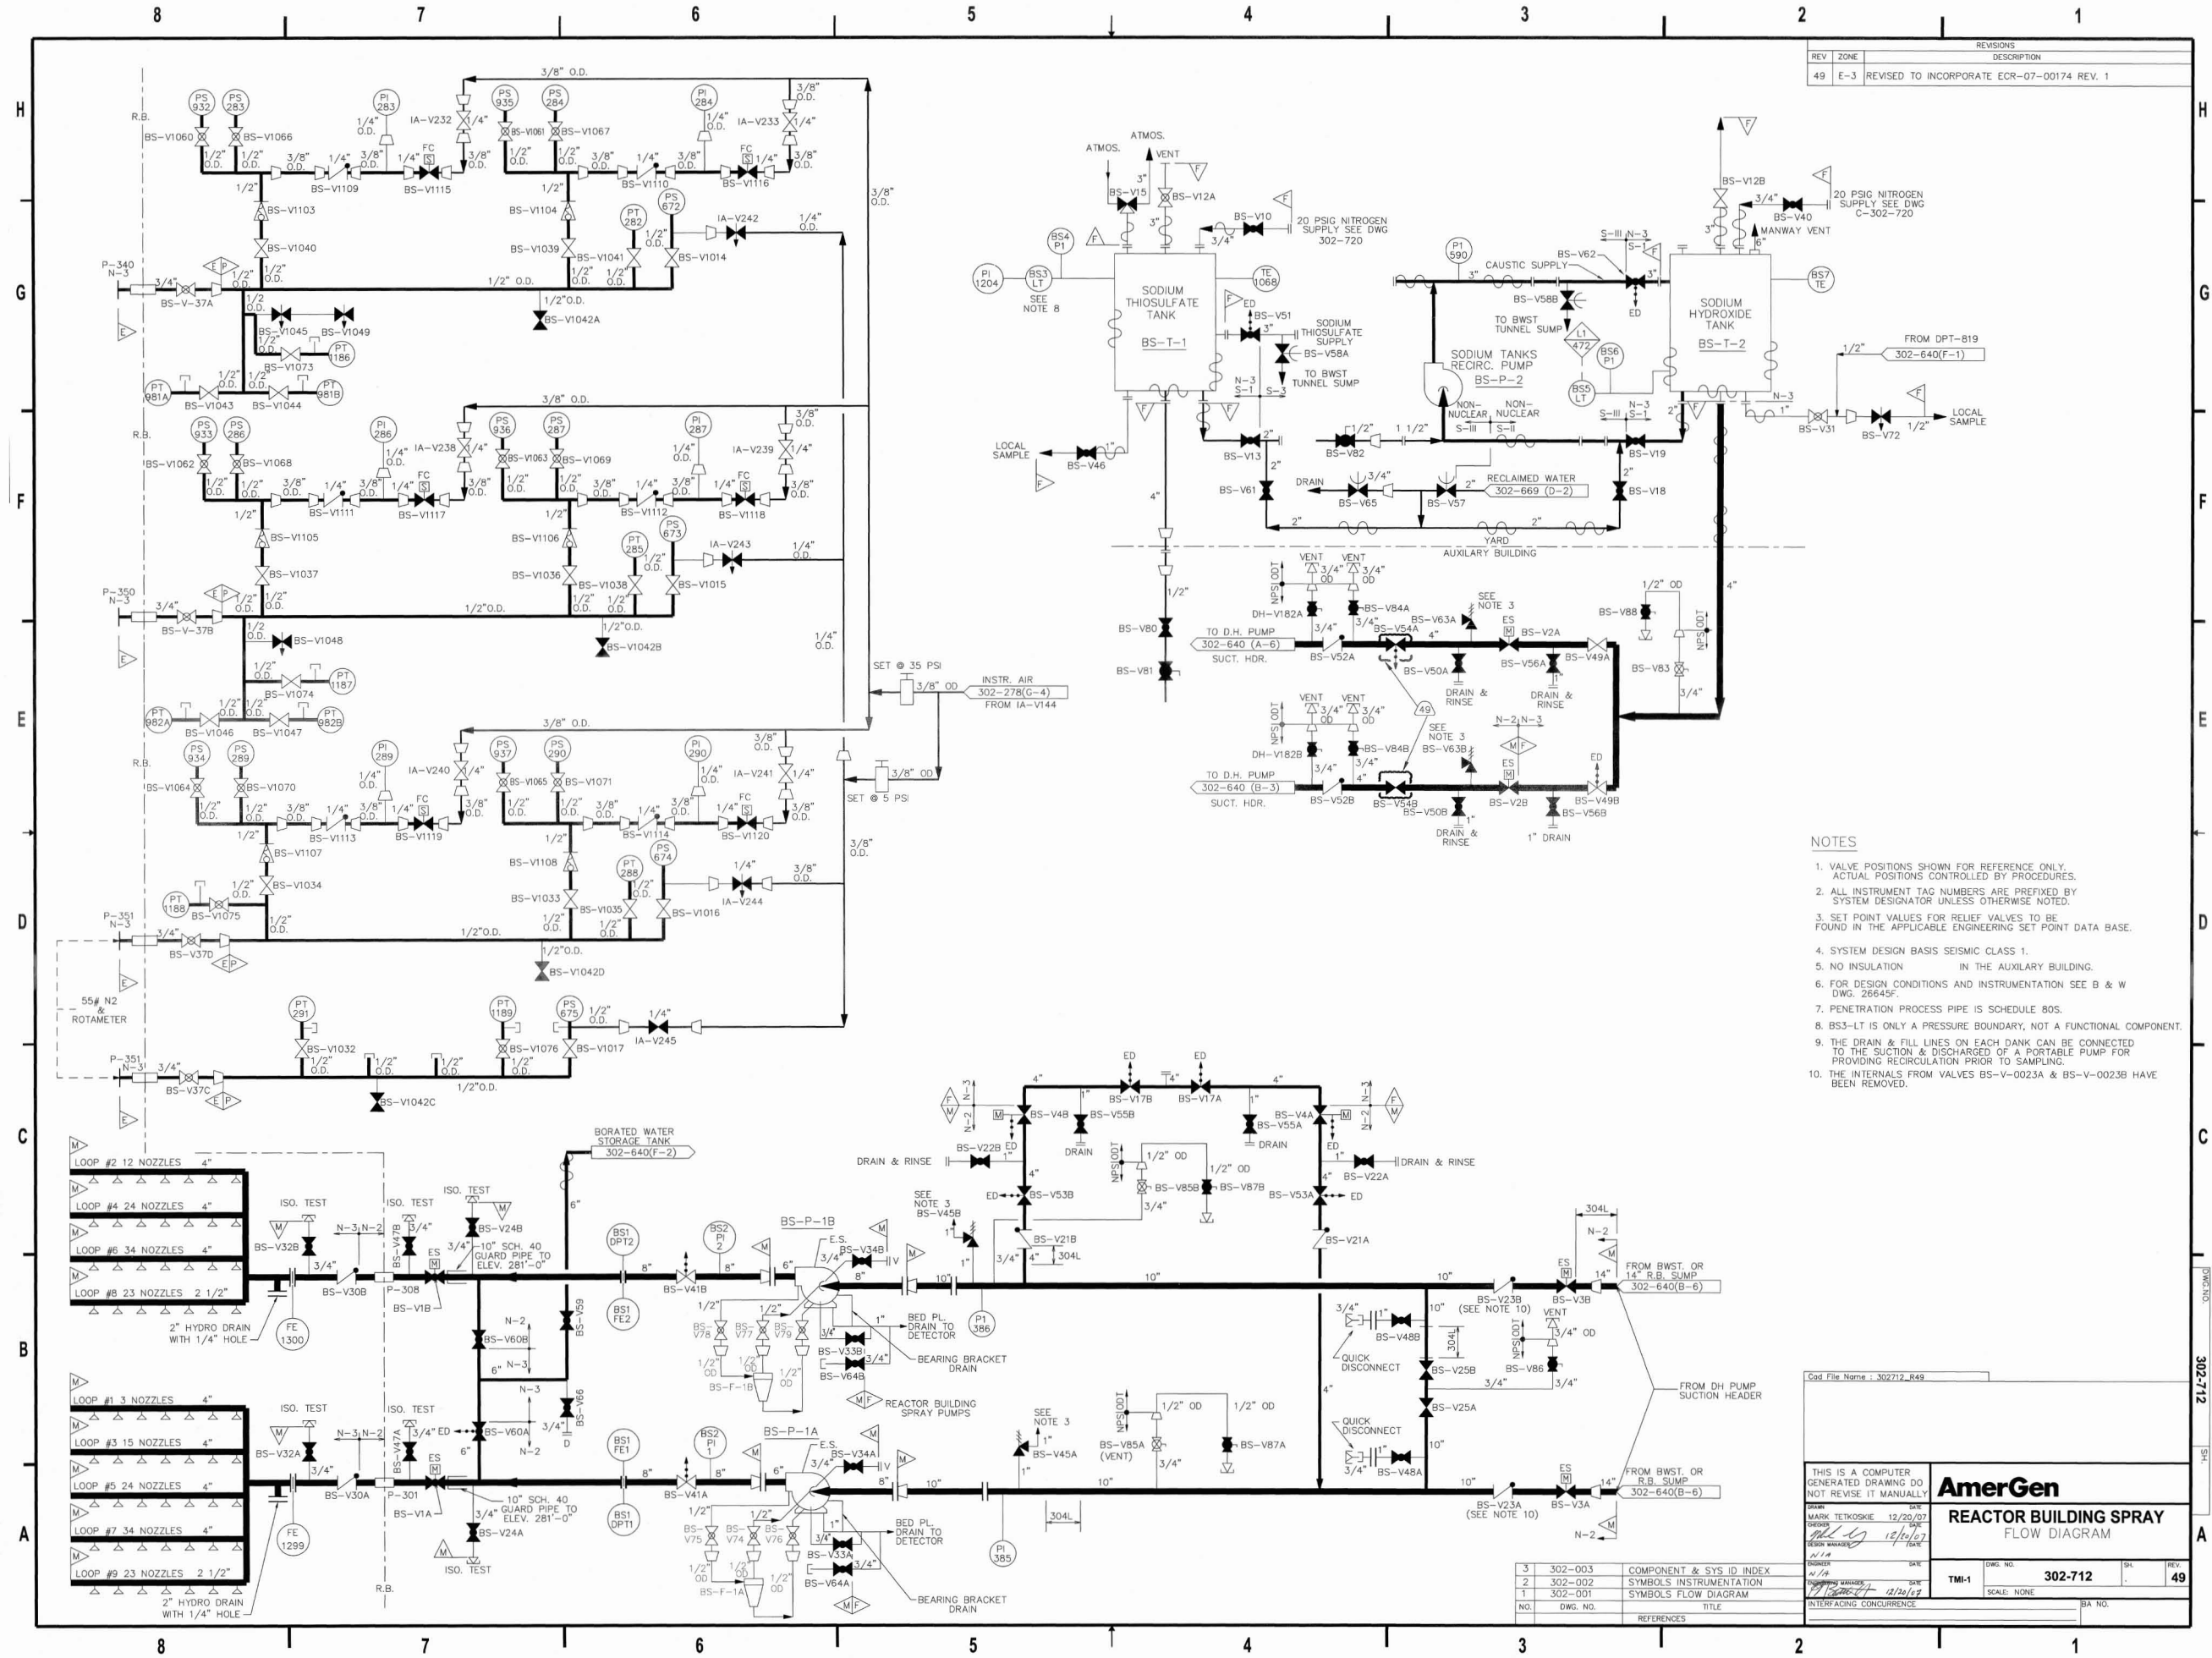

- NOTES**
1. VALVE POSITIONS SHOWN FOR REFERENCE ONLY. ACTUAL POSITIONS CONTROLLED BY PROCEDURES.
 2. ALL INSTRUMENT TAG NUMBERS ARE PREFIXED BY SYSTEM DESIGNATOR UNLESS OTHERWISE NOTED.
 3. SET POINT VALUES FOR RELIEF VALVES TO BE FOUND IN THE APPLICABLE ENGINEERING SET POINT DATA BASE.
 4. SYSTEM DESIGN BASIS SEISMIC CLASS 1.
 5. NO INSULATION IN THE AUXILIARY BUILDING.
 6. FOR DESIGN CONDITIONS AND INSTRUMENTATION SEE B & W DWG. 26645F.
 7. PENETRATION PROCESS PIPE IS SCHEDULE 80S.
 8. BS3-LT IS ONLY A PRESSURE BOUNDARY, NOT A FUNCTIONAL COMPONENT.
 9. THE DRAIN & FILL LINES ON EACH DANK CAN BE CONNECTED TO THE SUCTION & DISCHARGE OF A PORTABLE PUMP FOR PROVIDING RECIRCULATION PRIOR TO SAMPLING.
 10. THE INTERNALS FROM VALVES BS-V-0023A & BS-V-0023B HAVE BEEN REMOVED.

Cad File Name : 302712_R49

THIS IS A COMPUTER GENERATED DRAWING DO NOT REVISE IT MANUALLY

AmerGen

REACTOR BUILDING SPRAY FLOW DIAGRAM

DRW. MARK TETKOSKIE	DATE 12/20/07
DESIGNER	DATE 12/10/07
INTERFACING CONCURRENCE	DATE 12/10/07

DWG. NO. 302-712	REV. 49
SCALE: NONE	BA NO.

NO.	DWG. NO.	TITLE	REFERENCES
3	302-003	COMPONENT & SYS ID INDEX	
2	302-002	SYMBOLS INSTRUMENTATION	
1	302-001	SYMBOLS FLOW DIAGRAM	