

Central files 50-269
50-270
50-287

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

May 21, 1979

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

USNRC REGION I
ATLANTA, GEORGIA
TELEPHONE AREA 703
373-4083
79 MAY 23 9:10

Mr. James P. O'Reilly, Director
U. S. Nuclear Regulatory Commission
Region II
101 Marietta Street, Suite 3100
Atlanta, Georgia 30303

RE: RII:JPO
50-269
50-270
50-287

Dear Mr. O'Reilly:


Pursuant to your letter of April 21, 1979 which transmitted IE Bulletin 79-05B, the following is Duke Power Company's responses to Item 5 and 7 for Oconee Nuclear Station.

With regard to Item 5, in a letter dated May 21, 1979, copy attached, Duke Power provided for NRC/ONRR approval a design review and schedule for implementation of a safety grade automatic anticipatory reactor scram for loss of feedwater and turbine trip. Based on an examination of feedwater system related transients, it is not considered that a reactor trip on low steam generator level would be anticipatory and, thus, was not included in the submittal.

With regard to Item 7, in a second letter dated May 21, 1979, copy attached, Duke Power proposed changes to the Oconee Nuclear Station Technical Specifications which should be modified as a result of our implementation of IE Bulletin 79-05B.

My letters of April 21, and May 5, 1979 provided responses to Items 1, 2, 3, 4 and 6.

Very truly yours,

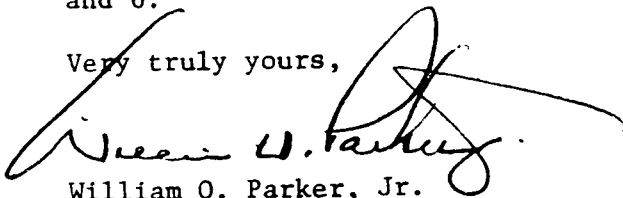

William O. Parker, Jr.

RLG:scs
Attachments

cc: NRC, Office of Inspection and Enforcement
Division of Reactor Operation Inspection
Washington, D. C. 20555

7907110627

790266

OFFICIAL COPY