


LOUISIANA POWER & LIGHT CO.
Waterford Steam Electric Station
VARIATION OF SHEAR MODULUS
WITH TIME (LEVEL 19)
3.7A-1

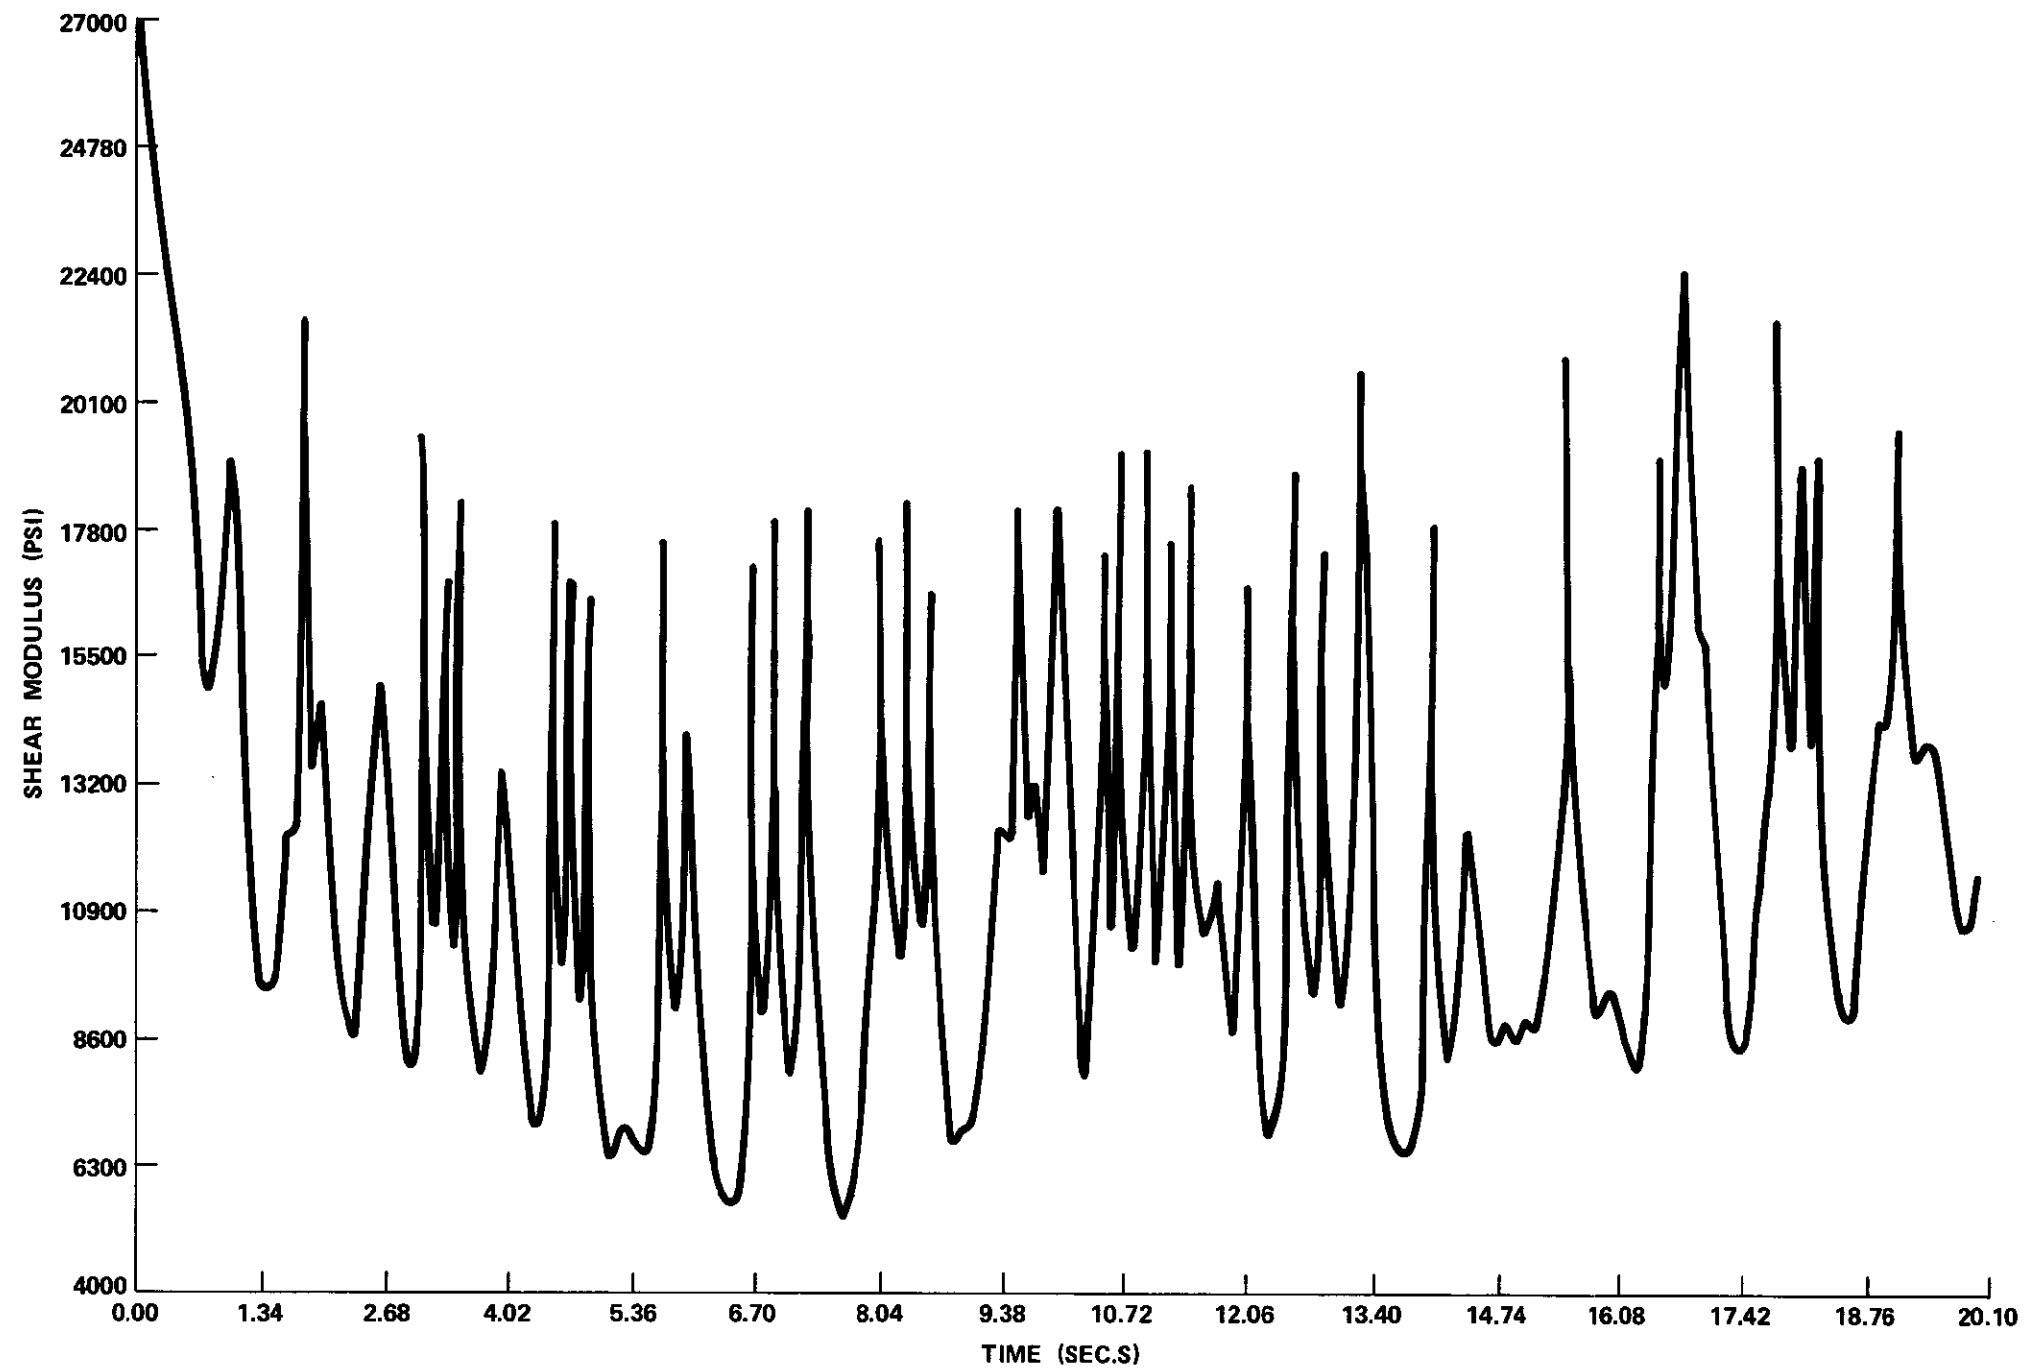


LOUISIANA POWER & LIGHT CO.

Waterford Steam Electric Station

VARIATION OF SHEAR MODULUS
WITH TIME (LEVEL 13)


3.7A-2

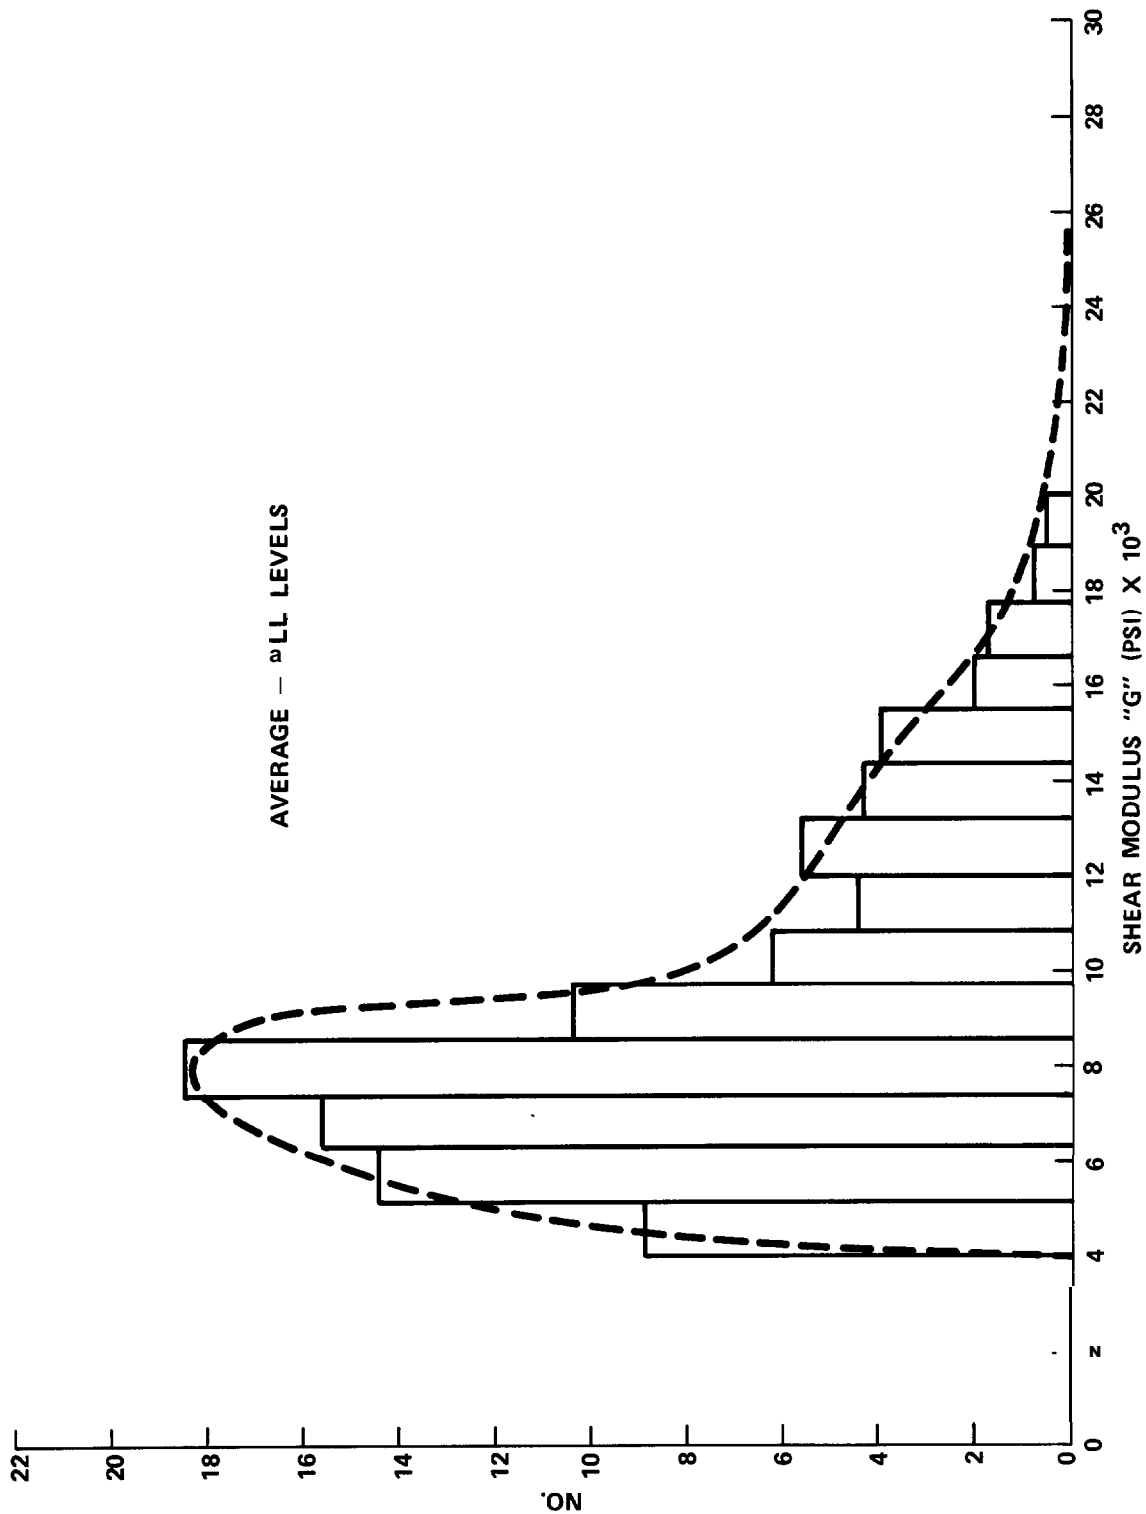

LOUISIANA
POWER & LIGHT CO.
Waterford Steam
Electric Station

SOIL SHEAR MODULUS DISTRIBUTION
DURING SAFE SHUTDOWN EARTHQUAKE

Figure
3.7A-3

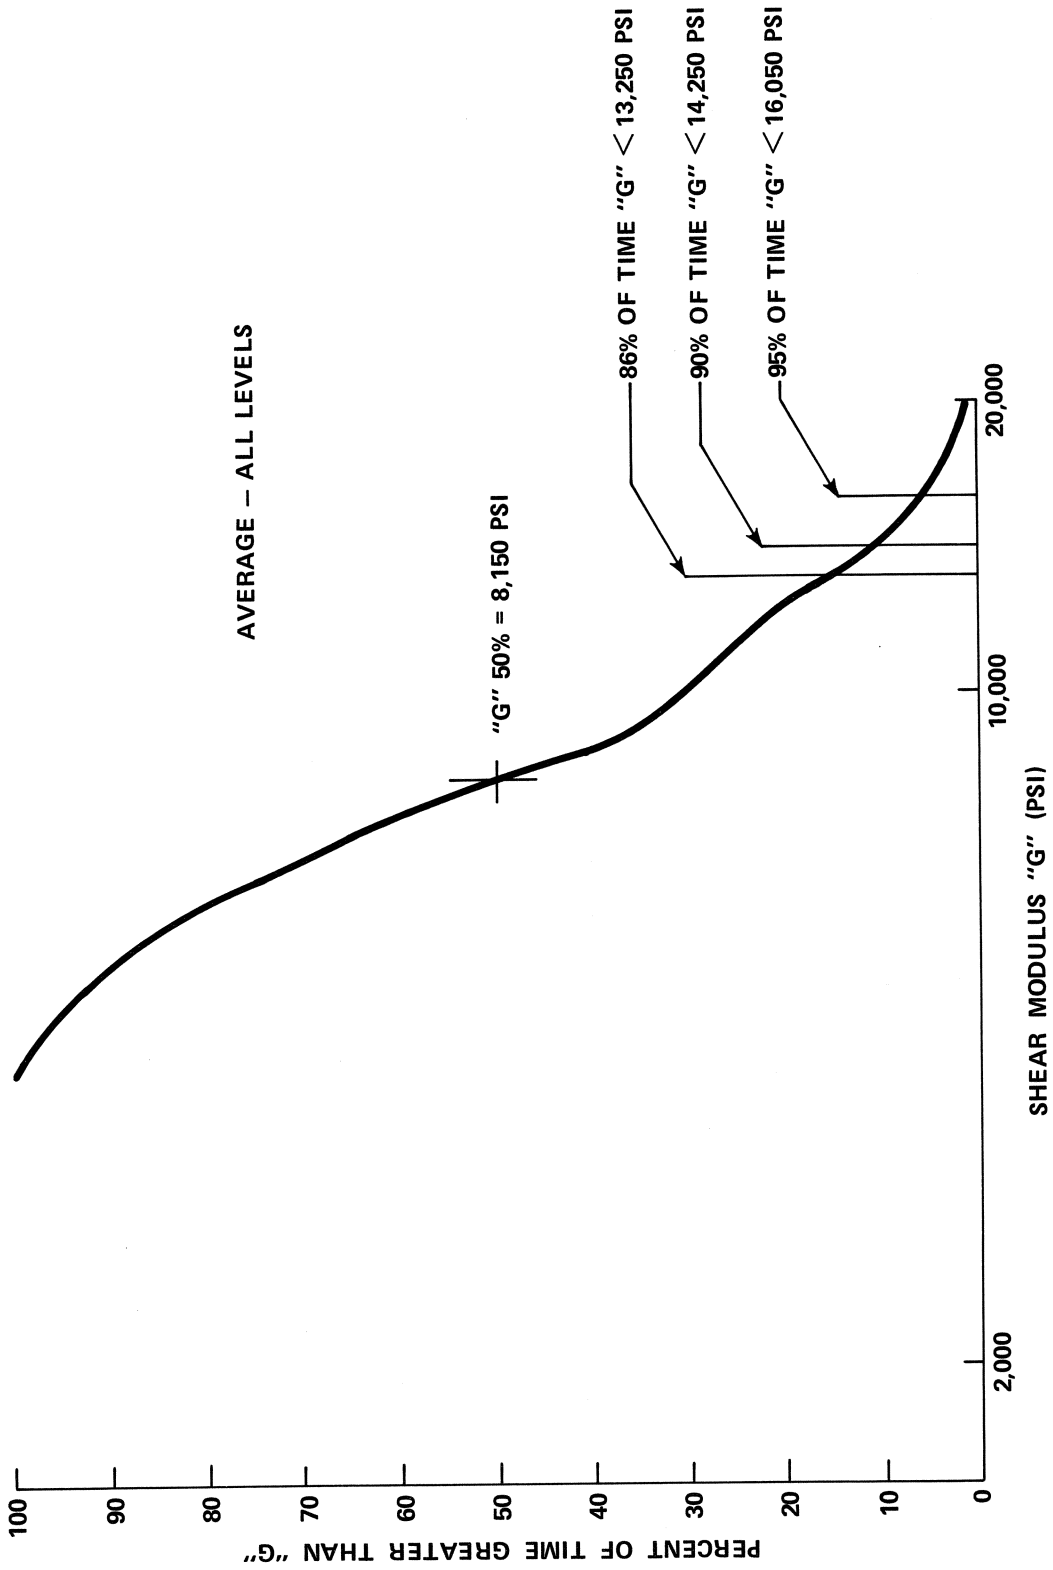

LOUISIANA
POWER & LIGHT CO.
Waterford Steam
Electric Station

SOIL SHEAR MODULUS DURING
SAFE SHUTDOWN EARTHQUAKE

Figure
3.7A-4