




LOUISIANA
POWER & LIGHT CO.
Waterford Steam
Electric Station


CVCS MALFUNCTION CORE POWER VS TIME


Figure
15.5-1

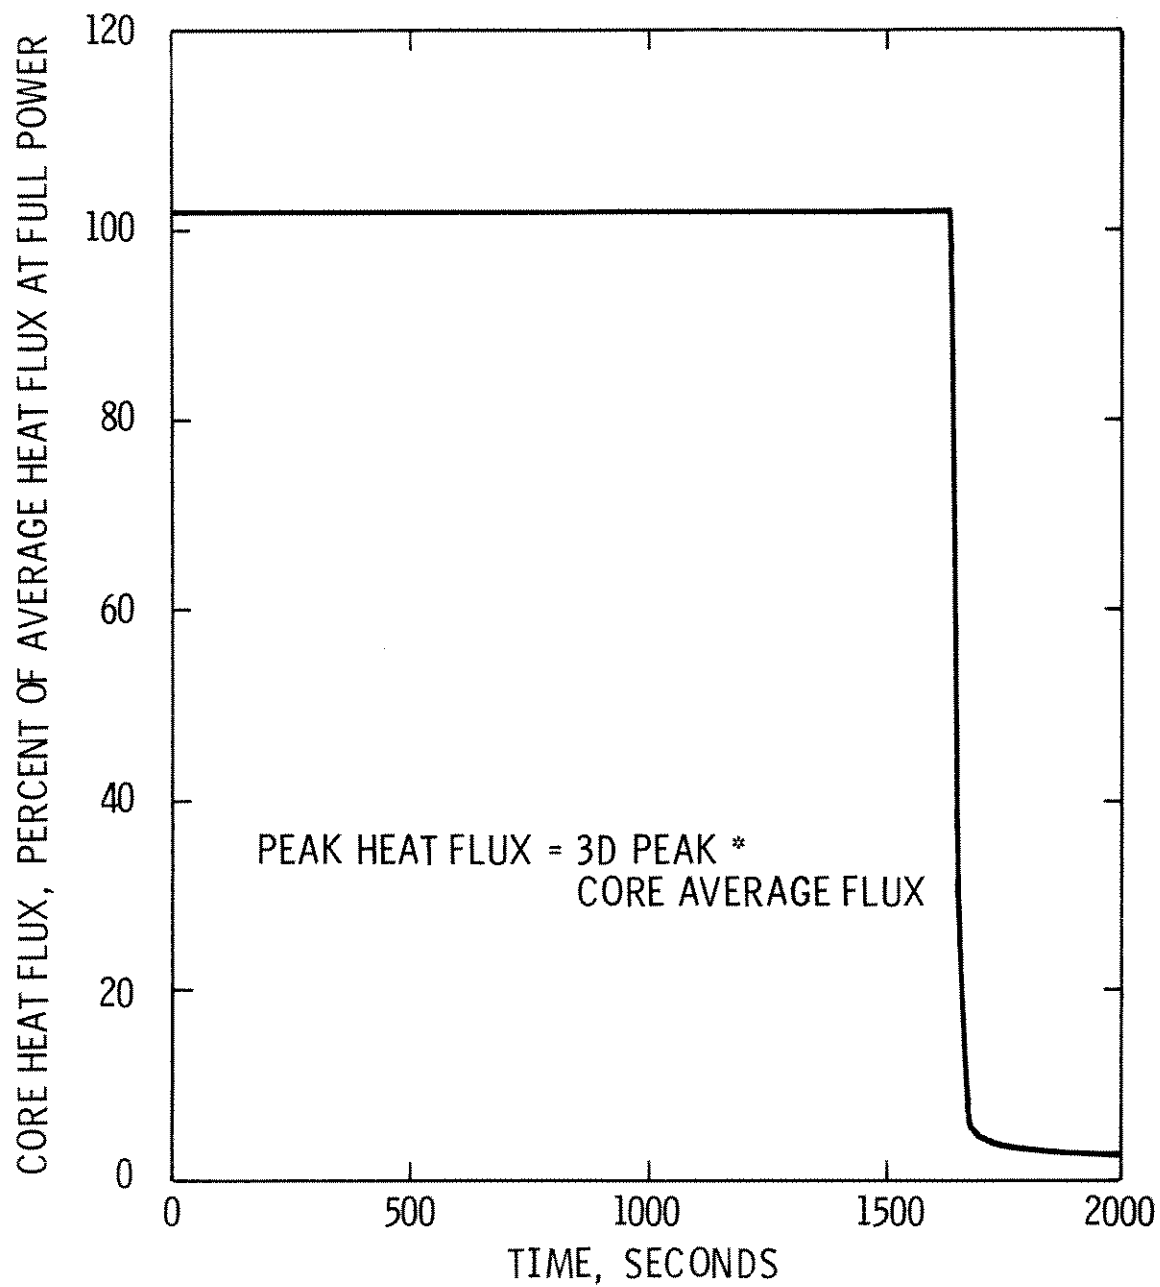

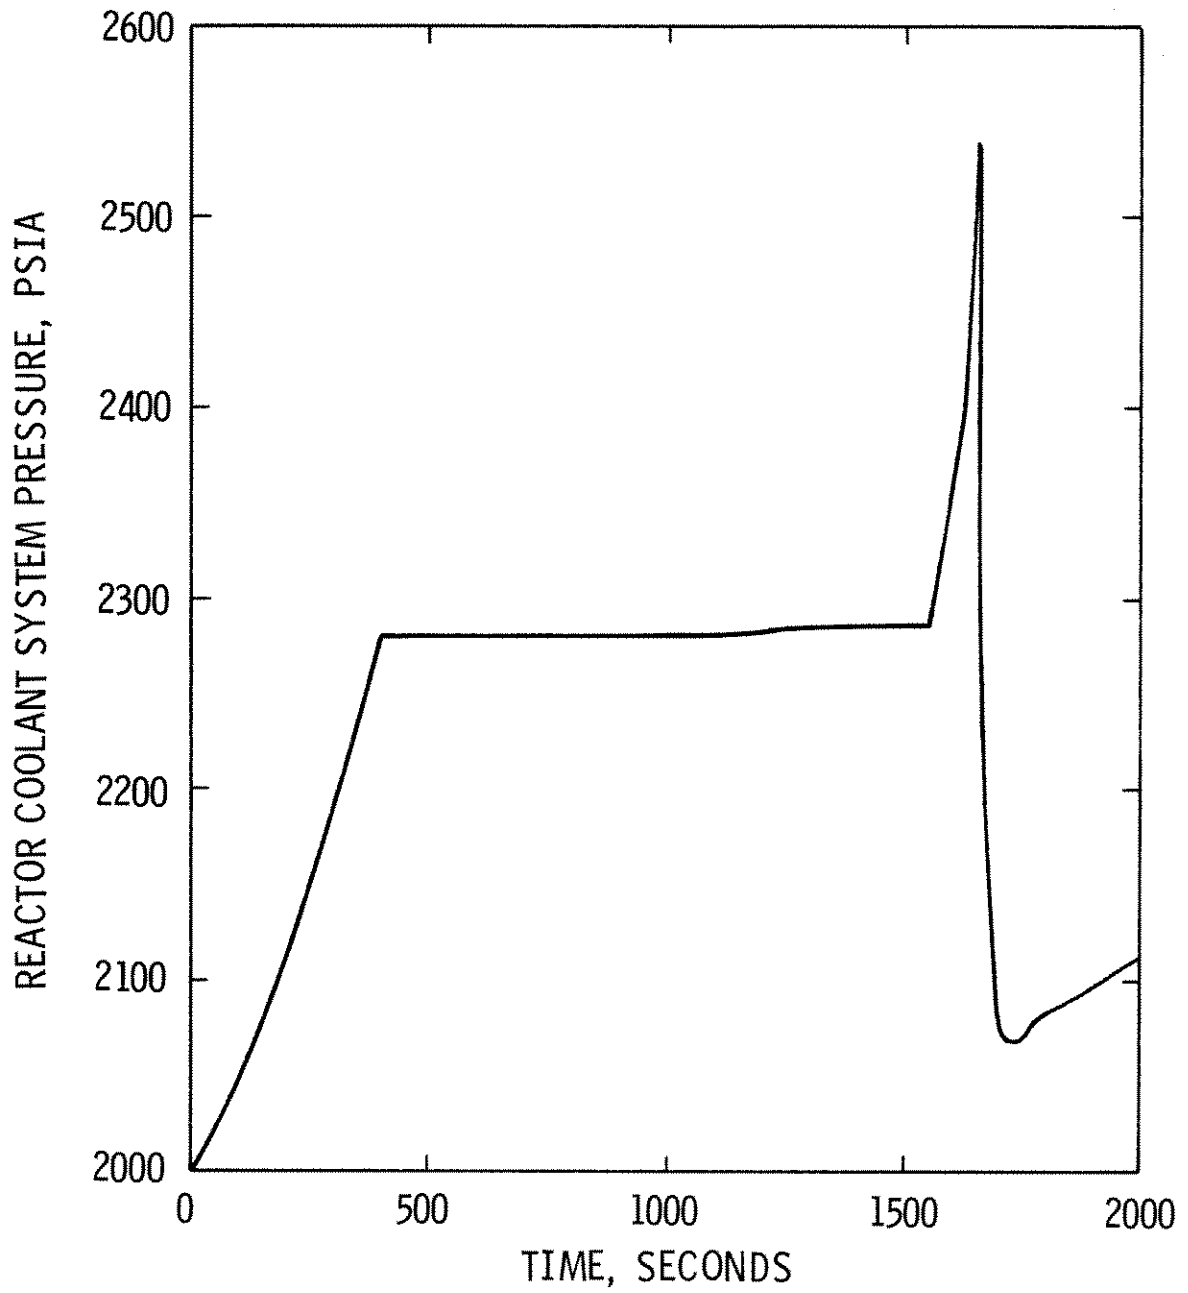

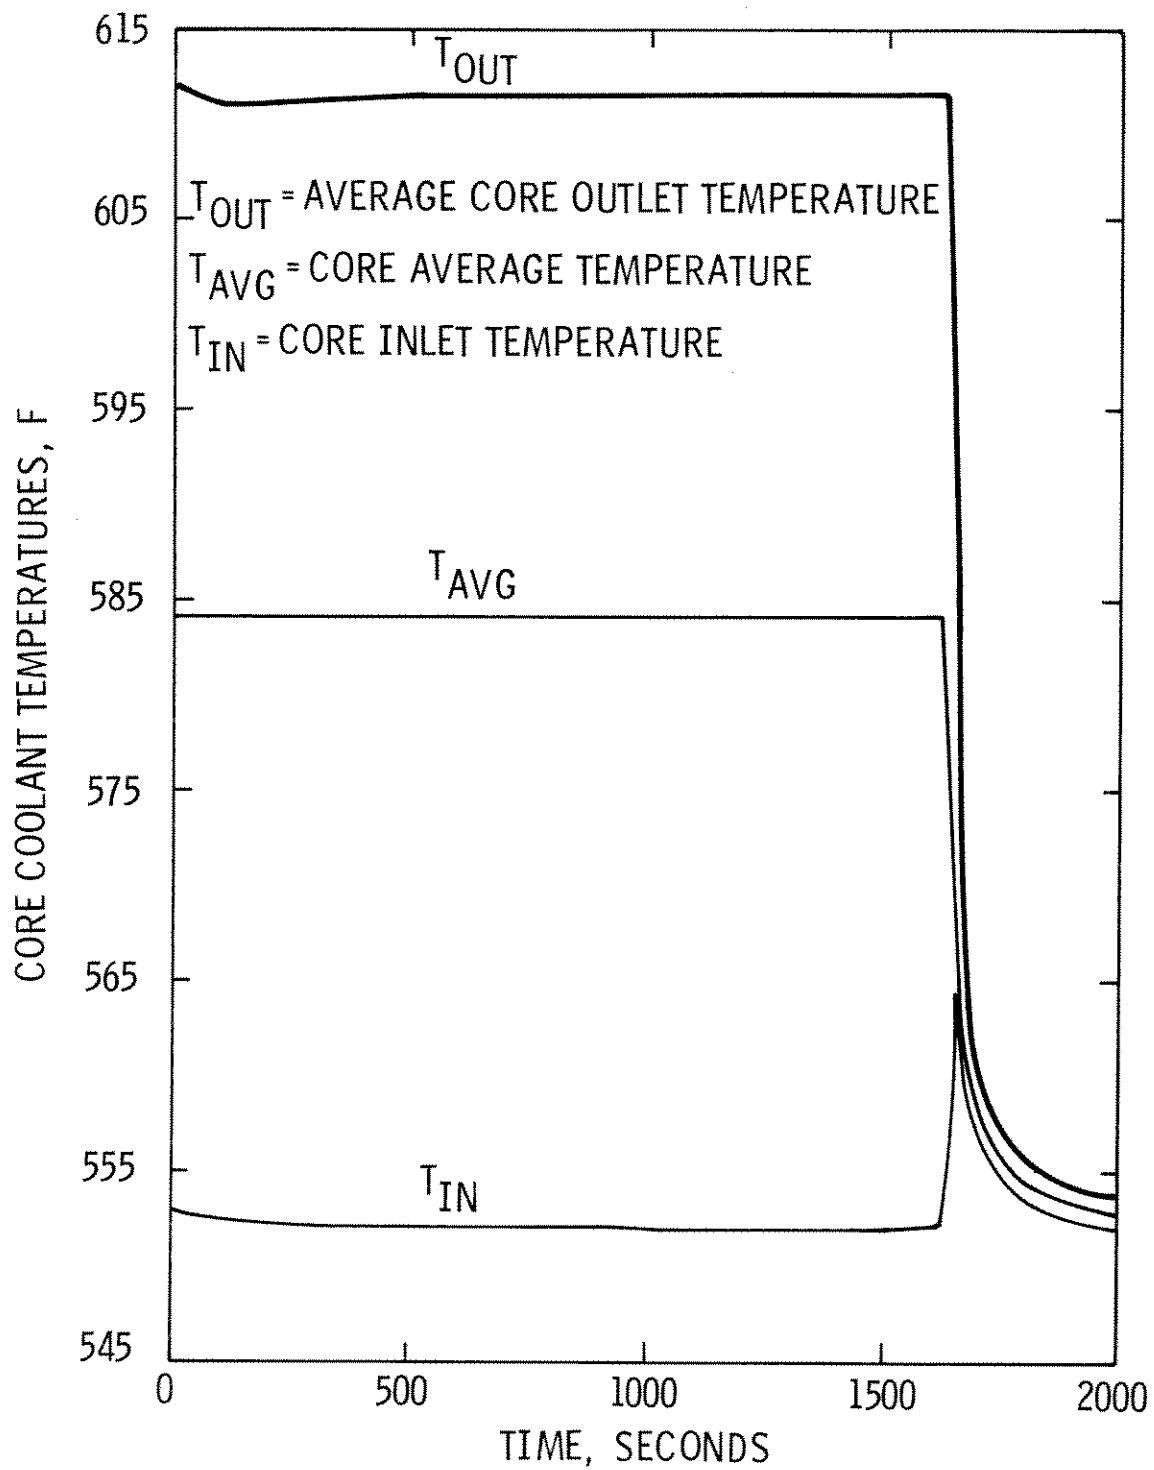

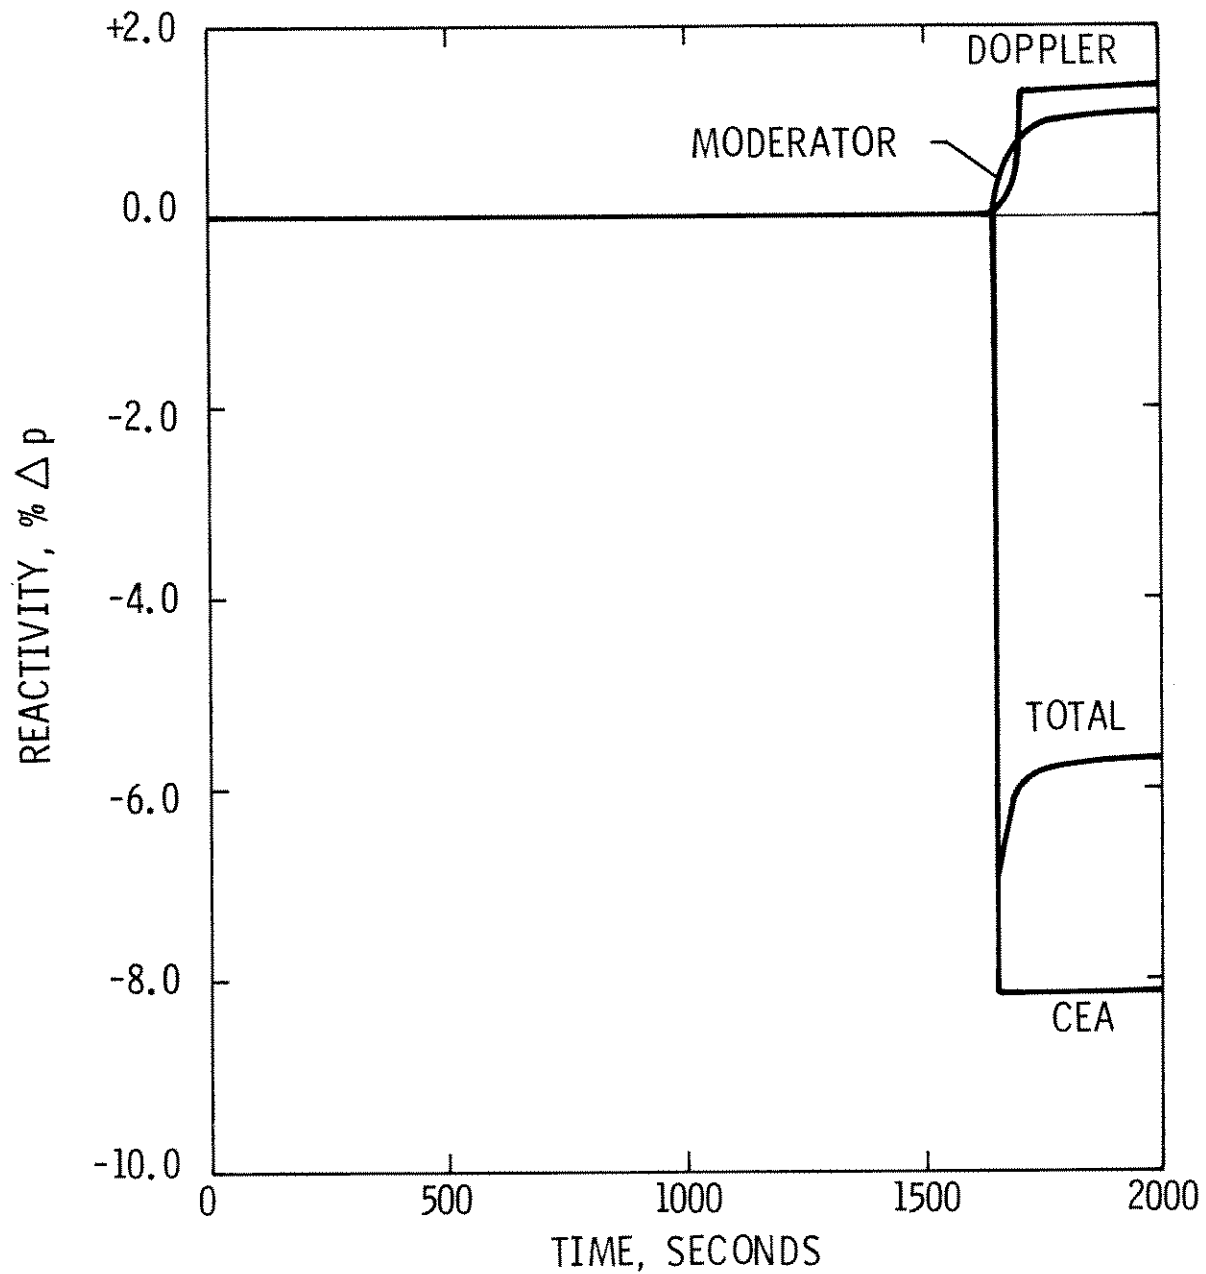


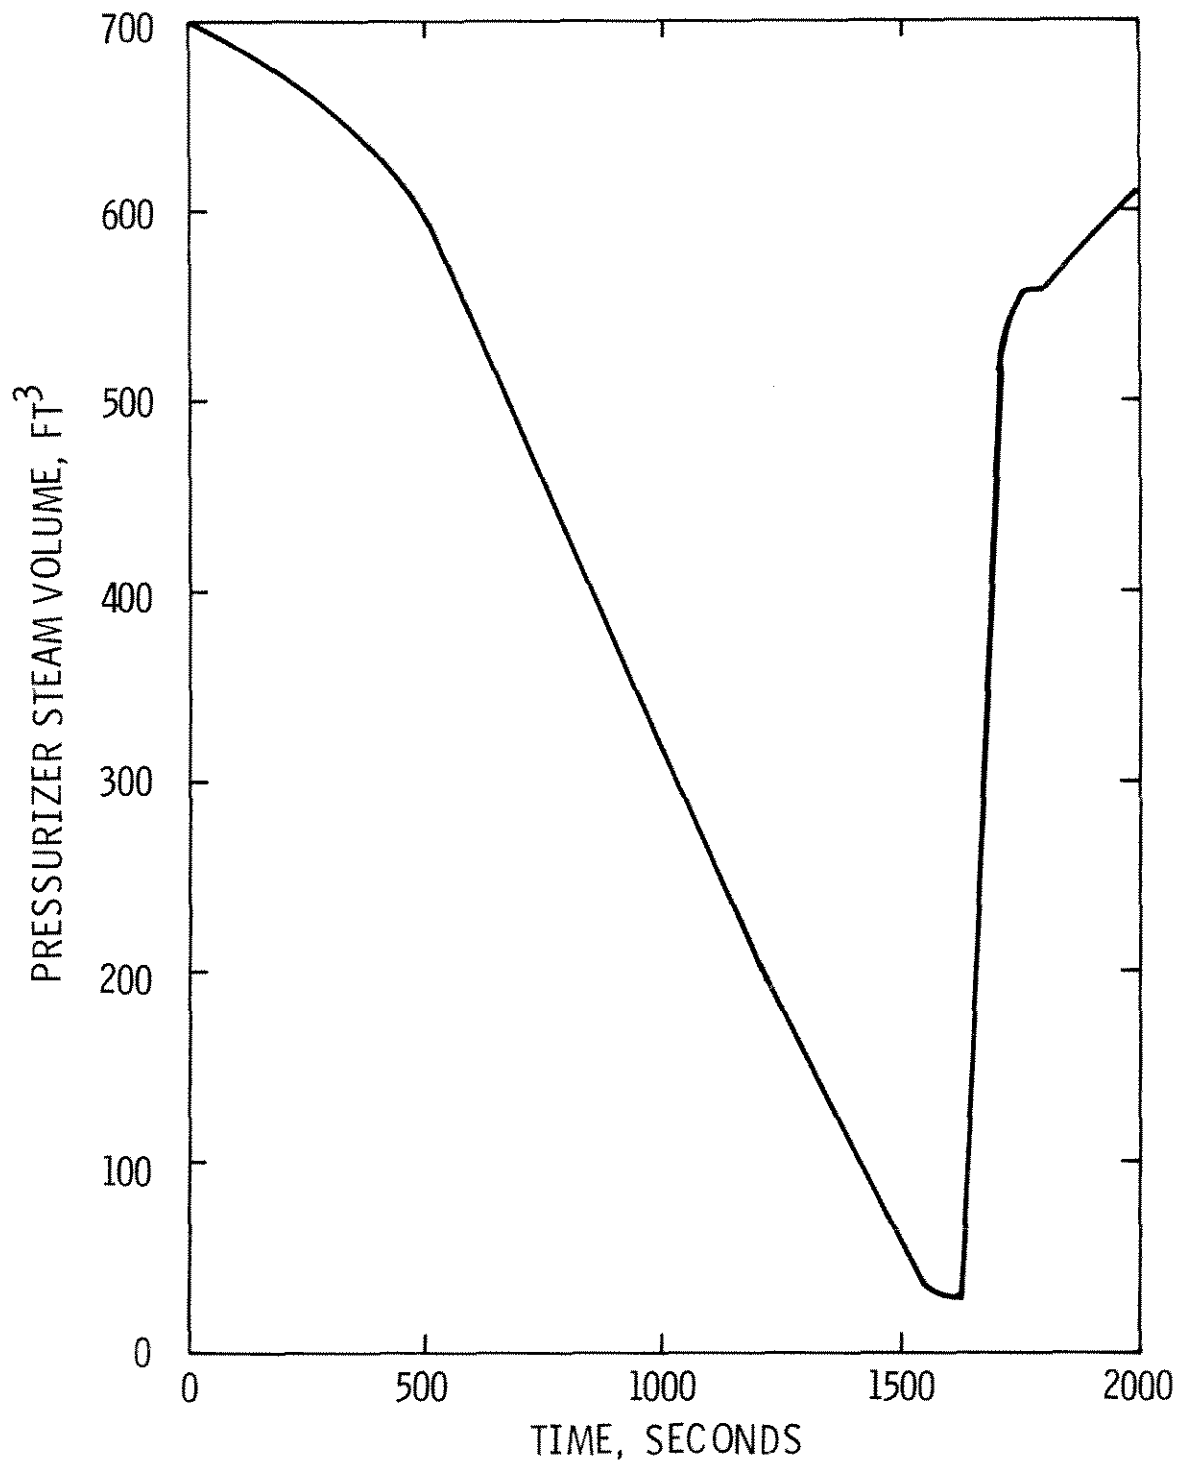

LOUISIANA
POWER & LIGHT CO.
Waterford Steam
Electric Station

CVCS MALFUNCTION PRESSURIZER STEAM
VOLUME VS TIME

Figure
15.5-6

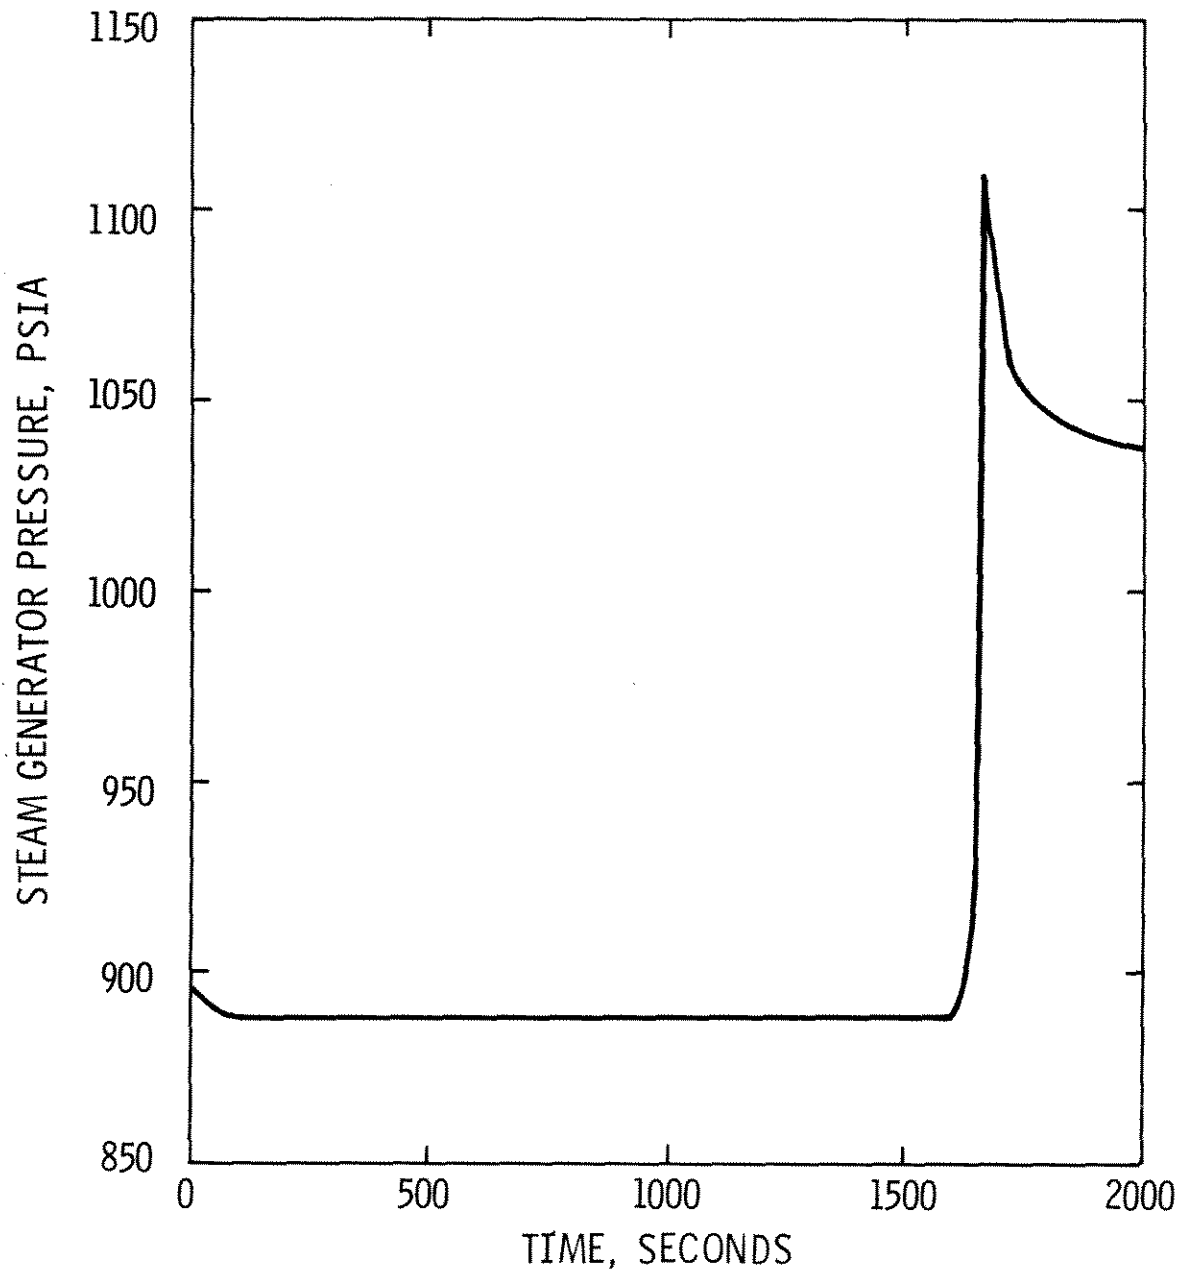

LOUISIANA
POWER & LIGHT CO.
Waterford Steam
Electric Station

CVCS MALFUNCTION STEAM GENERATOR
PRESSURE VS TIME

Figure
15.5-7