


Revision 307 (07/13)

Waterford Steam
Electric Station #3

Asymmetric Steam Generator Transient
Core Power vs. Time

Figure
15.9-1

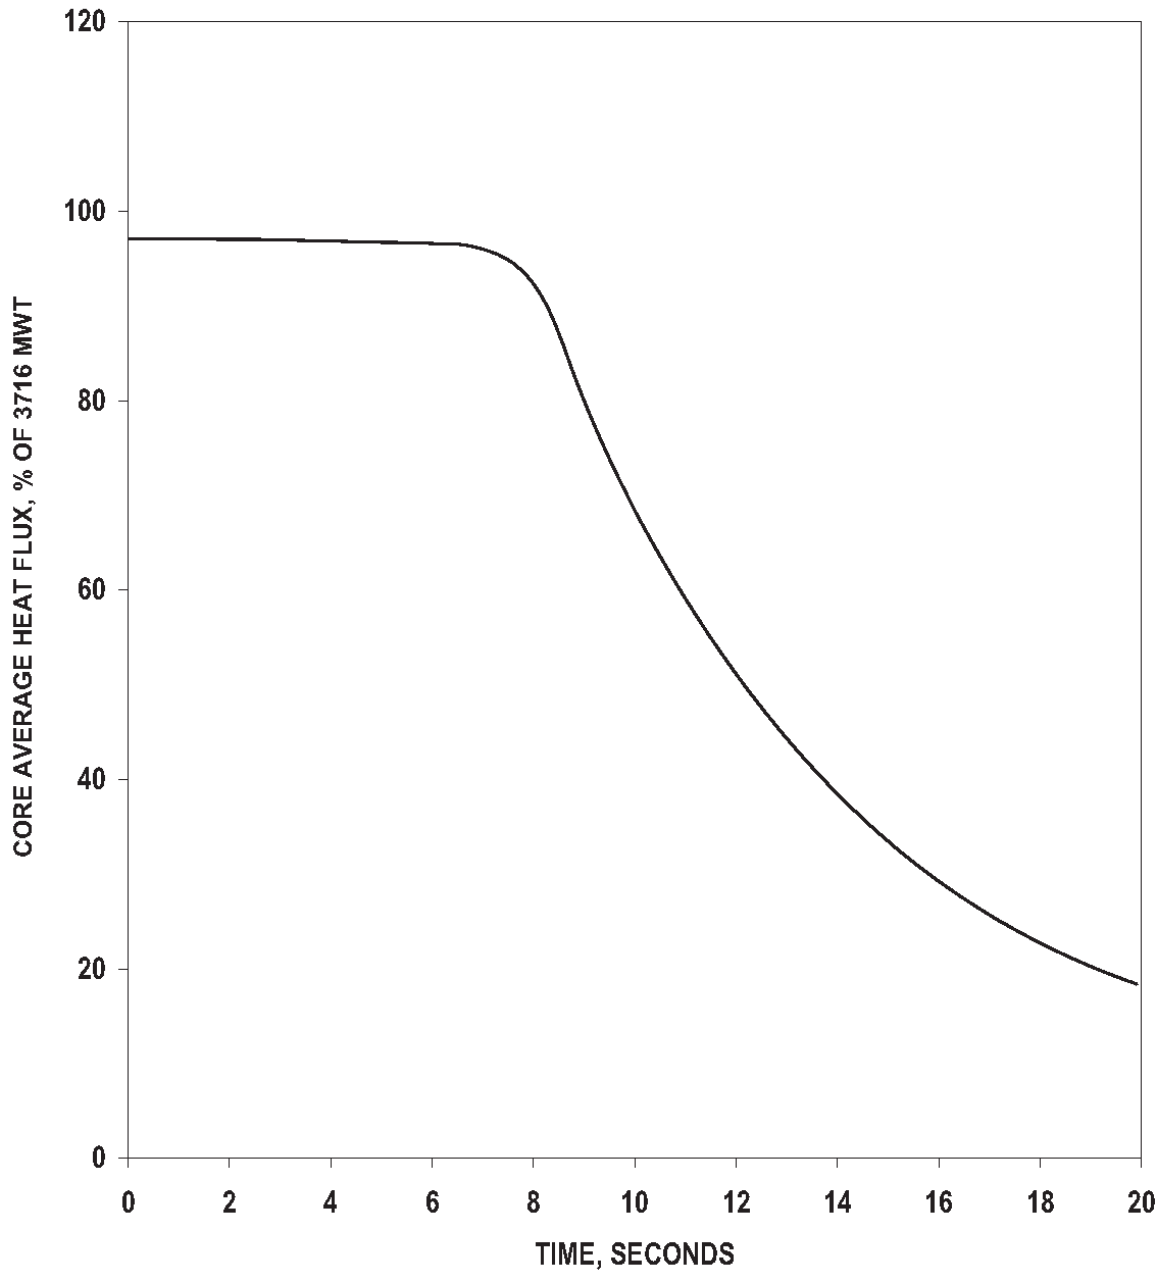


Revision 307 (07/13)


Waterford Steam
Electric Station #3

Asymmetric Steam Generator Transient
Core Average Heat Flux vs. Time

Figure
15.9-2

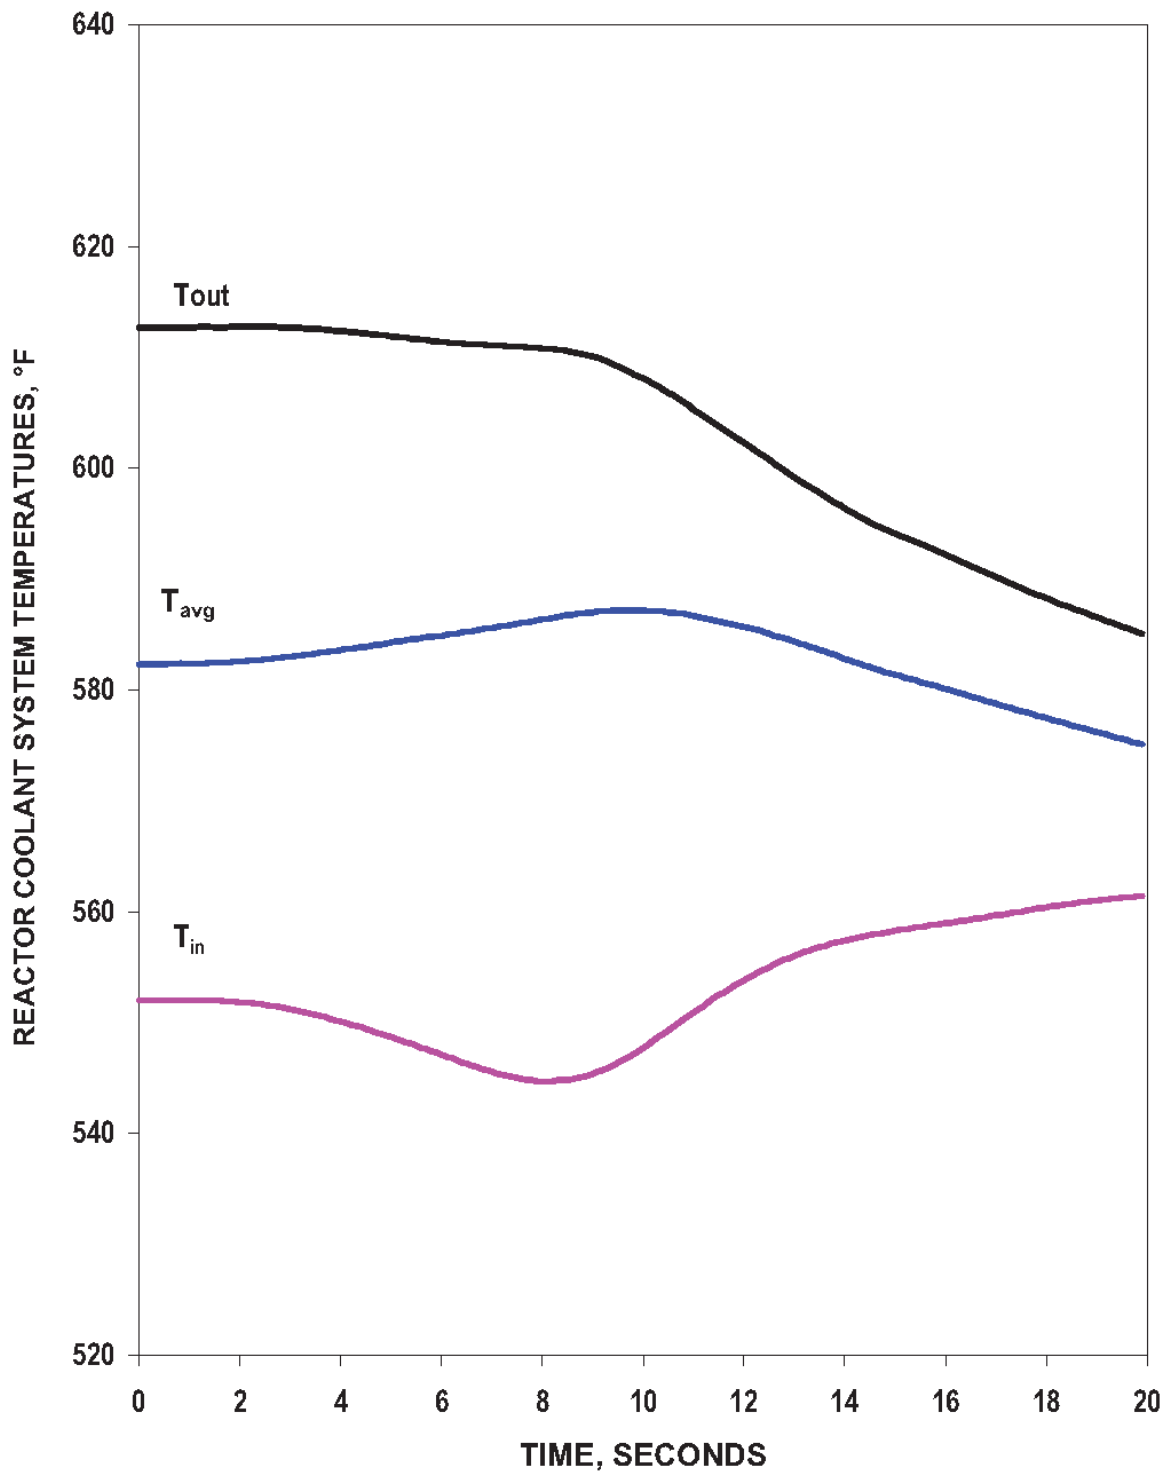

Revision 307 (07/13)

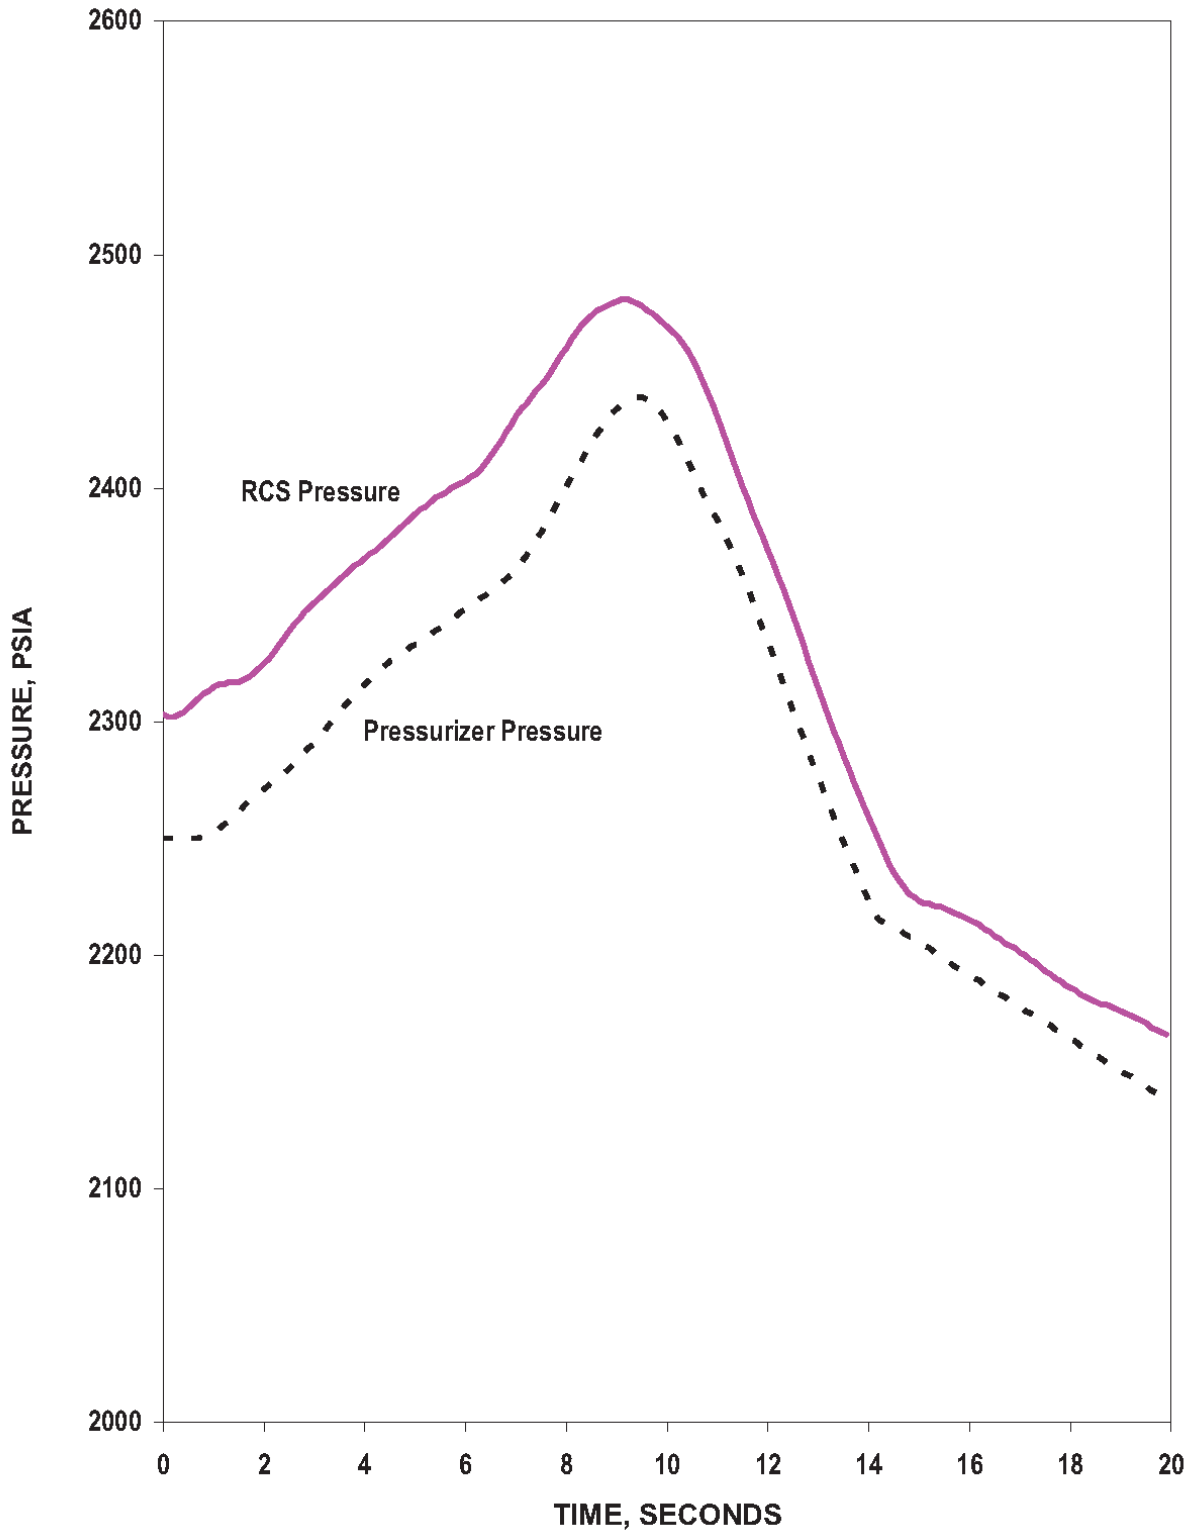


Revision 307 (07/13)

Waterford Steam
Electric Station #3

Asymmetric Steam Generator Transient
System Pressure vs. Time

Figure
15.9-4

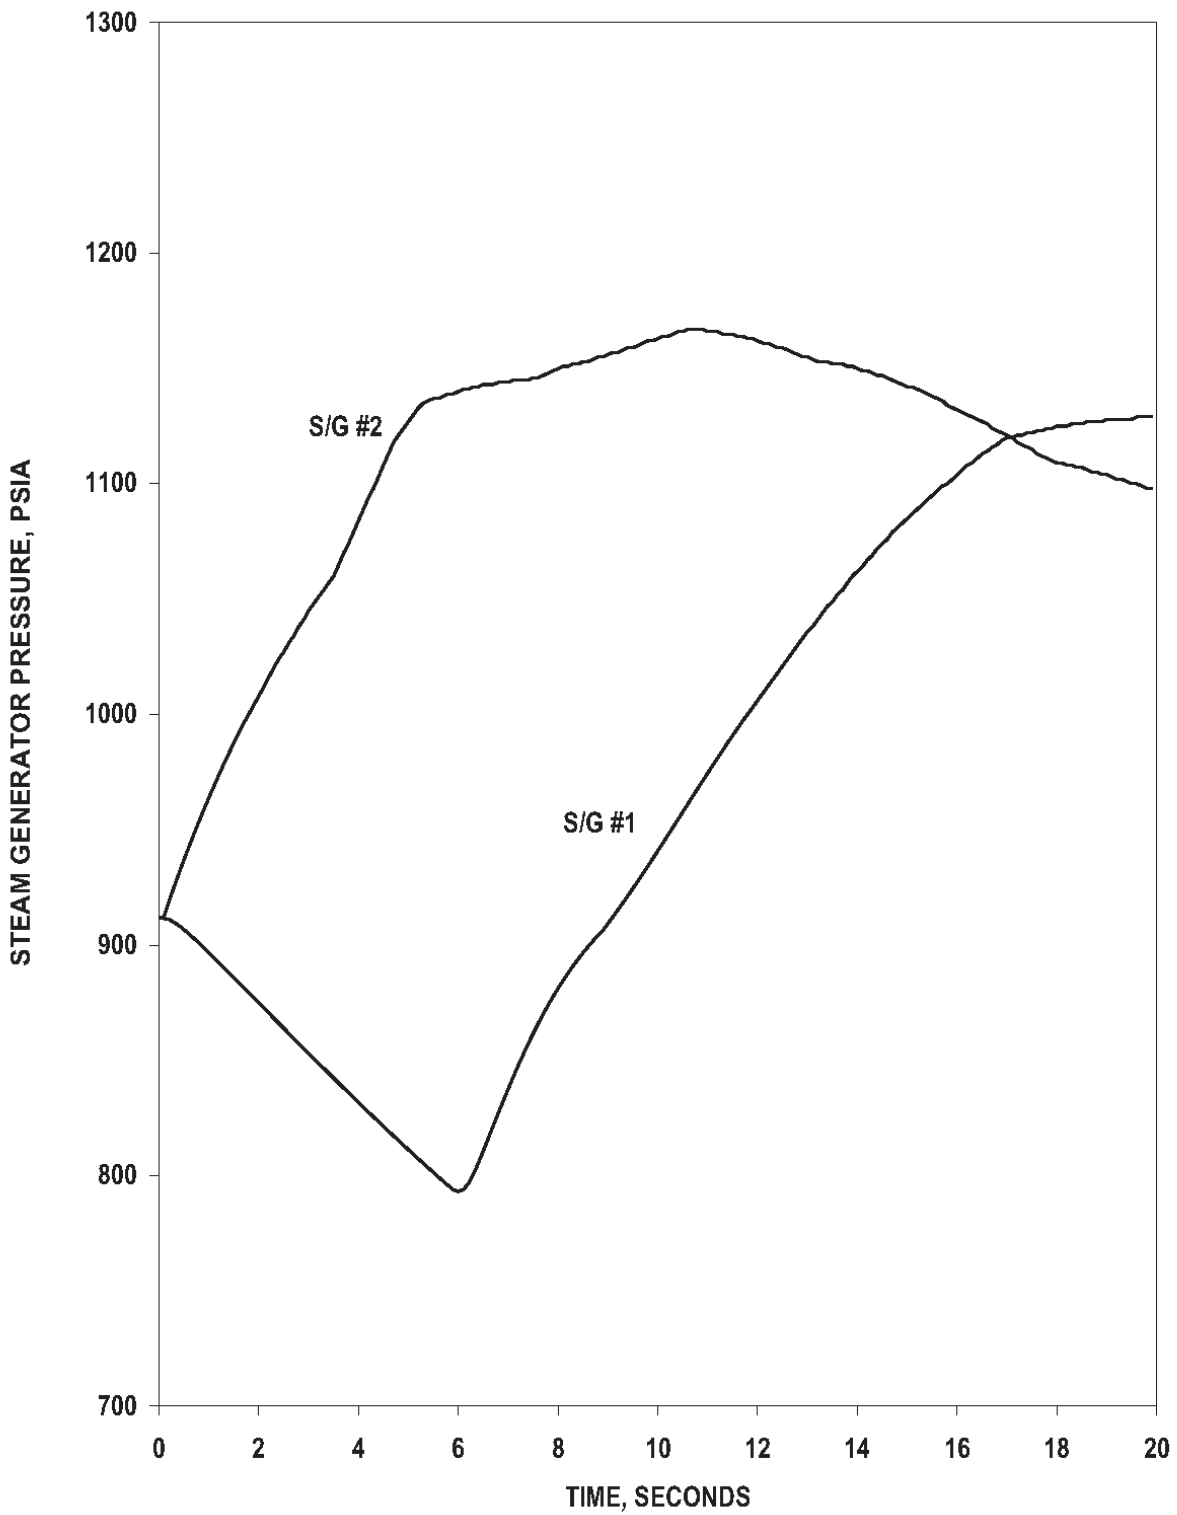


Revision 307 (07/13)

Waterford Steam
Electric Station #3

Asymmetric Steam Generator Transient
Steam Generator Pressure vs. Time

Figure
15.9-5

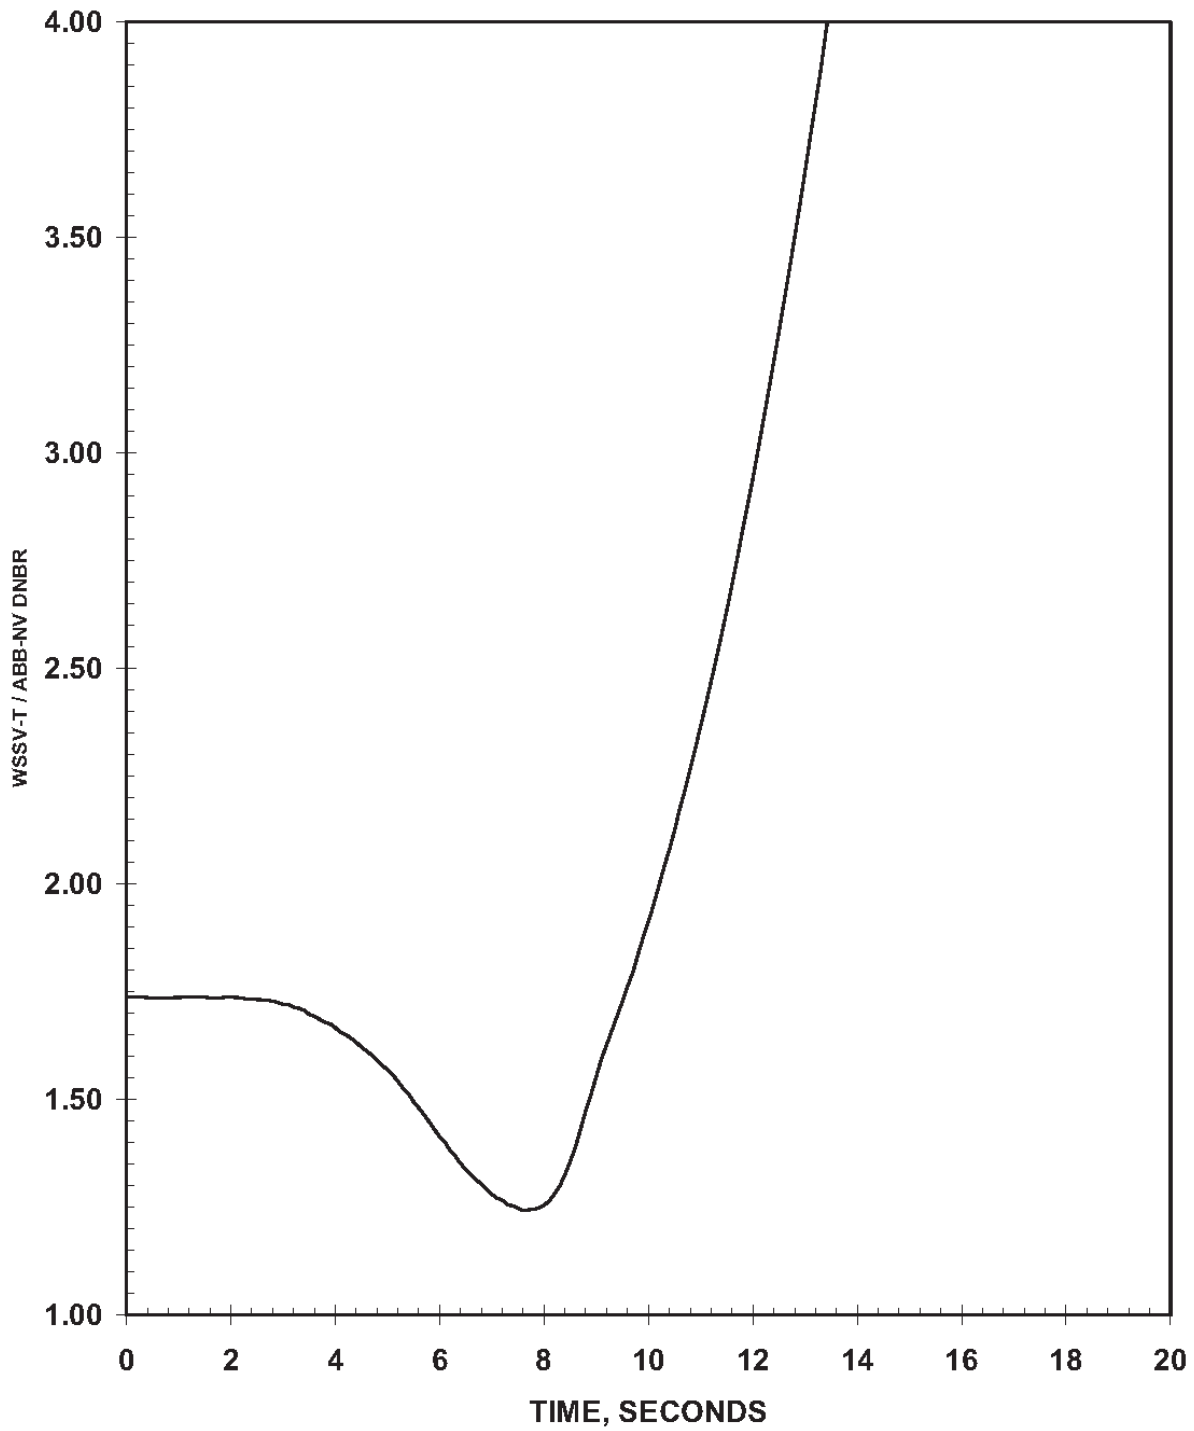

Revision 307 (07/13)

Waterford Steam
Electric Station #3

Asymmetric Steam Generator Transient
DNBR vs. Time

Figure
15.9-6