



INSTITUTE FOR RESEARCH IN
ELECTRONICS
& **APPLIED PHYSICS**

Dr. Timothy W. Koeth
Associate Research Professor
Director, Nuclear Reactor & Radiation Facilities
Energy Research Facility, Building 223,
Paint Branch Drive, College Park, MD 20742-3511
TEL: 301.405.4952 - FAX 301.314.9437 - koeth@umd.edu

Sept 29, 2016

Document Control Desk
United States Nuclear Regulatory Commission
Washington, D.C. 20555-0001

RE: Annual Report: July 1, 2015 - June 30, 2016 for the Maryland University Training Reactor,
Docket No. 50-166, License No. R-70 (TAC NO. ME 1592), University of Maryland.

Enclosed please find the University of Maryland's Annual Report for the period beginning July 1
2015 and ending June 30, 2016 for the MUTR, Docket No. 50-166, License No. R-70

I declare under penalty of perjury that the foregoing response is true and correct.

Sincerely,

A handwritten signature in black ink that reads "Timothy W. Koeth".

Timothy W. Koeth

A020
NRR



Annual Operating Report:

July 1, 2015 - June 30, 2016

MUTR Technical Specification 6.7.1

License No. R-70, Docket No. 50-166

A. James Clark School of Engineering
Department of Materials Science and Engineering
University of Maryland, College Park, MD 20742

Contents

1	Introduction	2
2	Reactor Usage	2
3	Surveillance Tests and Inspections	2
3.1	Maintenance Operations	3
4	Changes to Facility	3
5	Environmental Surveys of Surrounding Areas	3
6	Radioactive Release and Discharge to the Environment	4
6.1	Liquid	4
6.2	Gaseous and Argon-41	5
7	Summary of Exposure Received by Facility Personnel and Visitors	5
8	Unscheduled Shutdown/Reportable Occurrences	5
9	Special Experiments	5
10	Changes in Facility Staff	5

1 Introduction

The University of Maryland Training Reactor (MUTR) is an open-pool type, TRIGA facility licensed for operation at 250 kW thermal power. The MUTR is primarily used for operator training and tours for groups internal and external to the campus. In addition, the facility provides neutron and gamma irradiations, and neutron activation analysis experiments for undergraduate lab classes and graduate research.

2 Reactor Usage

Between July 1, 2015 to June 30, 2016, the MUTR operated for a total of 96 runs, which are categorized as follows:

Operator Training and Requalification	27 runs
Tours, Labs, and Demonstrations	24 runs
Calibration, Maintenance, and Surveillance	18 runs
Irradiations or Activations	28 runs

The total energy produced during this period was 22.96MWh with a corresponding burnup of 1.30 grams of U-235.

3 Surveillance Tests and Inspections

All required surveillance tests and inspections were performed at the intervals required by Technical Specification 4.0.

WATER SAMPLE TESTS

AIR SAMPLE TESTS

RADIATION SURVEYS

CONTROL ROD INSPECTION

CONTROL ROD DROP TEST

RAM CALIBRATION

SNM INVENTORIES

ALARA REVIEW

3.1 Maintenance Operations

In addition to the above surveillance items, the following maintenance operations were performed on the indicated dates:

9/13/15	Replaced primary filter
9/8/15	Dri-rite replaced
11/11/15	Replaced PuBe source string
11/11/15	Replaced microswitches for Shim 1 magnet down, Shim 2 and Regulating Rod up
12/22/15	Dri-rite replaced
11/11/15	Replaced microswitch for Shim 2 magnet down
3/8/16	Dri-rite replaced
4/22/16	Replaced primary resin
6/7/16	Dri-rite replaced

Additional minor maintenance was performed such as light bulb replacement and fine-tuning of equipment as necessary.

4 Changes to Facility

There were no significant changes to the facility during this reporting period.

5 Environmental Surveys of Surrounding Areas

Environmental surveys include the routine environmental dosimeter measurements at the facility perimeter and the remainder of the locations on campus. With the exception of recently positioned monitors [10, 11 and 12], the net measurements in millirem (mrem) tabulated below represent the July 1, 2015 to June 30, 2016 reporting period. Measurements at all points were well within the historical norms.

Environmental Survey Results for the Maryland University Training Reactor July 1, 2015 to June 30, 2016		
MONITOR	LOCATION	DOSE (MREM)
2	308 m NE of MUTR	48 ^a
3	1.1 km SW of MUTR	5
4	758 m NW of MUTR	2
5	387 m SE of MUTR	9
6	North, side MUTR fence line	2
7	East, adjacent to MUTR and IRR	2
8	West, adjacent to MUTR	5
9	606 m S of MUTR	16
10 ^b	950 m W of MUTR	5
11 ^b	South, courtyard adjacent to MUTR	12
12 ^b	248 m NW of MUTR	6

^aDose received is attributed to naturally occurring radioactive material (NORM) in the construction bricks of the building.

^bMonitoring period from January 1, 2016 to June 30, 2016

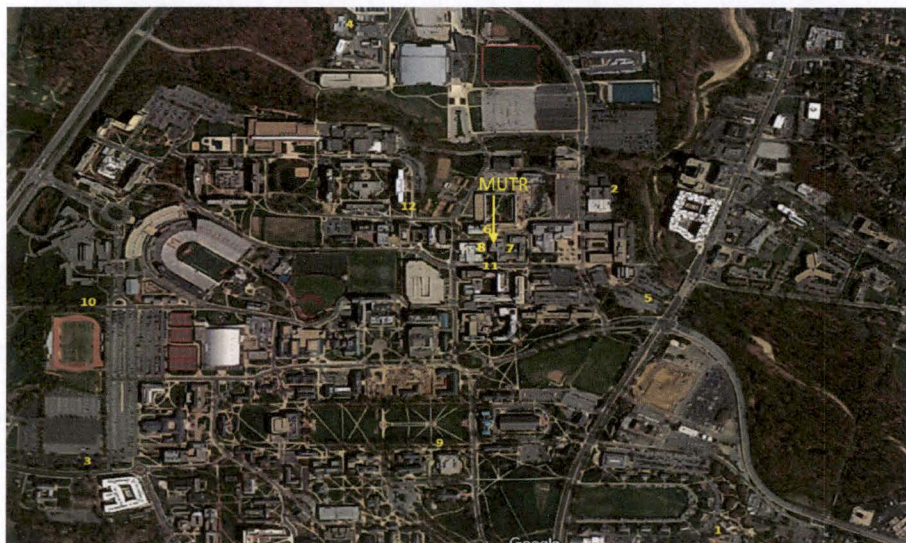


Figure 1: Location of dosimeters and MUTR

6 Radioactive Release and Discharge to the Environment

6.1 Liquid

The Reactor Storage Sump was not discharged during this reporting period.

6.2 Gaseous and Argon-41

The only release from the MUTR to the environment consists of Argon-41 produced from the activation of natural Argon dissolved in pool water and natural Argon present in air within the interstitial spaces of beams and ports. Argon-41 escapes from the pool and spaces into the MUTR reactor building and then leaks to areas outside the building. The two main areas for assessment of public dose due to effluent release are outside the roll-up door on the north side of the reactor building and outside the lower reception room into the hallway 1398.

For this reporting period the reactor was operated for 304.93 hours. EPA CAP88 was utilized to determine the dose outside the roll-up door to be 1.98×10^{-1} mrem. The dose in the hallway 1398 from any effluent release is 5.64×10^{-4} mrem.

7 Summary of Exposure Received by Facility Personnel and Visitors

As part of the annual ALARA audit, facility management reviewed exposure records and found all badged personnel received less than 10% of their annual dose limit. The pocket dosimeters recorded minimal exposure for all guests and service personnel.

8 Unscheduled Shutdown/Reportable Occurrences

During this reporting period, there were 5 unscheduled shutdowns resulting in the reactor SCRAM.

- Run# 4476 Safety 2 High Voltage on January 8, 2016
- Run# 4478 loss of power to Regulating Rod on January 15, 2016
- Run# 4481 period scram on Feb. 10, 2016
- Run# 4506 external scram, undercount on exhaust ram on April 11, 2016
- Run# 4510 AC power glitch on April 14, 2016

There were no reportable occurrences during this reporting period.

9 Special Experiments

There were no new special experiments performed during this reporting period.

10 Changes in Facility Staff

There were no significant staff changes during this period.