

TVA

WALL THICKNESS
PROFILE SHEET

REPORT NO:

R. POISS

PROJECT: WBN


WELD NO: RCF-G-4-4
G4
31-02-09-09

UNIT: 2

SYSTEM: RCS

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	2.70	3.57	3.14	3.22
2	3.24	3.45	3.36	3.44
3	3.3	3.26	3.21	3.2
4	3.65	3.53	N/A	3.89
5	N/A	N/A	N/A	N/A

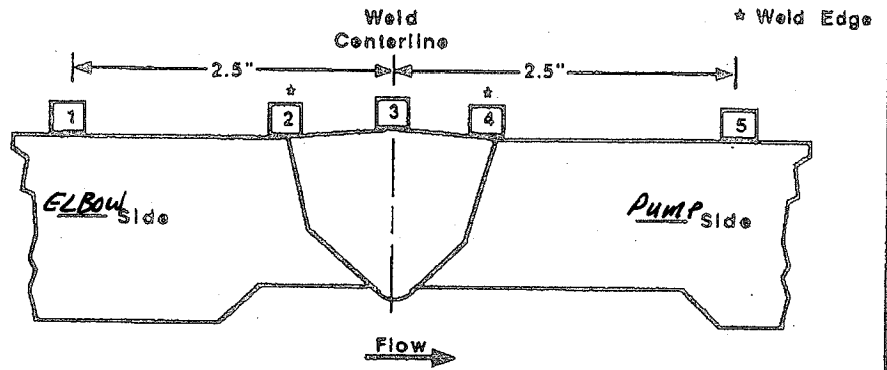


CROWN HEIGHT: FLUSH DIAMETER: 31.0

CROWN WIDTH: 2.5 WELD LENGTH: 118.0

ELBOW

FLOW →

PUMP

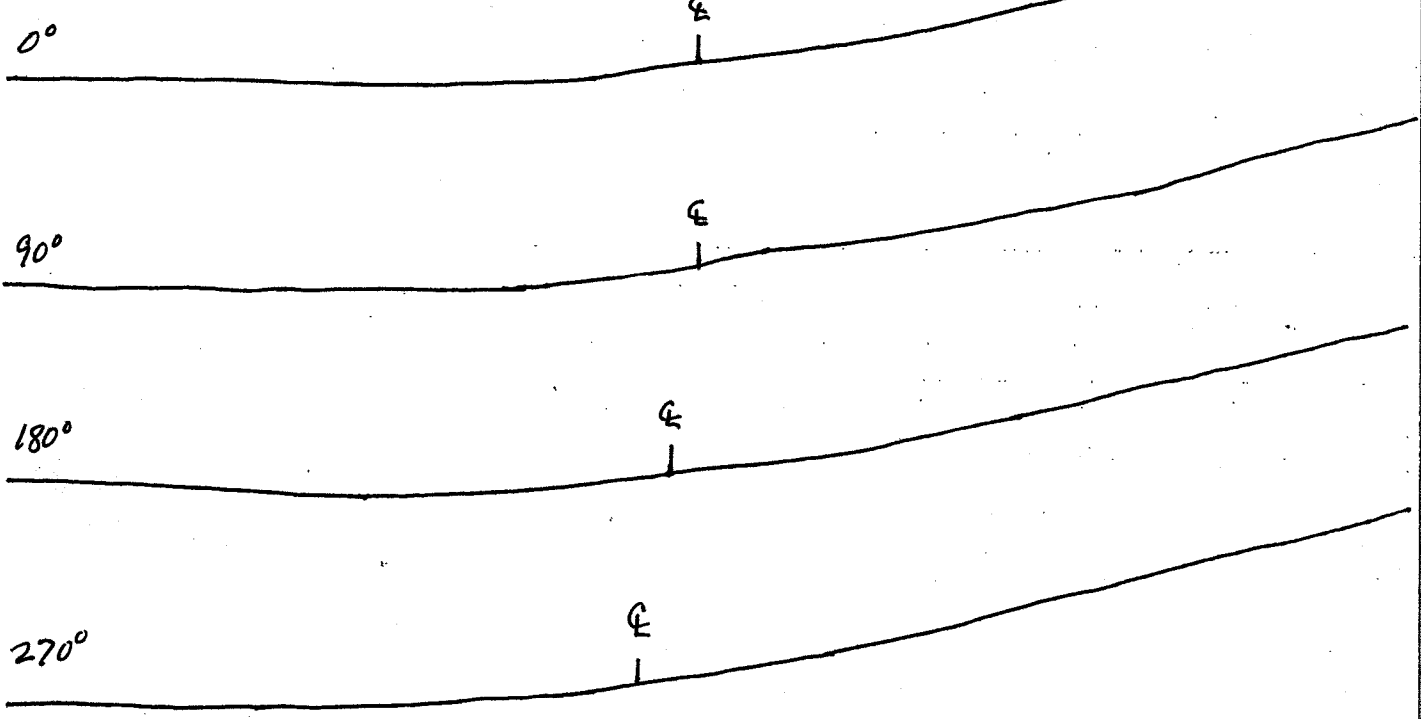

EXAMINER: Jose Alejandro J. Lopez
LEVEL: II
DATE: 02-04-09

REVIEWED BY: Dorena Dulas
LEVEL: III DATE: 02-04-09

ANII: [Signature]
DATE: 3/9/09
PAGE 4 OF 5

TVA

Office of Nuclear Power

PROJECT: WBN SYSTEM: RCS

UNIT: 2 WELD NO: RCF-G4-4


REPORT NO.:

R-PO155

ELBOW

FLOW →

PUMP

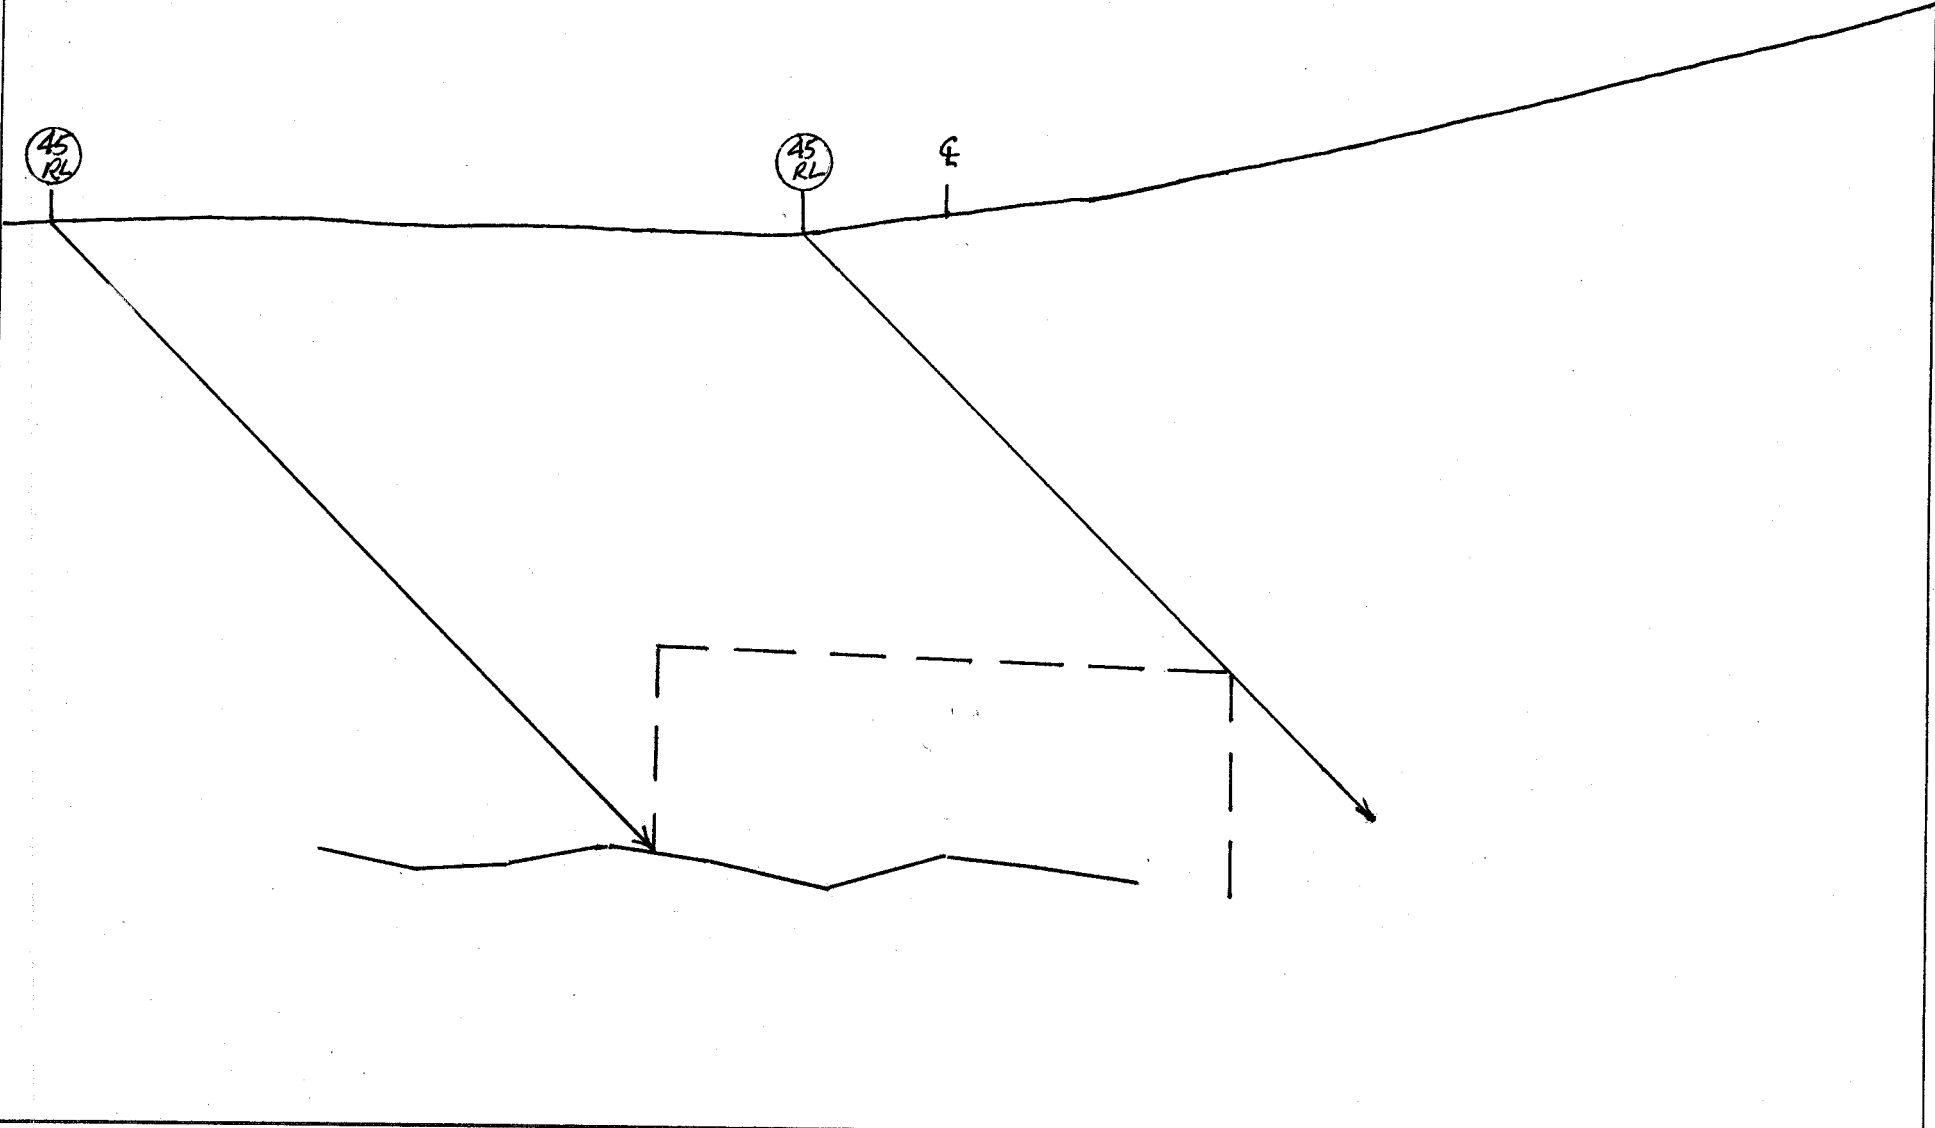

BY: Jose Alejandro [Signature] LEVEL: II DATE: 02-04-09 PAGE 5 OF 5