

TVA

WALL THICKNESS
PROFILE SHEET

REPORT NO:


R 20156

PROJECT: WBN
UNIT: 2

WELD NO: RCF-G2-4
SYSTEM: RCS

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	3.22	3.57	3.20	3.12
2	3.55	3.44	3.20	3.13
3	3.67	3.21	3.18	3.34
4	N/A	N/A	N/A	N/A
5	N/A	N/A	N/A	N/A

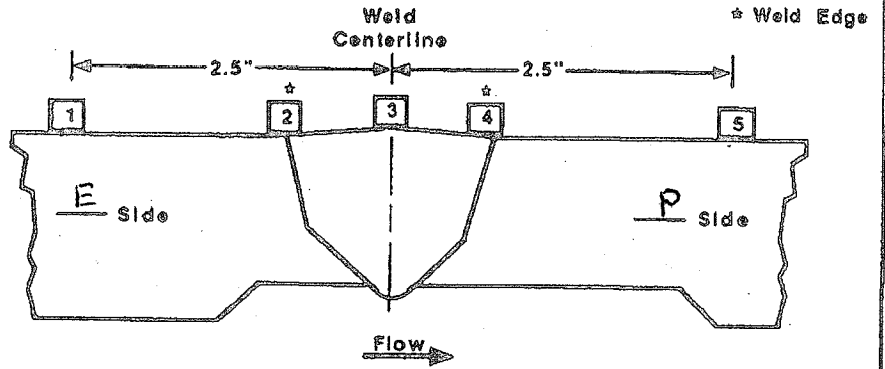


CROWN HEIGHT: FLUSH DIAMETER: 31"
CROWN WIDTH: 2.5" WELD LENGTH: 120.5"

ELBOW

FLOW →

PUMP

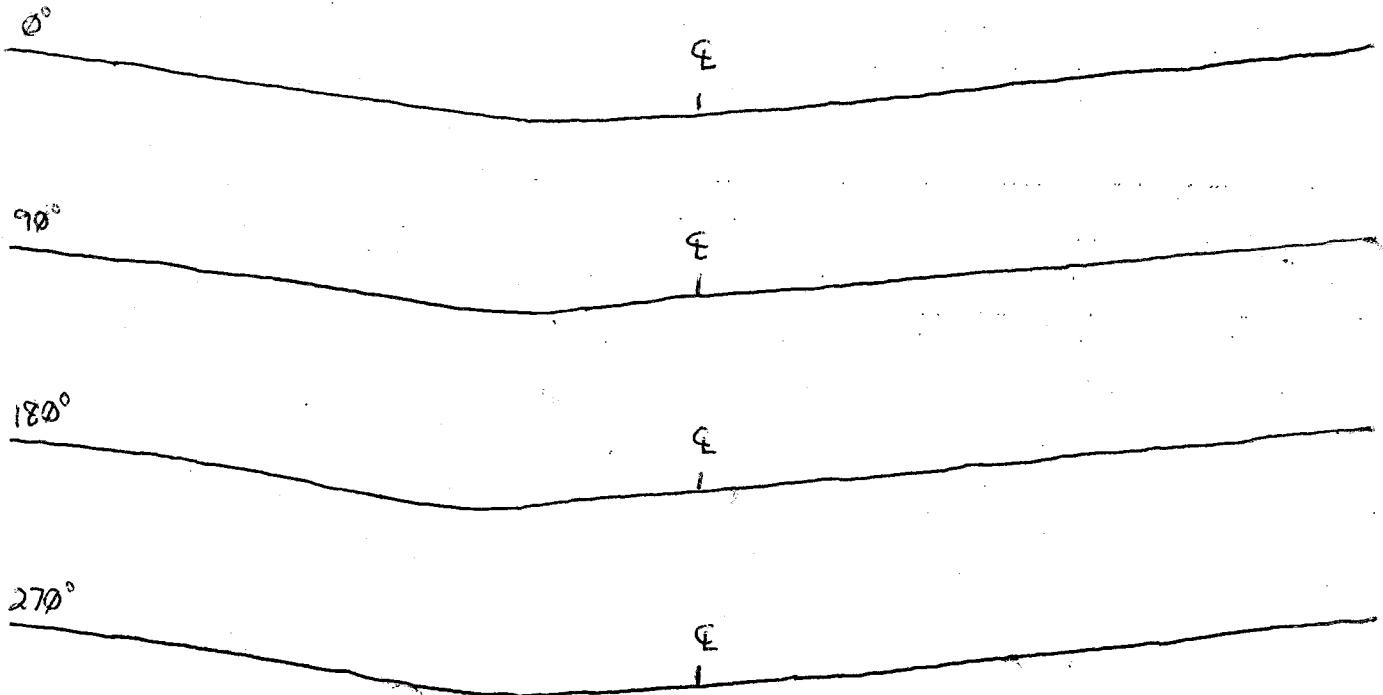

EXAMINER: [Signature]
LEVEL: II
DATE: 2-11-09

REVIEWED BY: [Signature]
LEVEL: III DATE: 2-24-09

ANII: [Signature]
DATE: 3/9/09
PAGE 4 OF 5

TVA

Office of Nuclear Power

PROJECT: WBN

SYSTEM: RCS

UNIT: 2

WELD NO: RCF-G2-4

REPORT NO.:

R. 00156


R. 00156

DR 224-09

ELBOW

FLOW

PUMP

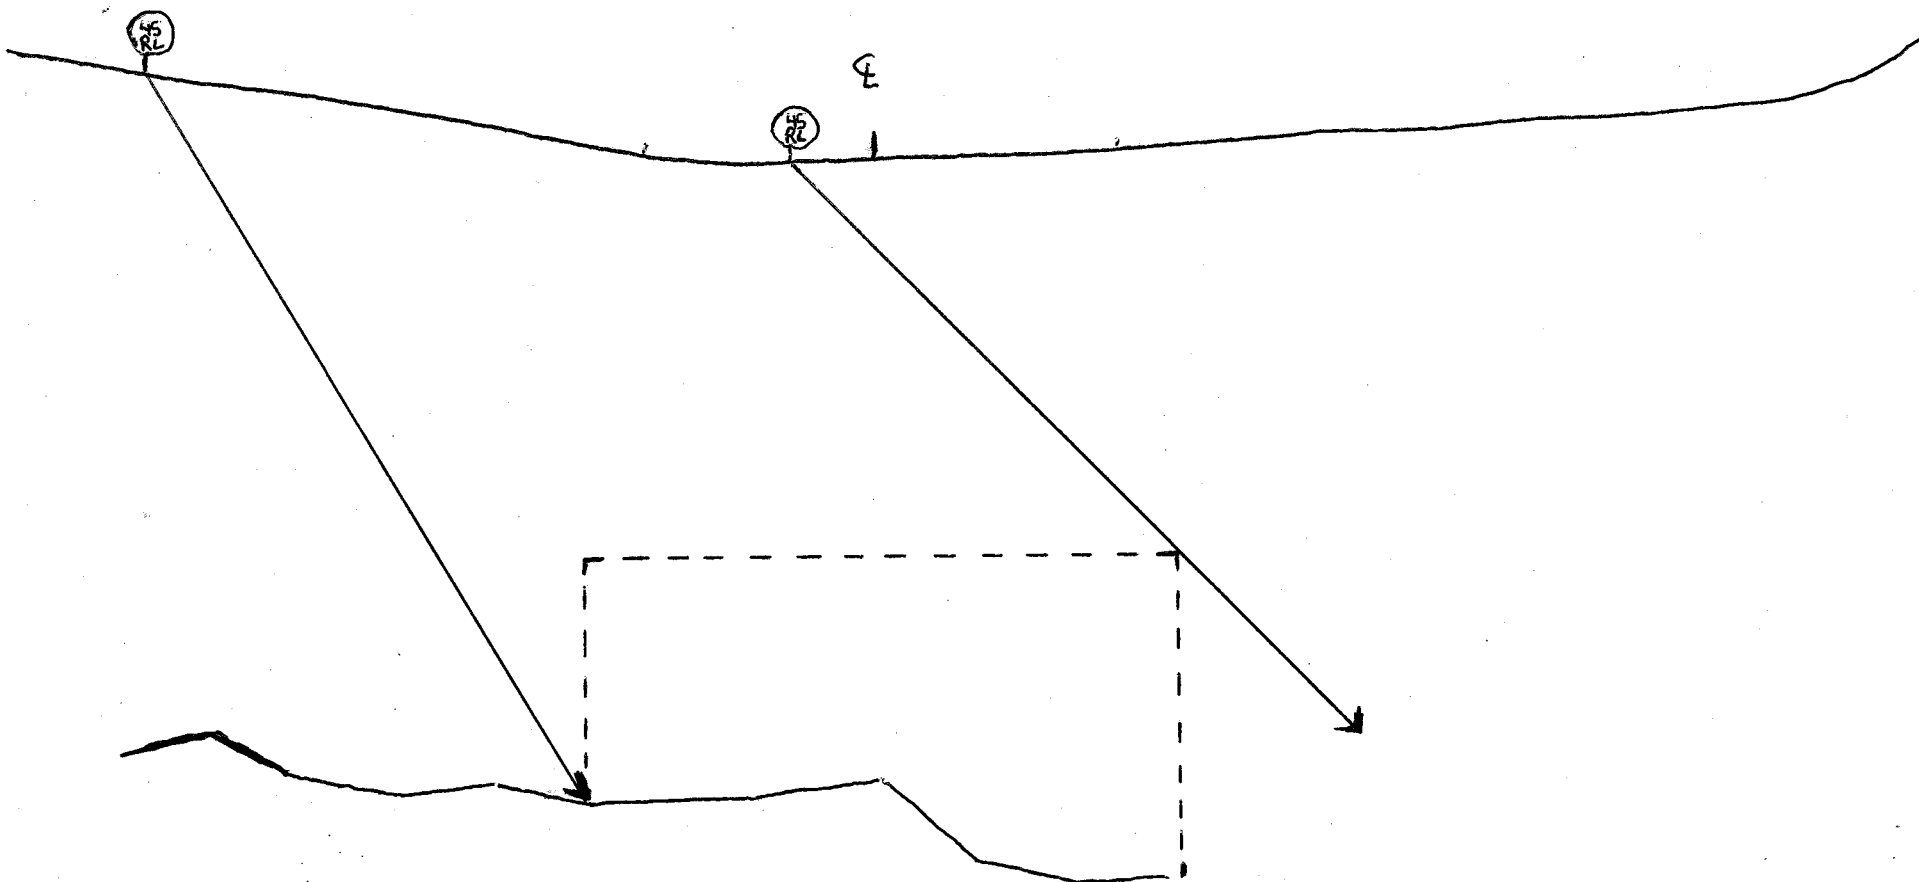

BY: Jean Nison

LEVEL: II

DATE: 2/11/09 PAGE 5 OF 5