


<h1>TVA</h1>	<h2>WALL THICKNESS PROFILE SHEET</h2>	REPORT NO: <u>R-P590</u>
--------------	---	-----------------------------

PROJECT: <u>W B N</u>	WELD NO: <u>SIF-B-T076-6</u>
UNIT: <u>2</u>	SYSTEM: <u>SIS (63)</u>

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°


Position	0°	90°	180°	270°
1	N/A	.276		
2	N/A	.272	N	
3	N/A	.259		A
4	N/A	.379		
5	N/A	N/A		

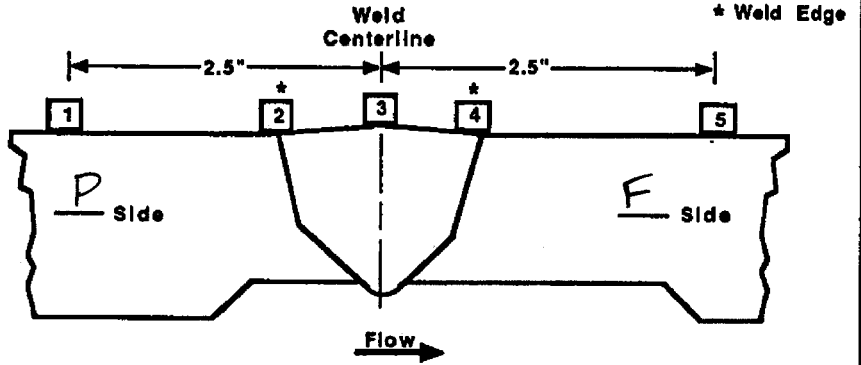

CROWN HEIGHT: <u>.0625"</u>	DIAMETER: <u>1.5"</u>
CROWN WIDTH: <u>.5"</u>	WELD LENGTH: <u>6.5"</u>

PIPE

FLANGE



EXAMINER: <u>[Signature]</u>	REVIEWED BY: <u>[Signature]</u>	ANII: <u>[Signature]</u>
LEVEL: <u>II</u>	LEVEL: <u>III</u>	DATE: <u>7/20/09</u>
DATE: <u>6/29/09</u>	DATE: <u>6/30/09</u>	PAGE <u>4</u> OF <u>5</u>

TVA


Office of Nuclear Power

PROJECT: WBN SYSTEM: SIS (063)

UNIT: 2 WELD NO: SIF-B-T076-6

REPORT NO.:

R-P0590

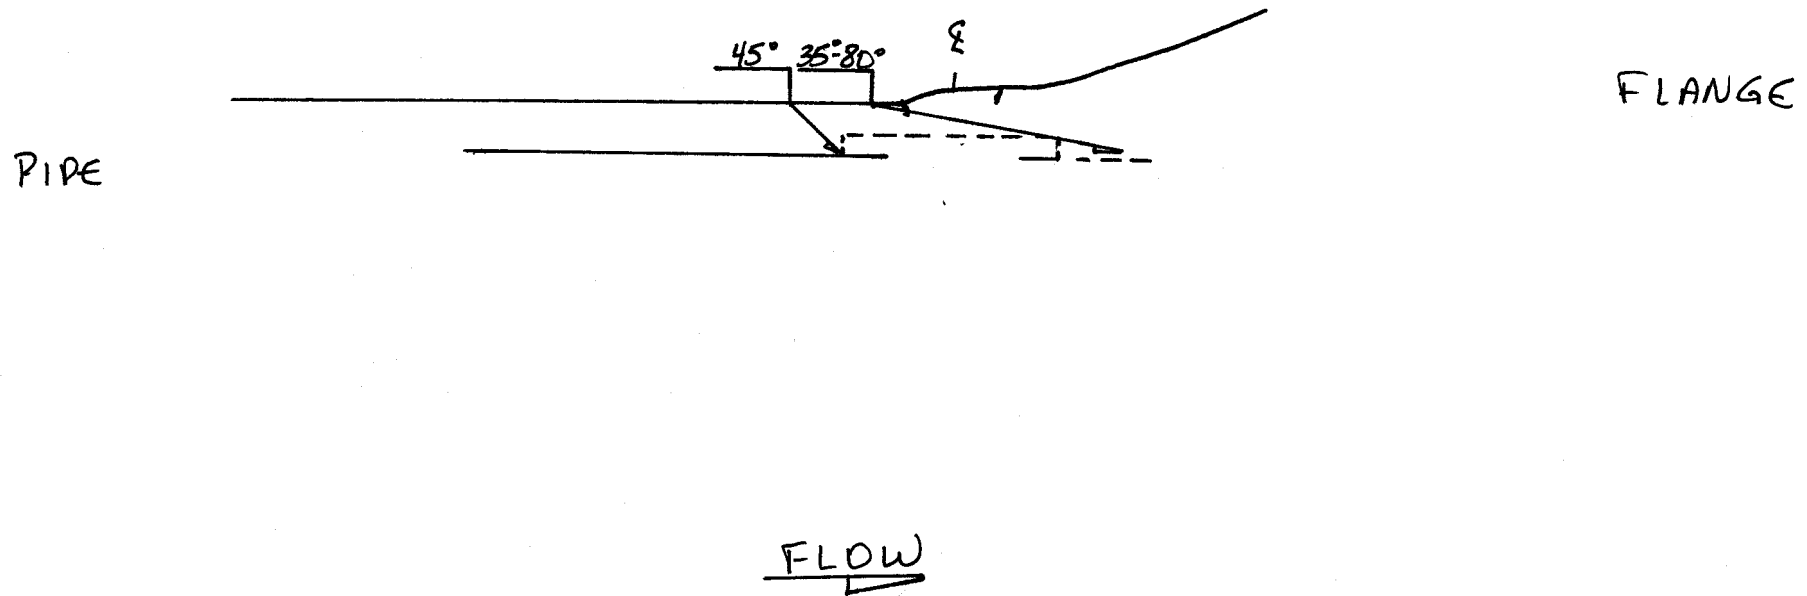

EXAMINATION PERFORMED WITH QUALIFIED SECTOR SCAN ANGLES OF 35° TO 80° AX & 35° TO 70° CIRC

BY: Pat Mahoney P Mahoney LEVEL: II DATE: 6/29/09 PAGE 5 OF 5

TVA Procedure
N-GP-31

Weld # SIF-B-T076-6

Attachment 3

Item 1	Required examination Volume in sq. in. (width x height)	1	0.109	0.109 sq. in.
Item 2	Number of scan directions	4 directions		
Item 3	Total Scan volume in sq. in.	0.436 sq. in.		
Item 4	Total length of weld	6.5 inches		
Item 5	Total required exam volume in cubic inches	2.834 cu. in.		
Item 6	Exam volume achieved (sq. in.) in direction 1 X length of weld achieved	0.109	6.5	0.7085 cu. In.
Item 7	Exam volume achieved (sq. in.) in direction 2 X length of weld achieved	0.109		0 cu. In.
Item 8	Exam volume achieved (sq. in.) in direction 3 X length of weld achieved	0.0545	6.5	0.35425 cu. In.
Item 9	Exam volume achieved (sq. in.) in direction 4 X length of weld achieved	0.0545	6.5	0.35425 cu. In.
Item 10	Determined the achieved exam volume add 6, 7, 8 & 9	1.417 cu. In.		
Item 11	Exam volume percentage item 10/item 5 x 100	50%		

Directions 3 & 4 (Circ Scan directions 5 & 6) were restricted to pipe side of weld.
This was a single sided examination

[Signature] Level: II Date: 6/29/09

INFORMATION ONLY