

TVA

WALL THICKNESS  
PROFILE SHEET

REPORT NO:


R. P. 1161

PROJECT: WISN  
UNIT: 2


WELD NO: SIF-D119-03  
SYSTEM: SIS

Record Thickness Measurements As Indicated, including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	N/A	N/A	N/A	N/A
2	.390	.313	.322	.312
3	.325	.310	.309	.303
4	.343	.303	.354	.359
5	.372	.367	.373	.372

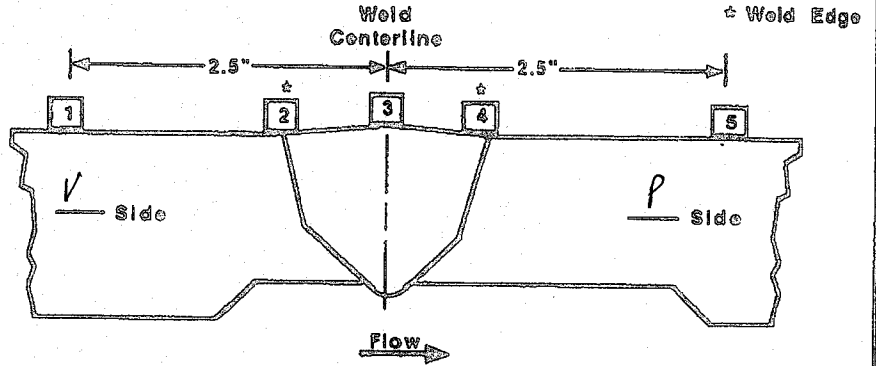

CROWN HEIGHT: .1 DIAMETER: 4  
CROWN WIDTH: .4 WELD LENGTH: 14.25"

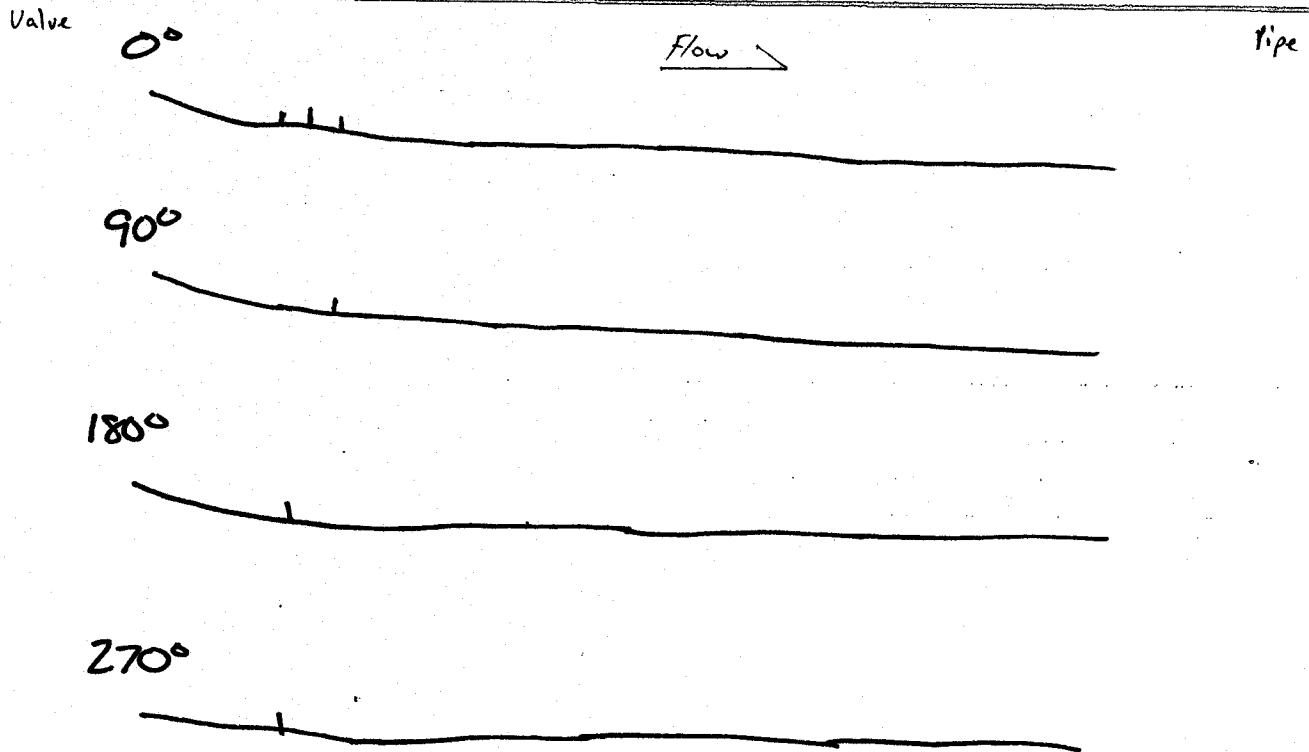

EXAMINER: <u>Brad Langston</u>	REVIEWED BY: <u>Darren Duley</u>	ANH: <u>AM</u>
LEVEL: <u>II</u>	LEVEL: <u>III</u> DATE: <u>6-25-10</u>	DATE: <u>7-20-10</u>
DATE: <u>6-17-10</u>		PAGE <u>6</u> OF <u>67</u>

TVA

Office of Nuclear Power

PROJECT: WBN

SYSTEM: SIS


REPORT NO.:

UNIT: 2

WELD NO: SIF-D119-03

VAIVE

PIPE

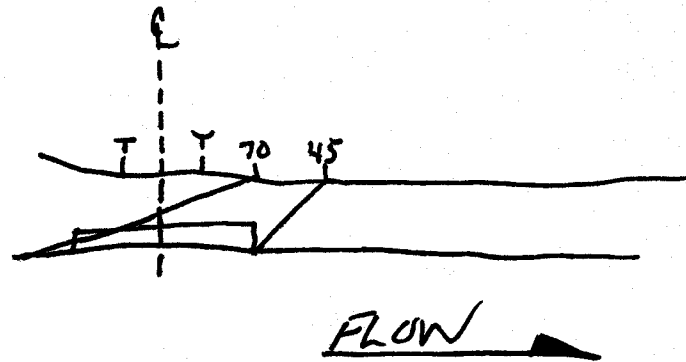

BY: Brad Langston

LEVEL: II

DATE: 6-17-10

PAGE 7 OF 7