

TVA

**WALL THICKNESS
PROFILE SHEET**

REPORT NO:


R.P2437

PROJECT: WBN
UNIT: 2


WELD NO: RCF-E4-2-SE
SYSTEM: RCS

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	N/A	N/A	N/A	N/A
2	N/A	N/A	N/A	N/A
3	2.36	2.42	2.39	2.42
4	2.58	2.47	2.46	2.48
5	2.82	2.67	2.62	2.77

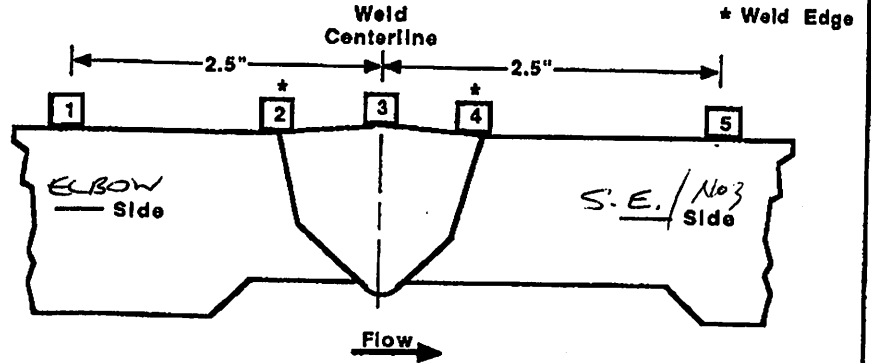

CROWN HEIGHT: FLAT DIAMETER: 36" OD
CROWN WIDTH: 1.7" WELD LENGTH: 114 1/8"

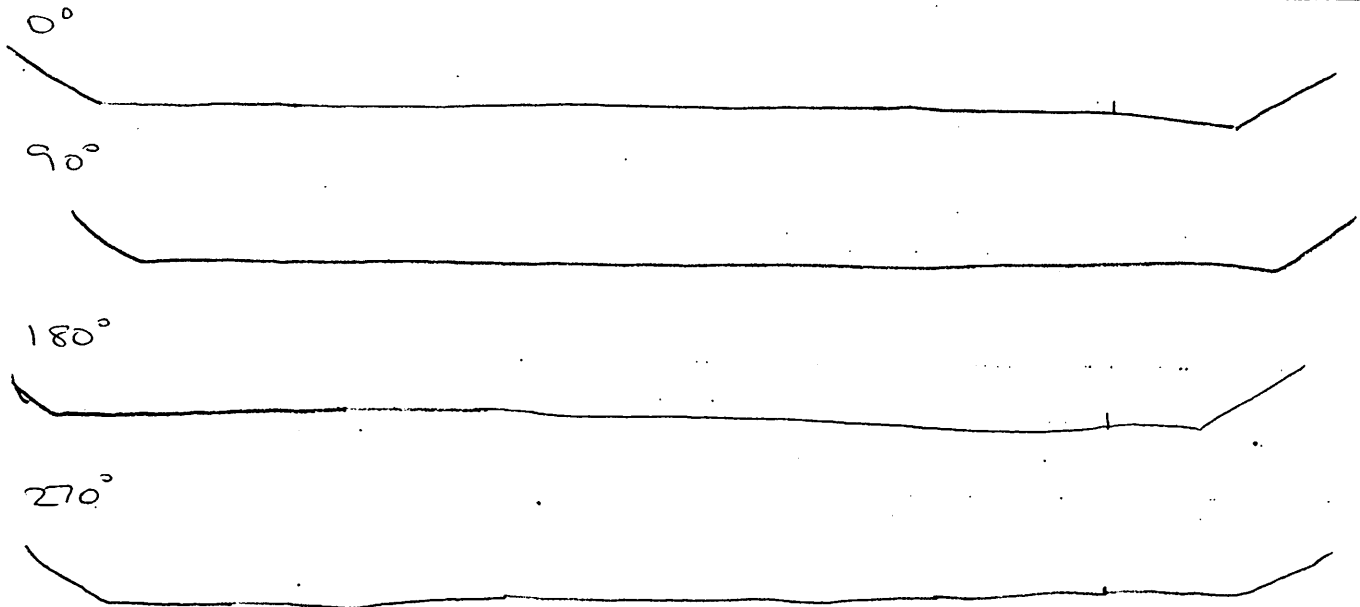

EXAMINER: D.J. MACKAY
LEVEL: III
DATE: 11-4-2014

REVIEWED BY: Matt Welch
LEVEL: III DATE: 2/25/15

ANN: Joe C. Hair
Joe C. Hair
DATE: 08/06/2015
PAGE 5 OF 7

TVA

Office of Nuclear Power

PROJECT: WBN


SYSTEM: RCS


REPORT NO.:

UNIT: 2

WELD NO: RCE-E4-2-SE

R.P2437

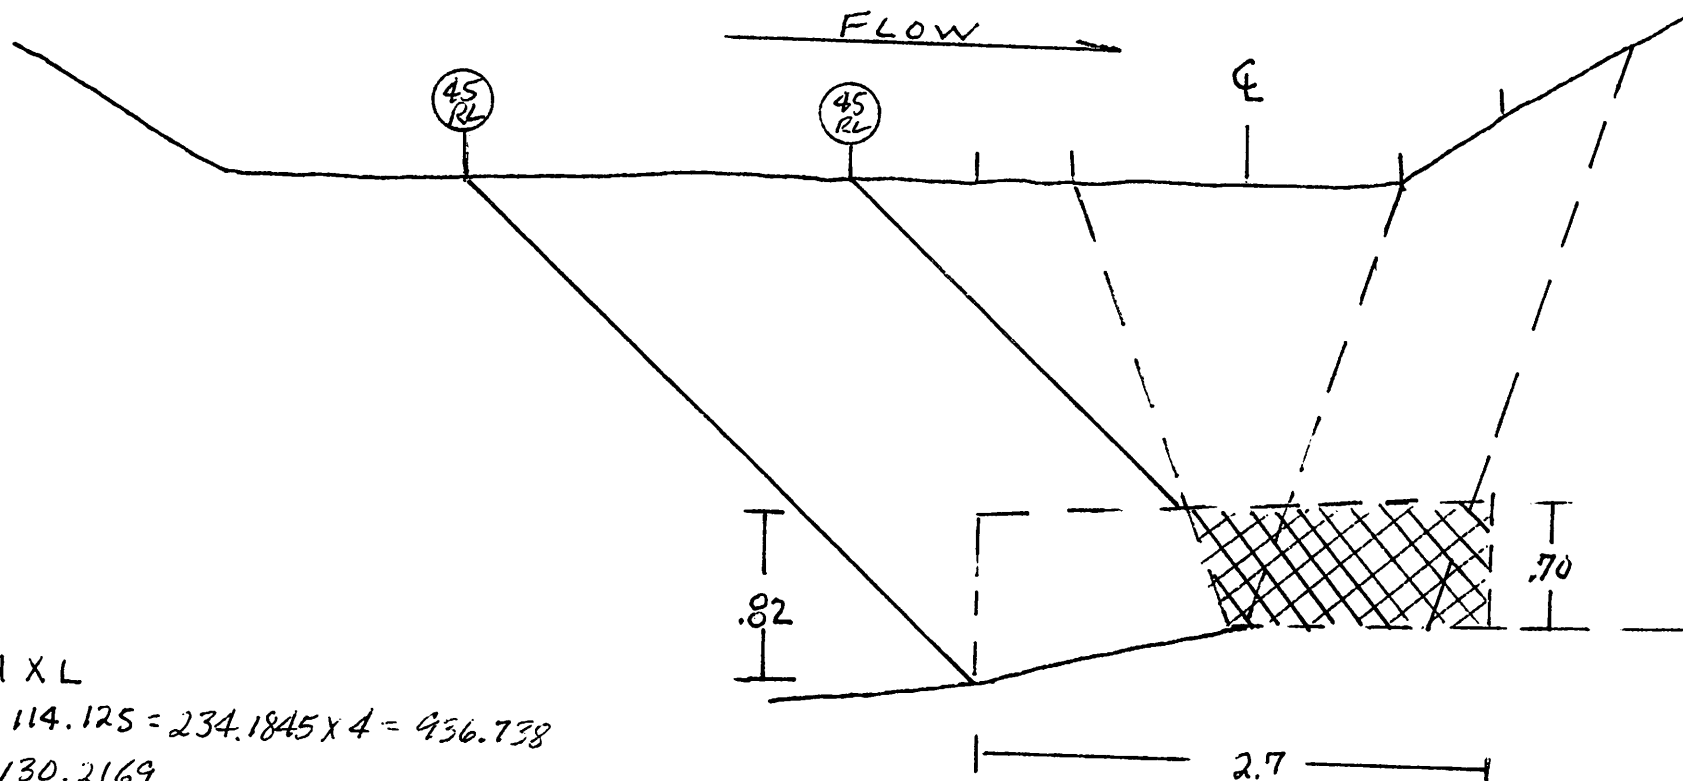

 Axial scans not covered

W X H X L

$2.7 \times .76 \times 114.125 = 234.1845 \times 4 = 936.738$

Scan 3 = 130.2169

Scan 4 = 0

Scan 5 = 91.87

Scan 6 = 91.87

$313.9569 \div 936.738 = .3351 \times 100 = 33.51\%$

ANZI Reviewed:
Soc C. HAIR
for E. Hair observations

BY:

Joe C. Hair

LEVEL: II

DATE: 12-17-14

¹⁴
_{12/17/14}

PAGE 6

OF 7

TVA

Office of Nuclear Power


PROJECT: WBN SYSTEM: RCS

REPORT NO.:

UNIT: 2 WELD NO: RCF-E4-2-5E

R-02437

FLOW →

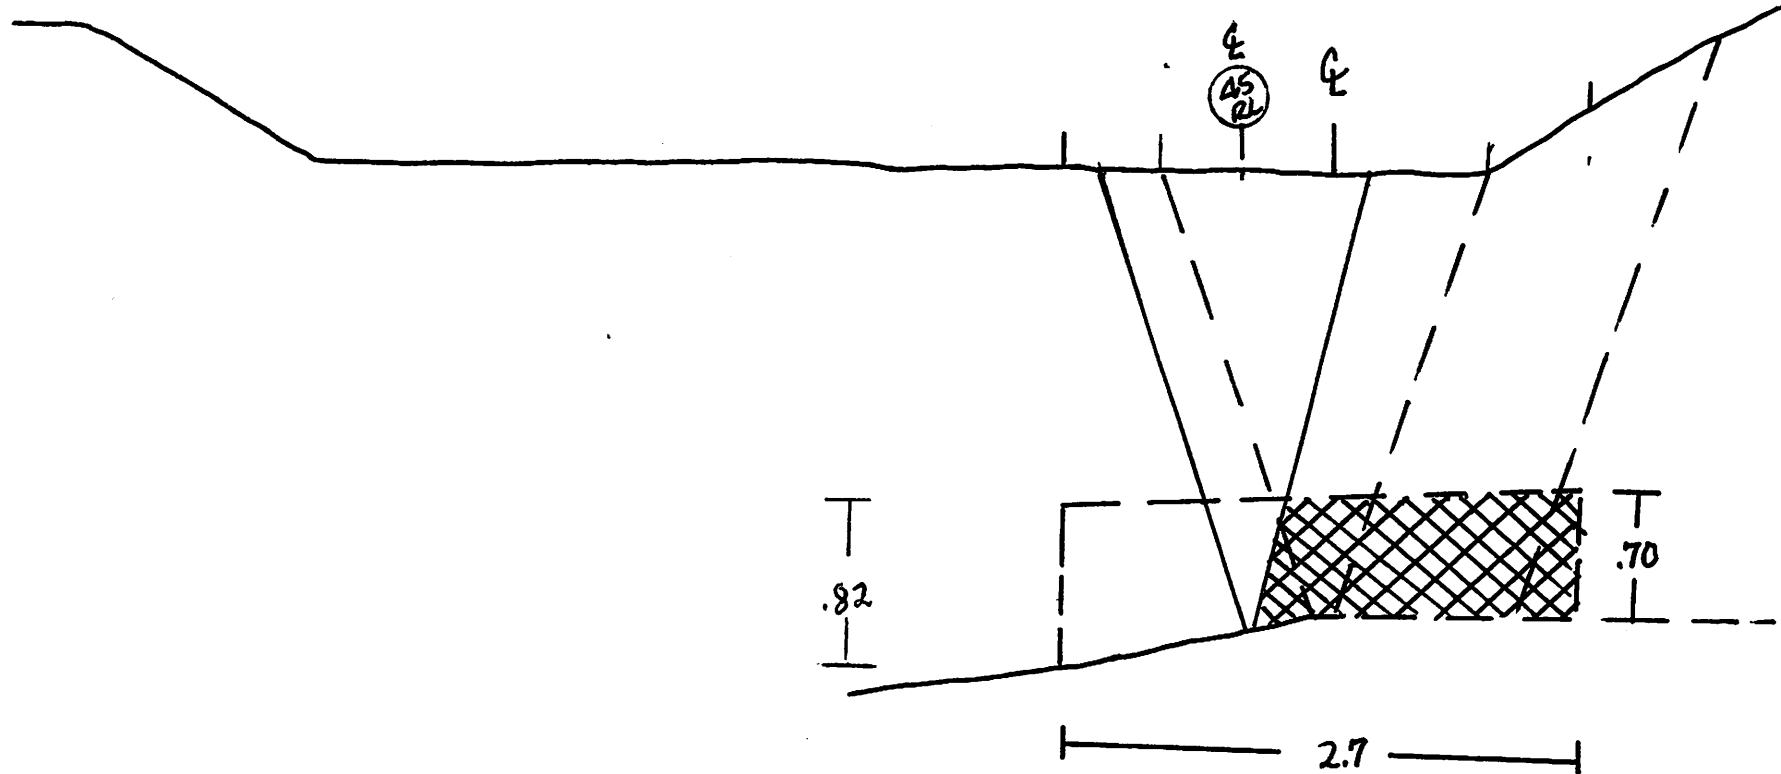

CIRC SCANS NOT COVERED

AVIZ Reviewed:
Joe C. Hair
Joe C. Hair October 2015

BY: Paul Lopez LEVEL: II DATE: 12-17-14 PAGE 7 OF 7