

TVA

**WALL THICKNESS
PROFILE SHEET**

REPORT NO:


R-P2472

PROJECT: WBN
UNIT: 2

WELD NO: SIF-D123-05
SYSTEM: SIS (063)

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	* N/A	N/A	N/A	N/A
2	.699	.703	.694	.733
3	.670	.648	.637	.679
4	.625	.622	.577	.594
5	.645	.640	.605	.649

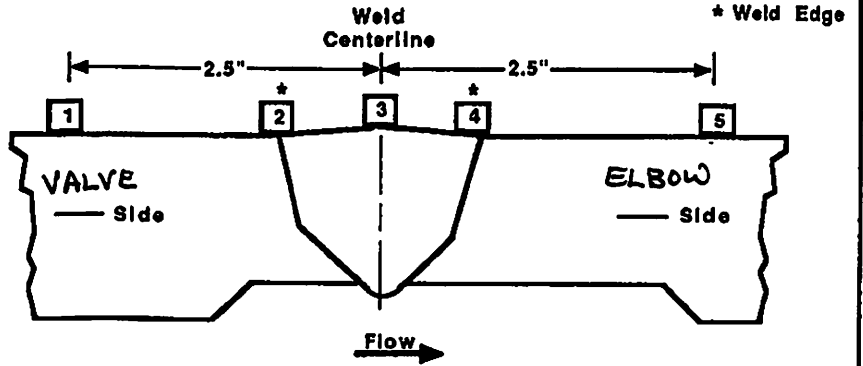

CROWN HEIGHT: FLUSH DIAMETER: 14"
CROWN WIDTH: .875" WELD LENGTH: 45"



* READINGS NOT TAKEN

EXAMINER: [Signature]
LEVEL: II
DATE: 03-10-15

REVIEWED BY: [Signature]
LEVEL: III DATE: 5-6-15

ANII: [Signature]
DATE: 7/04/05
PAGE 5 OF 6

TVA

Office of Nuclear Power

PROJECT: WBN SYSTEM: SIS (063)

UNIT: 2 WELD NO: SIF-D123-05


REPORT NO.:

R.D2472

VALVE

FLOW →

ELBOW

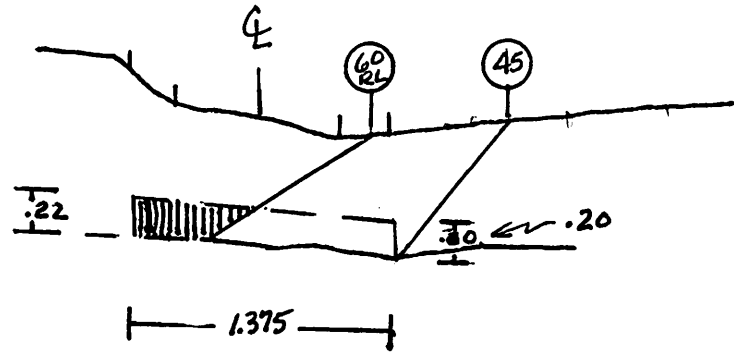

50% one sided examination
code credit coverage
achieved.

BY:

John Reynolds

LEVEL: II

DATE: 03-10-15

PAGE 6 OF 6