

TVA

Office of Nuclear Power

PROJECT: WBN SYSTEM: SIS (063)

UNIT: 2 WELD NO: SIF-B-T097-12


REPORT NO.:

R.P2473

PIPE

← FLOW

FLANGE

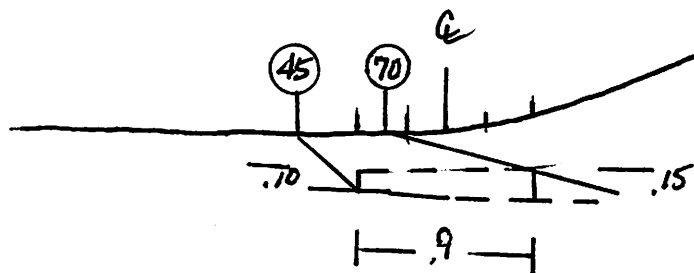

50% one sided examination
code credit coverage achieved.


BY: (Signature) LEVEL: (Signature) DATE: 03-18-15 PAGE 6 OF (7)

<h1>TVA</h1>	<h2>WALL THICKNESS PROFILE SHEET</h2>	REPORT NO: <i>R.P2473</i>
--------------	---------------------------------------	------------------------------


PROJECT: <u>WBN</u>	WELD NO: <u>SIF-B-T097-12</u>
UNIT: <u>2</u>	SYSTEM: <u>SIS (063)</u>

Record Thickness Measurements As Indicated, including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	*			
2	.327	N		
3	.310			
4	.299		A	
5	.321			

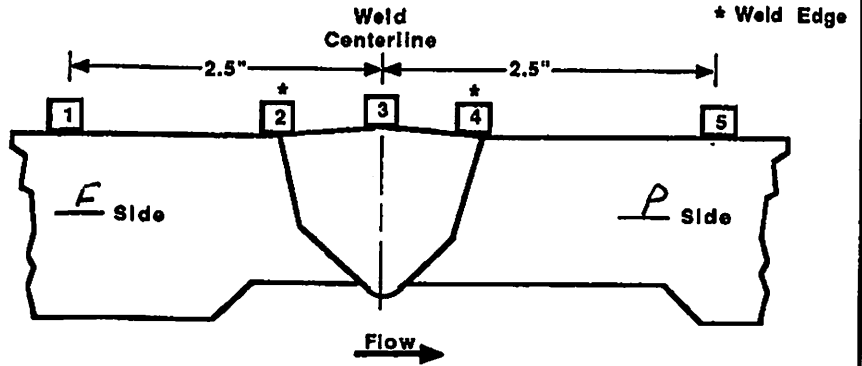

CROWN HEIGHT: <u>FLUSH</u>	DIAMETER: <u>1.50</u>
CROWN WIDTH: <u>.4</u>	WELD LENGTH: <u>6.25</u>

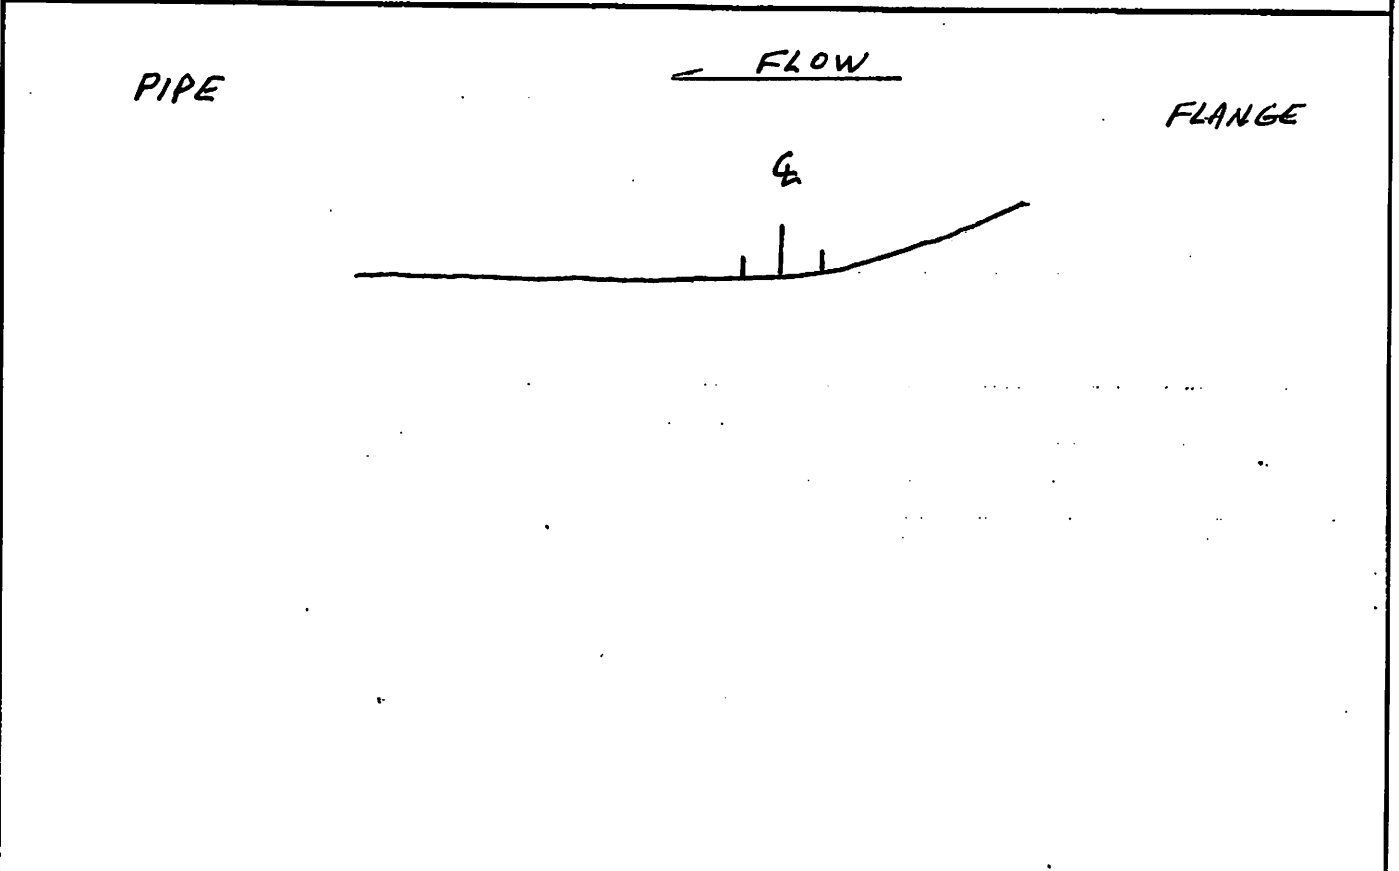

** No thickness readings taken due to configuration.*

EXAMINER: <u><i>Mike Leonardo</i></u>	REVIEWED BY: _____	ANII: <u><i>WJZ</i></u>
LEVEL: <u><i>II</i></u>	LEVEL: _____	DATE: <u><i>7/14/15</i></u>
DATE: <u><i>03-18-15</i></u>	DATE: _____	PAGE: <u><i>7</i></u> OF <u><i>7</i></u>