

TVA

Office of Nuclear Power

PROJECT: WBN SYSTEM: SIS (063)

UNIT: 2 WELD NO: SIF-B-T107-05


REPORT NO.:

R.P2475

PIPE

← FLOW

FLANGE

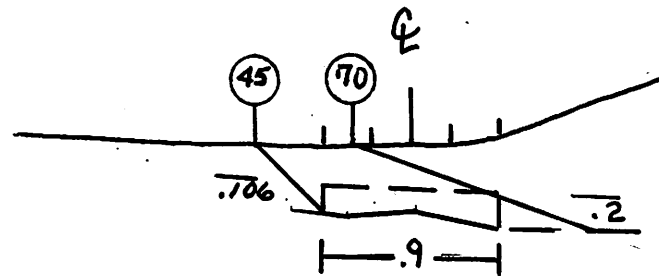

50% one sided examination  
code credit coverage achieved

BY: (*Mike Lupardo*) LEVEL: 7 DATE: 03-18-15 PAGE 0 OF ( 7

TVA

WALL THICKNESS PROFILE SHEET

REPORT NO:

R-P2475

PROJECT: WBN


WELD NO: SIF-B-T107-05

UNIT: 2

SYSTEM: SIS (063)

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	*			
2	.317		N	
3	.310			
4	.285		A	
5	.277			

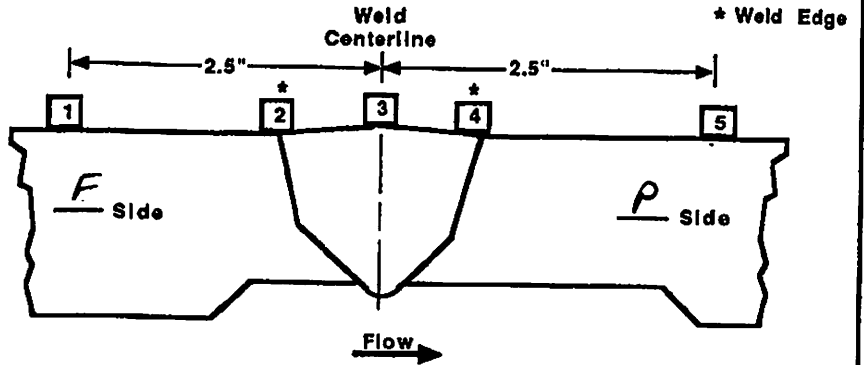


CROWN HEIGHT: FLUSH      DIAMETER: 1.50  
 CROWN WIDTH: .4      WELD LENGTH: 6.25

PIPE

← FLOW

FLANGE

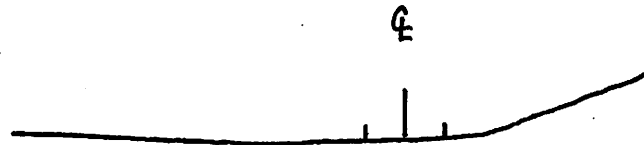

\* No thickness readings taken <sup>due</sup> to configuration.

EXAMINER: [Signature]  
 LEVEL: II  
 DATE: 03-18-15

REVIEWED BY: [Signature]  
 LEVEL: TU      DATE: 5-6-15

ANII: [Signature]  
 DATE: 7-20-15  
 PAGE: 7 OF 7