

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

TO: J F Stolz		FROM: Pacific Gas & Elec Co San Francisco, Calif P A Crane Jr		DATE OF DOCUMENT 10-4-77
<input checked="" type="checkbox"/> LETTER <input checked="" type="checkbox"/> ORIGINAL <input type="checkbox"/> COPY		<input type="checkbox"/> NOTORIZED <input checked="" type="checkbox"/> UNCLASSIFIED	PROP	INPUT FORM
				DATE RECEIVED 10-14-77
				NUMBER OF COPIES RECEIVED <b>1 signed</b>

DESCRIPTION  
furnishing info concerning their 8-25-77 request for interim operating license .....with regard to modifications in the auxiliary building & radiation exposures....

1 p

PLANT NAME: Diablo Canyon 1 & 2  
10-14-77 ehf


**Dist. Per. D. Allison**

ENCLOSURE

SAFETY		FOR ACTION/INFORMATION		ENVIRONMENTAL	
<input checked="" type="checkbox"/> ASSIGNED AD:	<b>VASSALLO</b>	<input checked="" type="checkbox"/> ASSIGNED AD:	<b>V. MOORE (LTR)</b>		
<input checked="" type="checkbox"/> BRANCH CHIEF:	<b>STOLZ</b>	<input checked="" type="checkbox"/> BRANCH CHIEF:	<b>Knighen</b>		
<input checked="" type="checkbox"/> PROJECT MANAGER:	<b>ALLISON (2)</b>	<input checked="" type="checkbox"/> PROJECT MANAGER:	<b>CLARK</b>		
<input checked="" type="checkbox"/> LICENSING ASSESTANT:	<b>HYLTON</b>	<input checked="" type="checkbox"/> LICENSING ASSISTANT:	<b>SLATER</b>		
			<b>B. HARLESS</b>		

INTERNAL DISTRIBUTION			
<input checked="" type="checkbox"/> REG FILES (2)		SYSTEMS SAFETY	PLANT SYSTEMS
<input checked="" type="checkbox"/> NRC PDR	<input checked="" type="checkbox"/> R. MATTSO	TEDESCO	SITE SAFETY & ENVIRON ANALYSIS
<input checked="" type="checkbox"/> F & E (2)	<input checked="" type="checkbox"/> SCHROEDER	BENAROYA	DENTON & MULLER
<input checked="" type="checkbox"/> OELD		LATNAS	CRUTCHFIELD
GOSSICK & STAFF	ENGINEERING	IPPOLITO	
HANAHER	<input checked="" type="checkbox"/> KNIGHT	F. ROSA	ENVIRO TECH.
MTPC	<input checked="" type="checkbox"/> BOSNAK		<input checked="" type="checkbox"/> ERNST
<input checked="" type="checkbox"/> CASE	<input checked="" type="checkbox"/> SHWELL	OPERATING REACTORS	<input checked="" type="checkbox"/> BALLARD
<input checked="" type="checkbox"/> BOYD	<input checked="" type="checkbox"/> PAWLICKI	STELLO	<input checked="" type="checkbox"/> YOUNGBLOOD
<input checked="" type="checkbox"/> DeYoung		EISENHUT	
PROJECT MANAGEMENT	REACTOR SAFETY	SHAO	SITE TECH.
SKOVHOLT	ROSS	BAER	
P. COLLINS	NOVAK	BUTLER	<input checked="" type="checkbox"/> GAMMILL (2)
HOUSTON	ROSZTOCZY	GRIMES	
MELTZ	CHECK		SITE ANALYSIS
HELTEMES		<input checked="" type="checkbox"/> <b>Nehemias</b>	<input checked="" type="checkbox"/> VOLLMER
SK	AT&I		BUNCH
	SALTZMAN		J. COLLINS
	RUTBERG		<input checked="" type="checkbox"/> KREGER

EXTERNAL DISTRIBUTION			CONTROL NUMBER
<input checked="" type="checkbox"/> LPDR: <b>SAN Luis Obispo, CA.</b>			772870155
TIC	NSIC		
NAT LAB			
<input checked="" type="checkbox"/> REG IV (J. HANCHETT)			
<input checked="" type="checkbox"/> CYS ACRS SENT CATEGORY <b>A</b>			

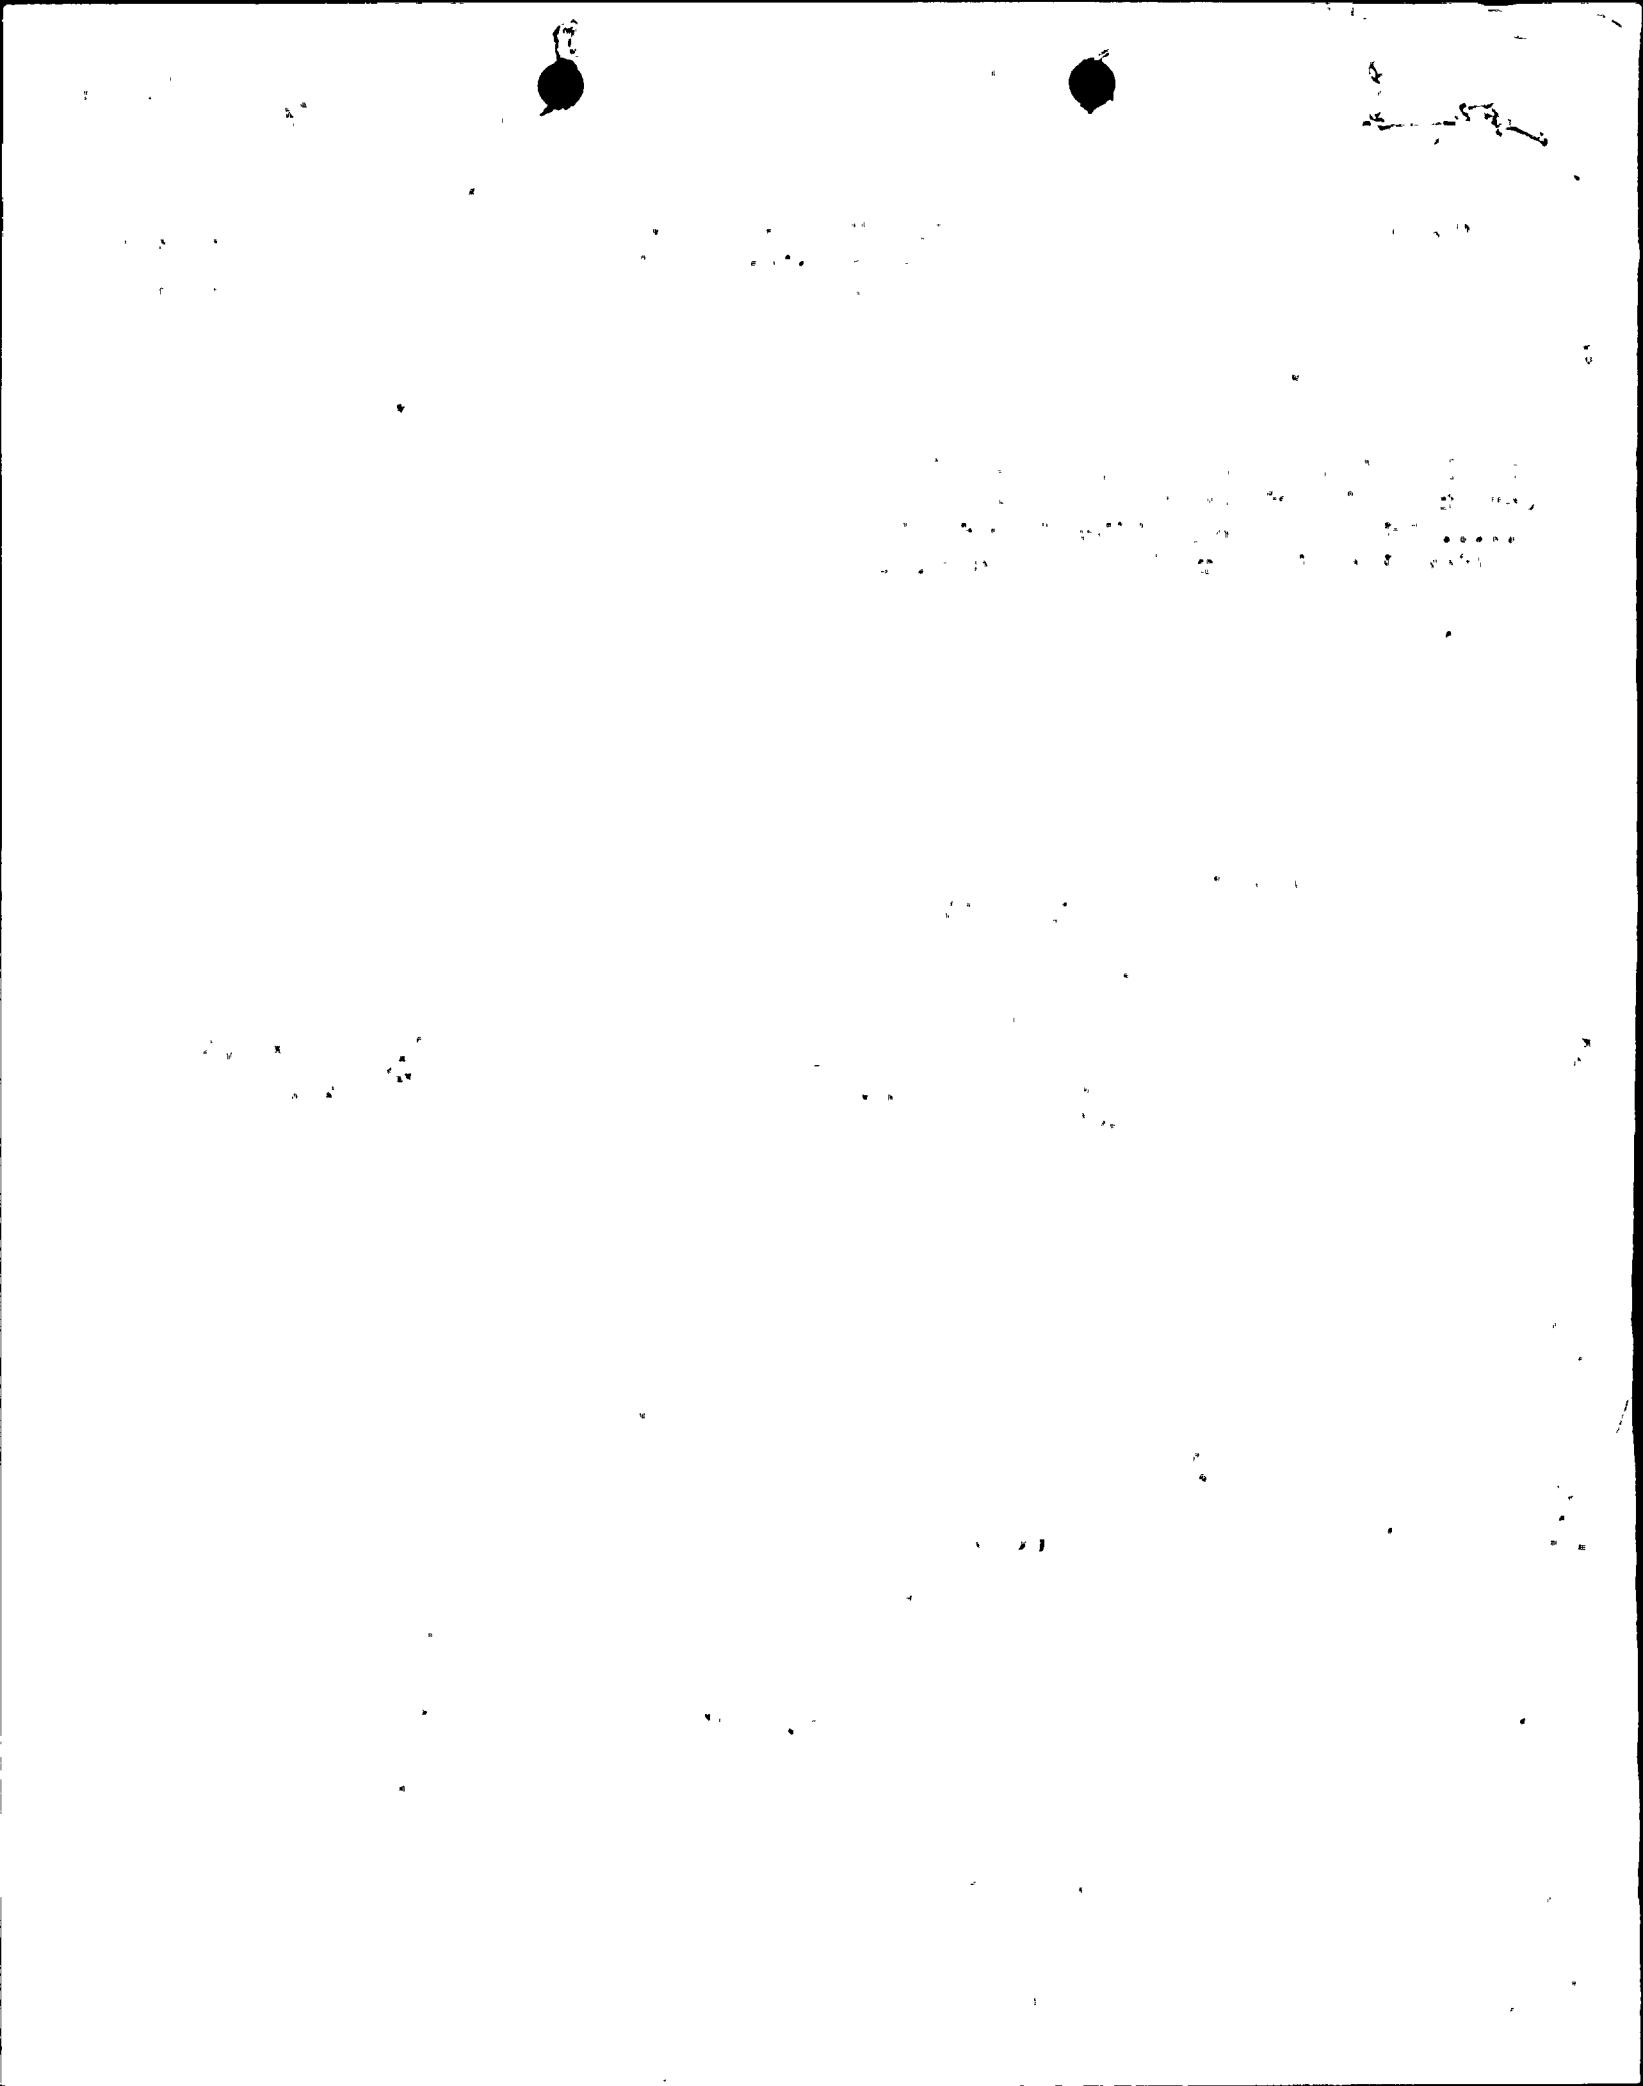

# REGULATORY DOCKET FILE COPY

## PACIFIC GAS AND ELECTRIC COMPANY

PG&E + 77 BEALE STREET, 31ST FLOOR • SAN FRANCISCO, CALIFORNIA 94106 • (415) 781-4211

JOHN C. MORRISSEY  
VICE PRESIDENT AND GENERAL COUNSEL

October 4, 1977

DILBERT L. HARRICK  
GLENN WEST, JR.  
CHARLES W. THIBELL  
DANIEL E. GIBSON  
JOSEPH I. KELLY  
HOWARD V. GOLUS

EDWARD J. MCGANNEY  
ARTHUR L. HILLMAN, JR.  
ROBERT OHLSBACH  
DAN GRAYSON LUSBOCK  
JACK F. FALLIN, JR.

MALCOLM H. FURBUSH  
ASSOCIATE GENERAL COUNSEL

SENIOR COUNSEL

CHARLES T. VAN DEUSEN  
PHILIP A. CRANE, JR.  
HENRY J. LAPLANTE  
RICHARD A. CLARKE  
JOHN B. GIBSON  
ASSISTANT GENERAL COUNSEL

JOSHUA BAR-LEV  
ROBERT L. BOADON  
LEIGH S. CABBODY  
ERIAN S. DENTON  
JOSEPH S. ENGLERT, JR.  
JOHN N. FRYE  
KATHY GRAHAM  
PETER W. HANSCHEM  
JUAN M. JAYO  
F. RONALD LAUPHEIMER  
MEREK E. LIPSON  
JAMES C. LOODDON  
RICHARD M. MOSS  
ROBERT R. RICKETT  
SHIRLEY A. SANDERSON  
JACK W. SHUCK  
SHIRLEY WOOD

J. PETER BAUMGARTNER  
STEVEN P. BURKE  
BERNARD J. DELLABANTA  
WILLIAM H. EDWARDS  
DONALD ERICKSON  
BARBARA A. GOODE  
ANNETTE GREEN  
ROBERT L. HARRIS  
KERNIT R. KUBITZ  
THEODORE L. LINDBERG, JR.  
RICHARD F. LODGE  
RICHARD L. NEISS  
DOUGLAS A. OGLESBY  
IVOR E. SAMSON  
SUE ANN SCHIFF  
DAVID J. WILLIAMSON  
BRUCE R. WORTHINGTON

Mr. John F. Stolz, Chief  
Light Water Reactors Branch No. 1  
Division of Project Management  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Re: Docket No. 50-275-OL  
Docket No. 50-323-OL  
Diablo Canyon Units 1 and 2



Dear Mr. Stolz:

Our Motion for Interim Operating License for Diablo Canyon Unit 1, dated August 25, 1977, states that

"Certain of the modifications required for the Hosgri event would be difficult to make after operation, primarily because the modifications require working for extended periods in areas where significant exposure of workers to radioactivity might be required. Modifications in this category would be limited to those inside the containment and to some systems and components in the auxiliary building which are associated with radwaste systems, the chemical and volume control system, and the residual heat removal system. PGandE will complete all such modifications prior to commencing operation of the Diablo Canyon Units."

We expect that the other modifications in the auxiliary building which have been identified in the Hosgri Evaluation Report (Amendment No. 50) and which could result in significant worker exposure also will be completed prior to operation. However, if we determine that these other modifications in the auxiliary building cannot be completed prior to operation, we will provide to you by February 15, 1978 a list of the remaining modifications with our estimate of the man-hours of work required, the expected dose rates in the work areas, and the man-rem exposure. We will also demonstrate that the exposures will be as low as reasonably achievable.

Very truly yours,

*Philip A. Crane*

CC: Service List

772870155

