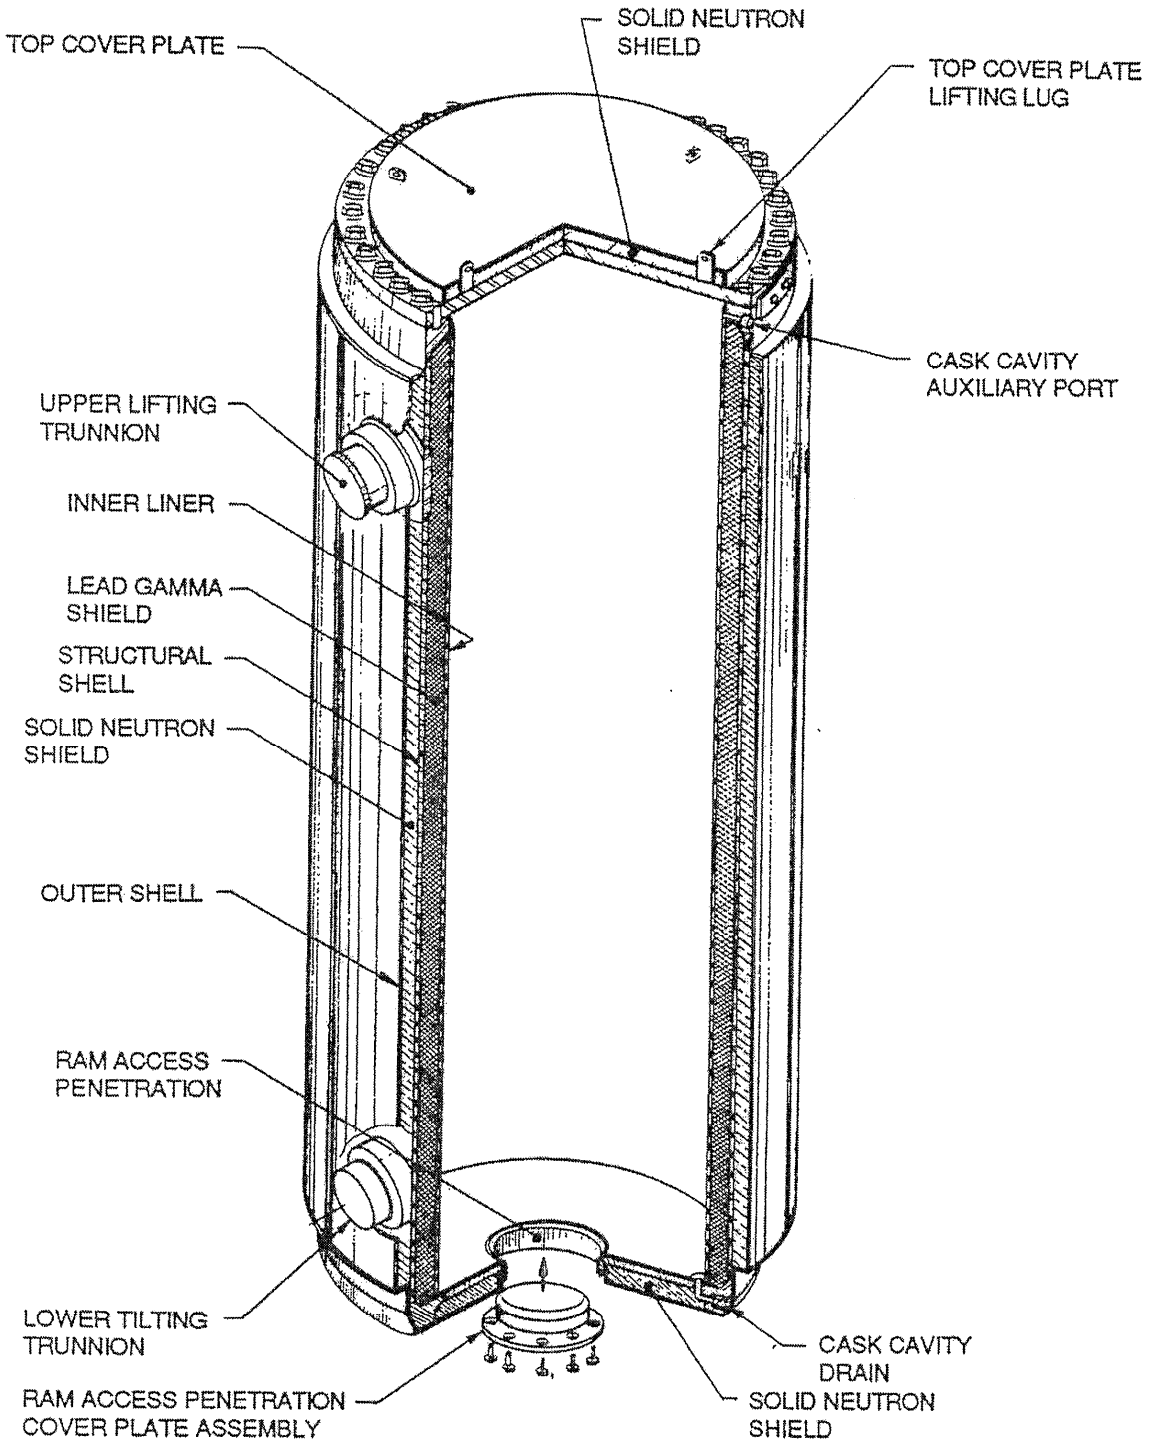

Calvert Cliffs Nuclear Power Plant, Independent Spent Fuel Storage Installation	NUHOMS ON-SITE TRANSFER CASK	USAR Figure 1.3-2 Revision 15