


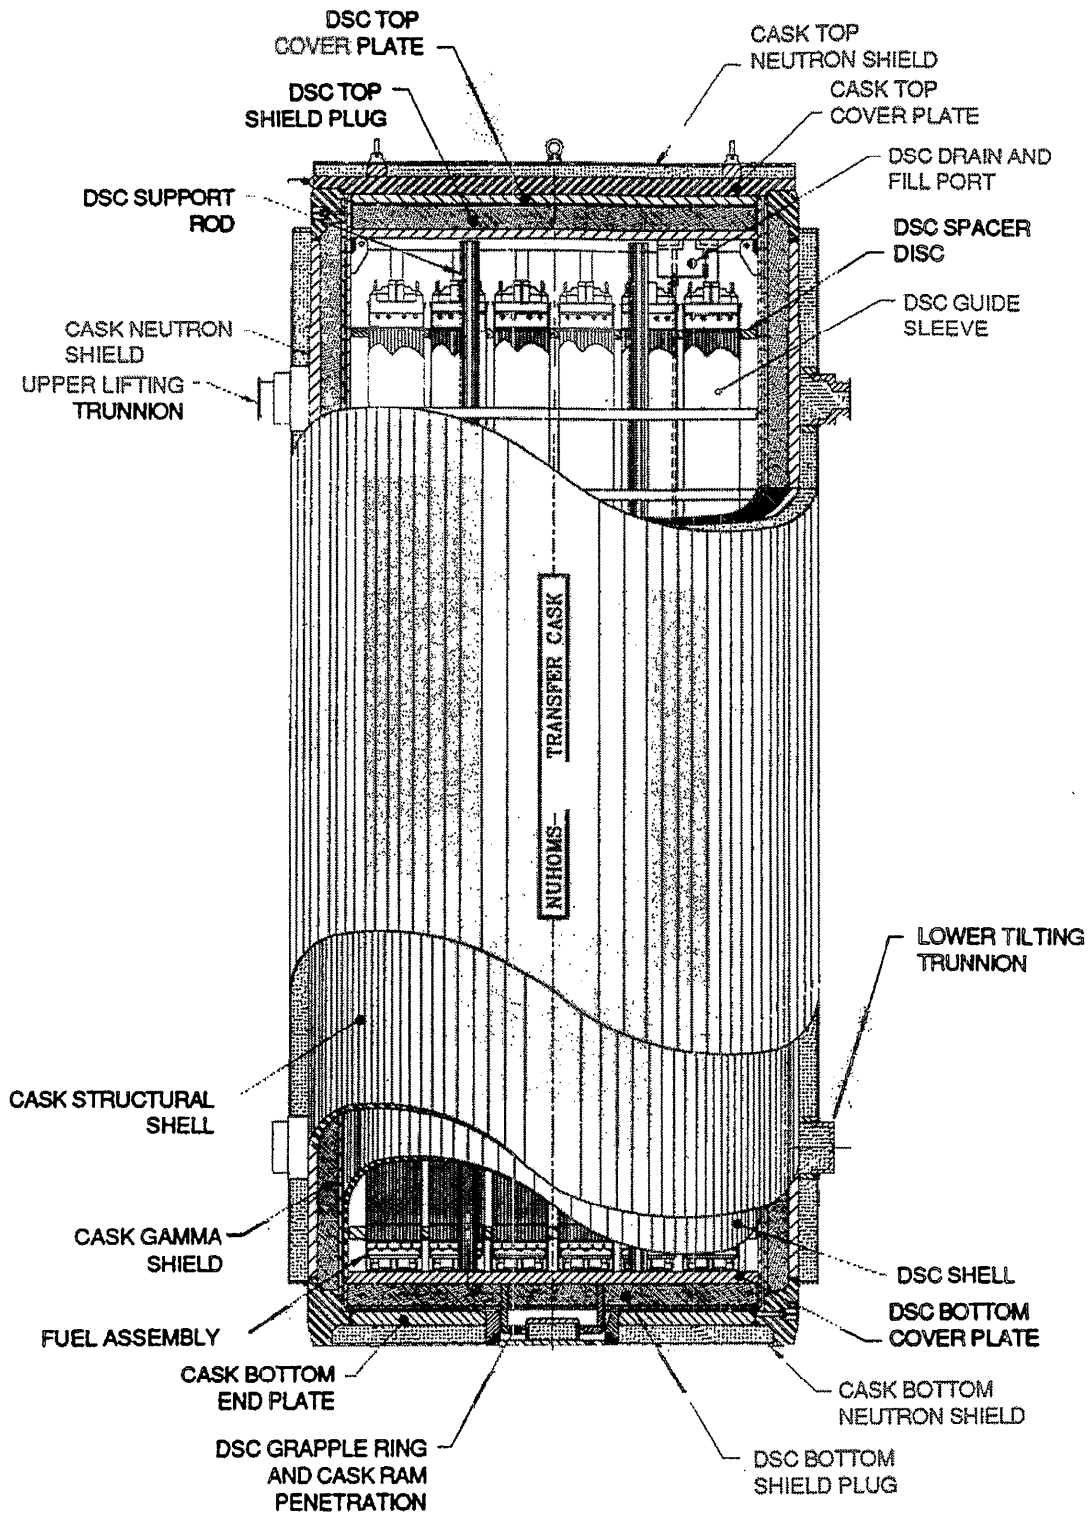

Calvert Cliffs Nuclear
Power Plant, Independent
Spent Fuel Storage
Installation

NUHOMS TRANSFER CASK
(Shown with a NUHOMS-24P DSC)

USAR
Figure 4.7-1
Revision 15