

COOK NUCLEAR PLANT

SUPE 2A | GNSLOOMO & GNSLOOTO CONCRETE THERMAL  
(NORMAL & ACCIDENT)

N11 & N22

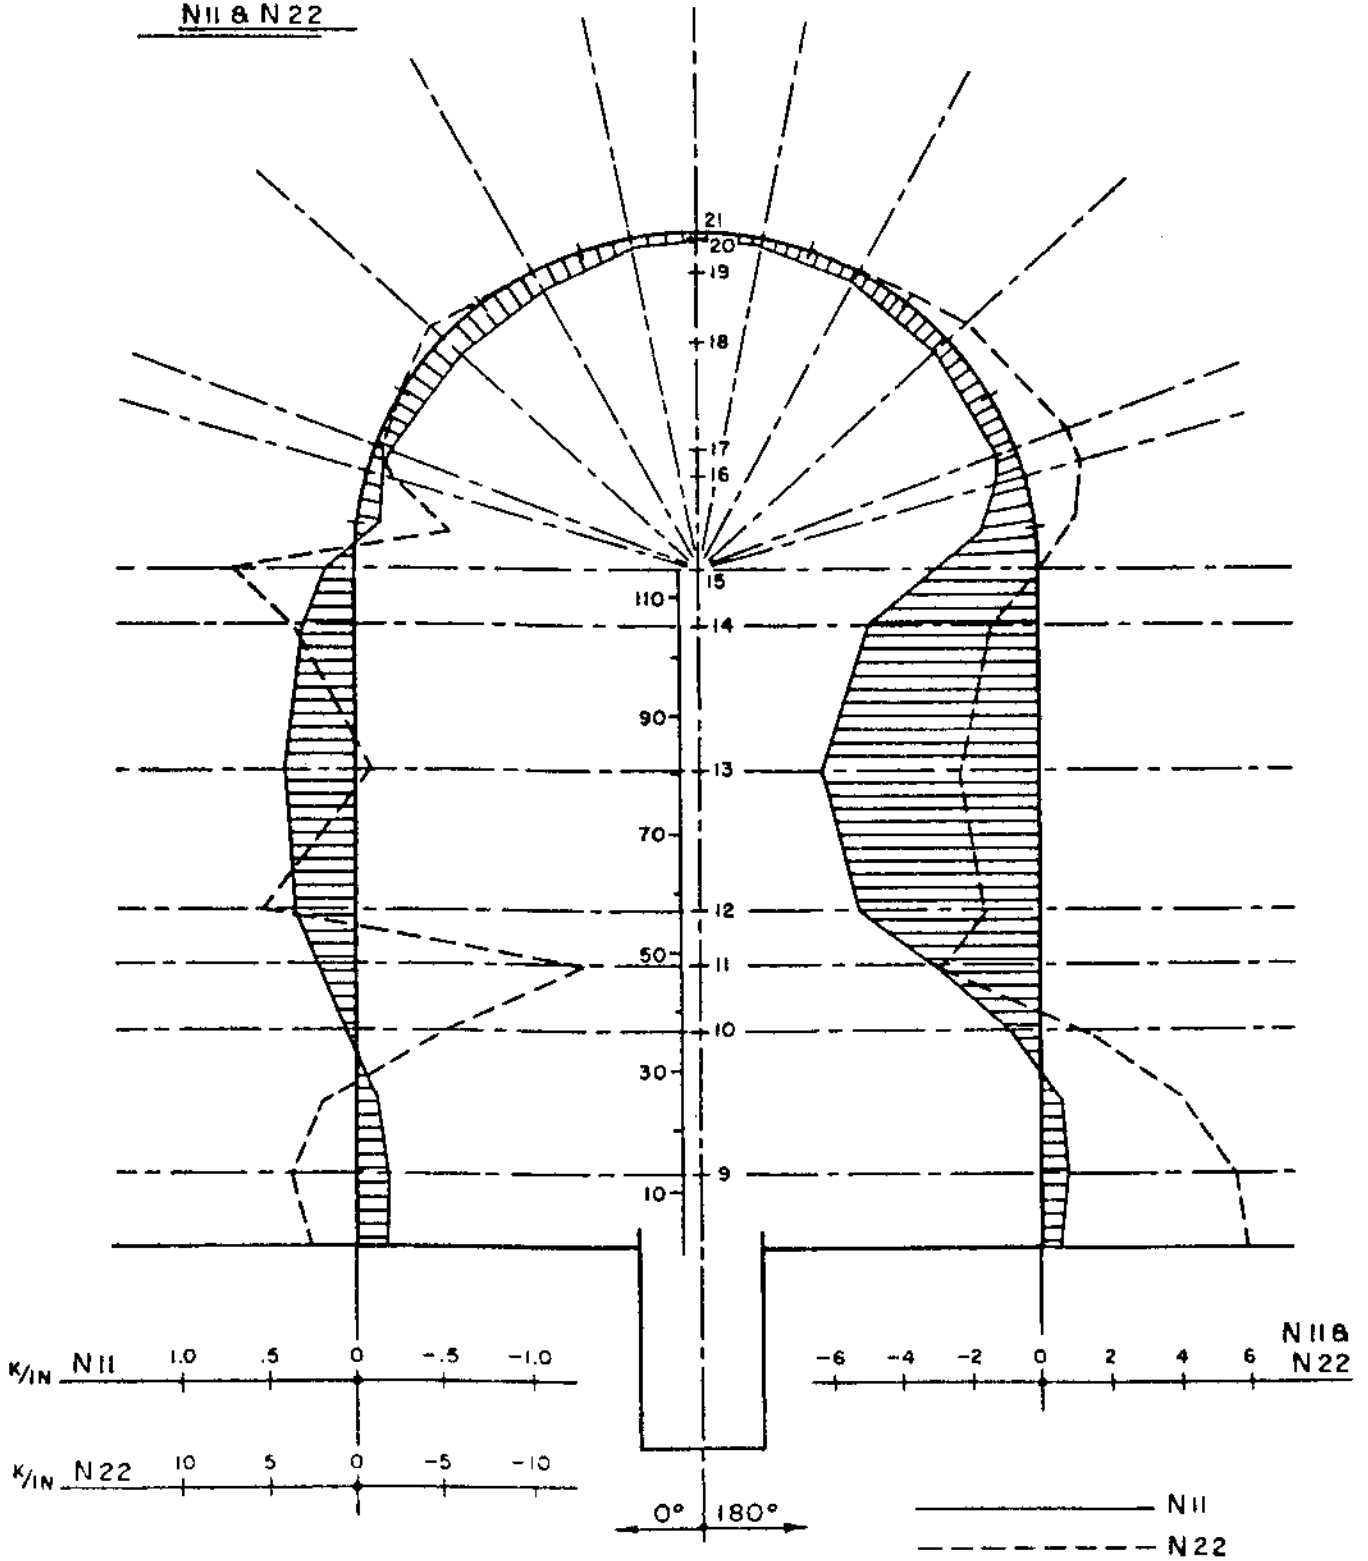


FIG. 5.2.2-41  
July 1982