

990X NUCLEAR PLANT
 COMPUTED STRAINS
 TESRUN 21 - COMB. 10E11, E22 (STRAIN)
 STRAIN DIAGRAMS DUE TO TESTING PRESSURE
 1.34P (16.1PSI) MERIDIAN DIRECTION-E22 HOOP DIRECTION

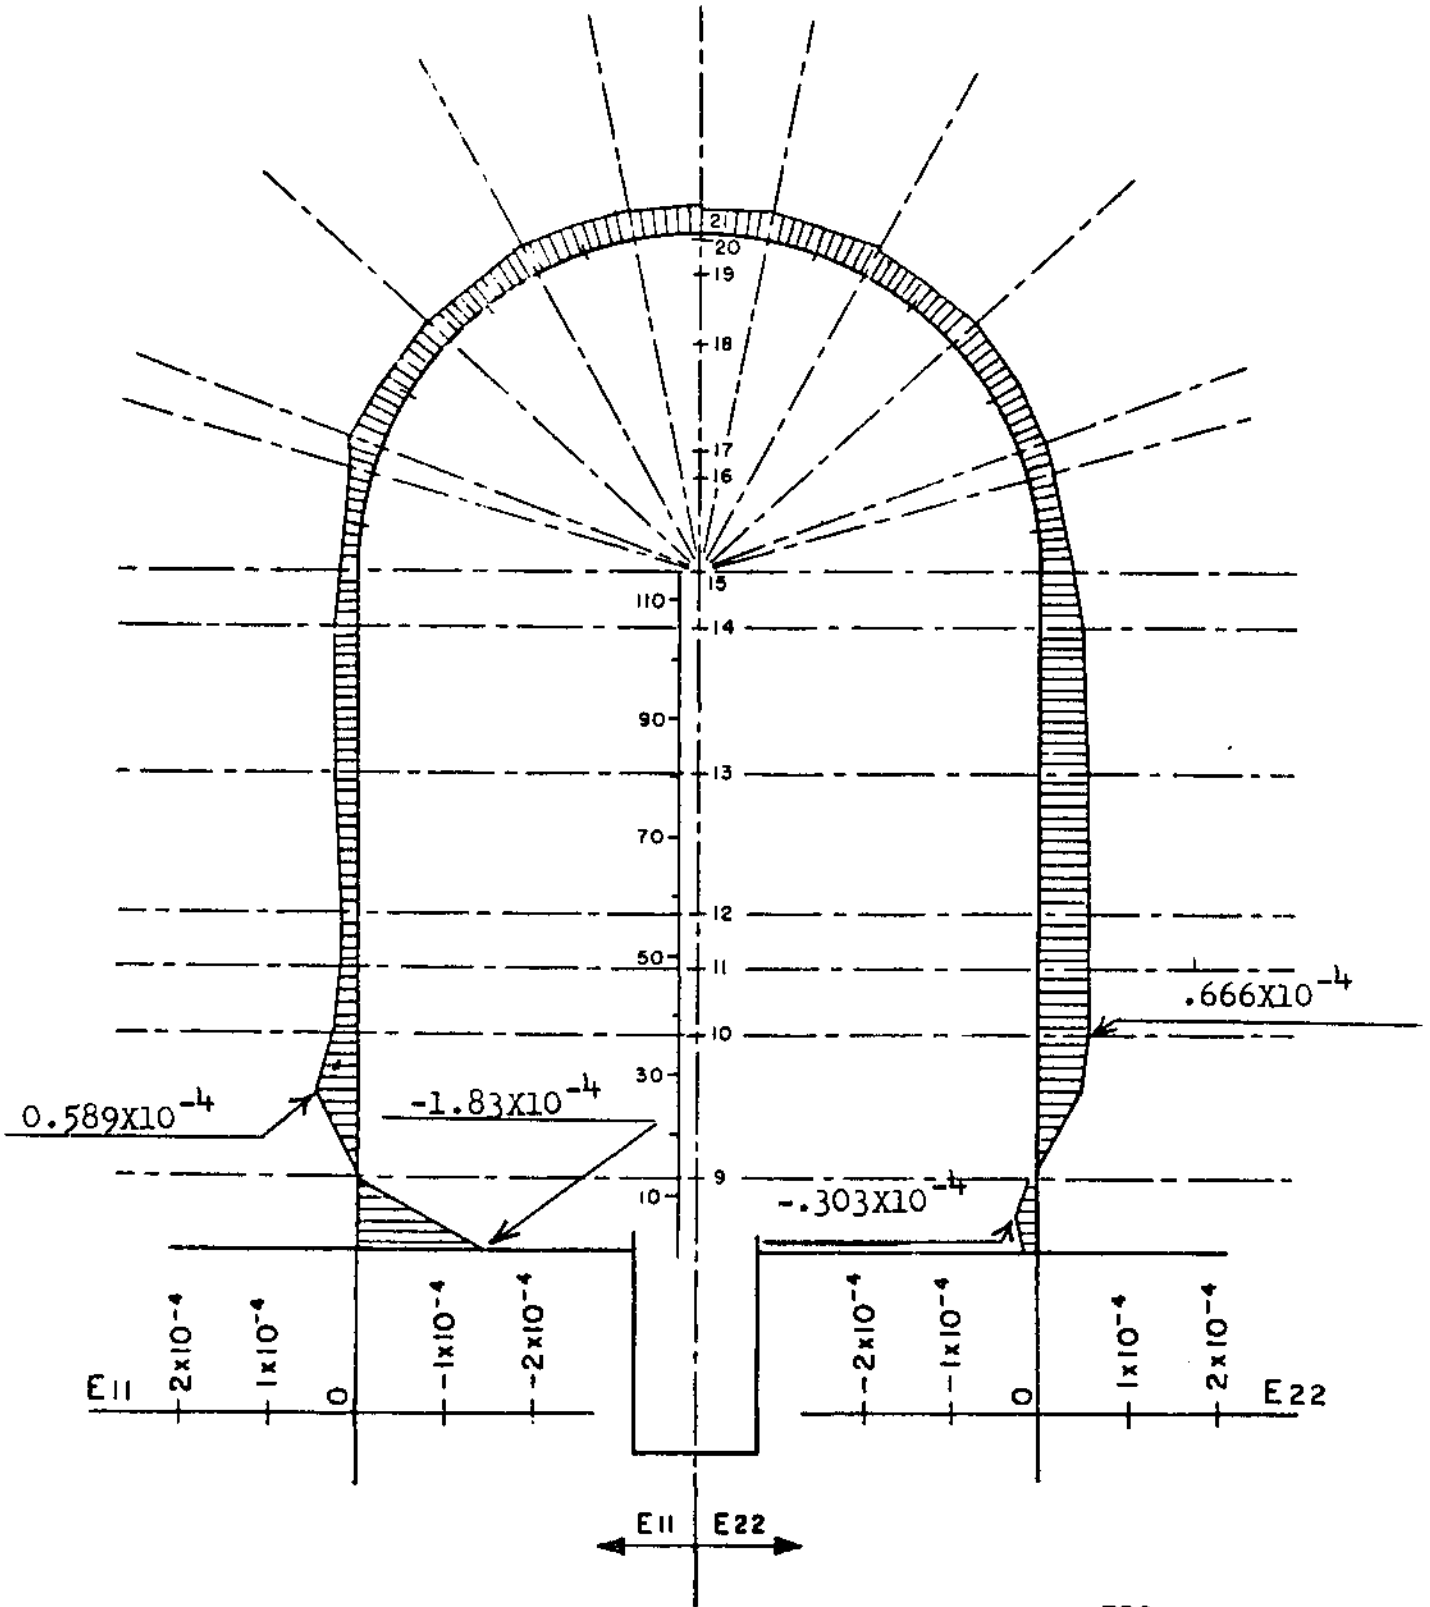


FIG. 5.7-1

July, 1982