

CATEGORY 1

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9711050034 DOC. DATE: 97/10/29 NOTARIZED: ~~NO~~ ^{YES} DOCKET #
 FACIL: 50-275 Diablo Canyon Nuclear Power Plant, Unit 1, Pacific Ga 05000275
 50-323 Diablo Canyon Nuclear Power Plant, Unit 2, Pacific Ga 05000323

AUTH. NAME AUTHOR AFFILIATION
 RUEGER, G.M. Pacific Gas & Electric Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Submits 30-day response to NRC GL 97-04, re "Assurance of Sufficient Net Positive Suction Head for ECC & Containment Heat Removal Pumps."

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2
 TITLE: OR Submittal: General Distribution


NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD4-2 LA		1	1		PD4-2 PD		1	1
	BLOOM, S.		1	1					
INTERNAL:	ACRS		1	1		<u>FILE CENTER 01</u>		1	1
	NRR/DE/ECGB/A		1	1		NRR/DE/EMCB		1	1
	NRR/DRCH/HICB		1	1		NRR/DSSA/SPLB		1	1
	NRR/DSSA/SRXB		1	1		NUDOCS-ABSTRACT		1	1
	OGC/HDS3		1	0					
EXTERNAL:	NOAC		1	1		NRC PDR		1	1

C
A
T
E
G
O
R
Y
1
D
O
C
U
M
E
N
T

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 13



Pacific Gas and Electric Company

245 Market Street, Room 937-N9B
San Francisco, CA 94105
Mailing Address
Mail Code N9B
P.O. Box 770000
San Francisco, CA 94177
415/973-4684 Fax 415/973-2313

Gregory M. Rueger
Senior Vice President and
General Manager
Nuclear Power Generation



October 29, 1997

PG&E Letter DCL-97-186

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555-0001

Docket No. 50-275, OL-DPR-80
Docket No. 50-323, OL-DPR-82
Diablo Canyon Units 1 and 2

30-Day Response to NRC Generic Letter 97-04, "Assurance of Sufficient Net Positive Suction Head for Emergency Core Cooling and Containment Heat Removal Pumps"

Dear Commissioners and Staff:

NRC Generic Letter (GL) 97-04, "Assurance of Sufficient Net Positive Suction Head for Emergency Core Cooling and Containment Heat Removal Pumps," was issued on October 7, 1997. GL 97-04 requires a response within 30 days, as identified below, and requests that information responding to the various issues identified in GL 97-04 be submitted within 90 days.

1/b

A001

Required Response

Within 30 days from the date of this generic letter, each addressee is required to submit a written response indicating (a) whether or not the requested information will be submitted, and (b) whether or not the requested information will be submitted within the requested time period. Addressees who choose not to submit the requested information, or are unable to submit the information within the requested period, must describe in their response an alternative course of action that is proposed to be taken, including the basis for the acceptability of the proposed alternative.

9711050034 971029
PDR ADDCK 05000275
P PDR

040632






PG&E Response

PG&E will provide the requested information within 90 days of the date of GL 97-04 as specified in the GL.



Sincerely,



Gregory M. Rueger

Subscribed and sworn to before me
this 29th day of October, 1997

Attorneys for Pacific Gas
and Electric Company
Roger J. Peters
Richard F. Locke




Notary Public

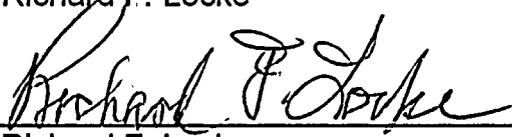

Richard F. Locke

- cc: Edgar Bailey, DHS
Steven D. Bloom
Ellis W. Merschoff
Kenneth E. Perkins
David L. Proulx
Diablo Distribution

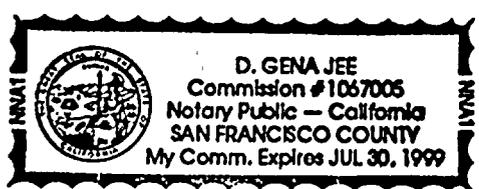

KEJ

