
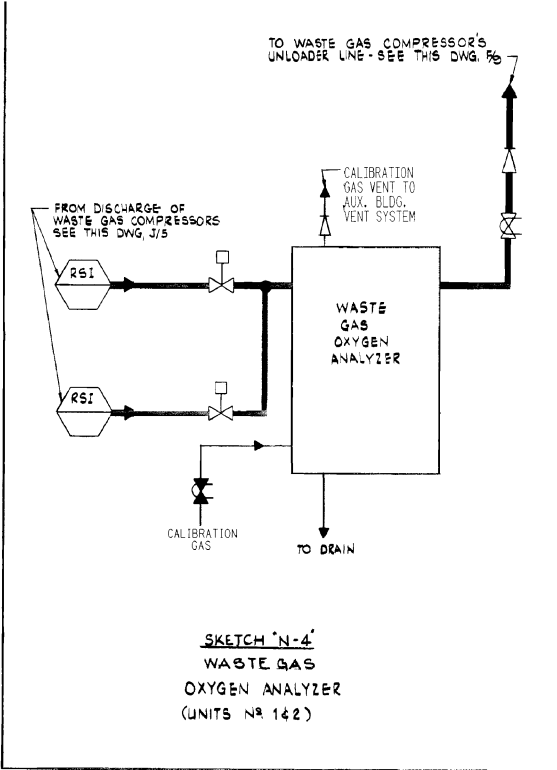


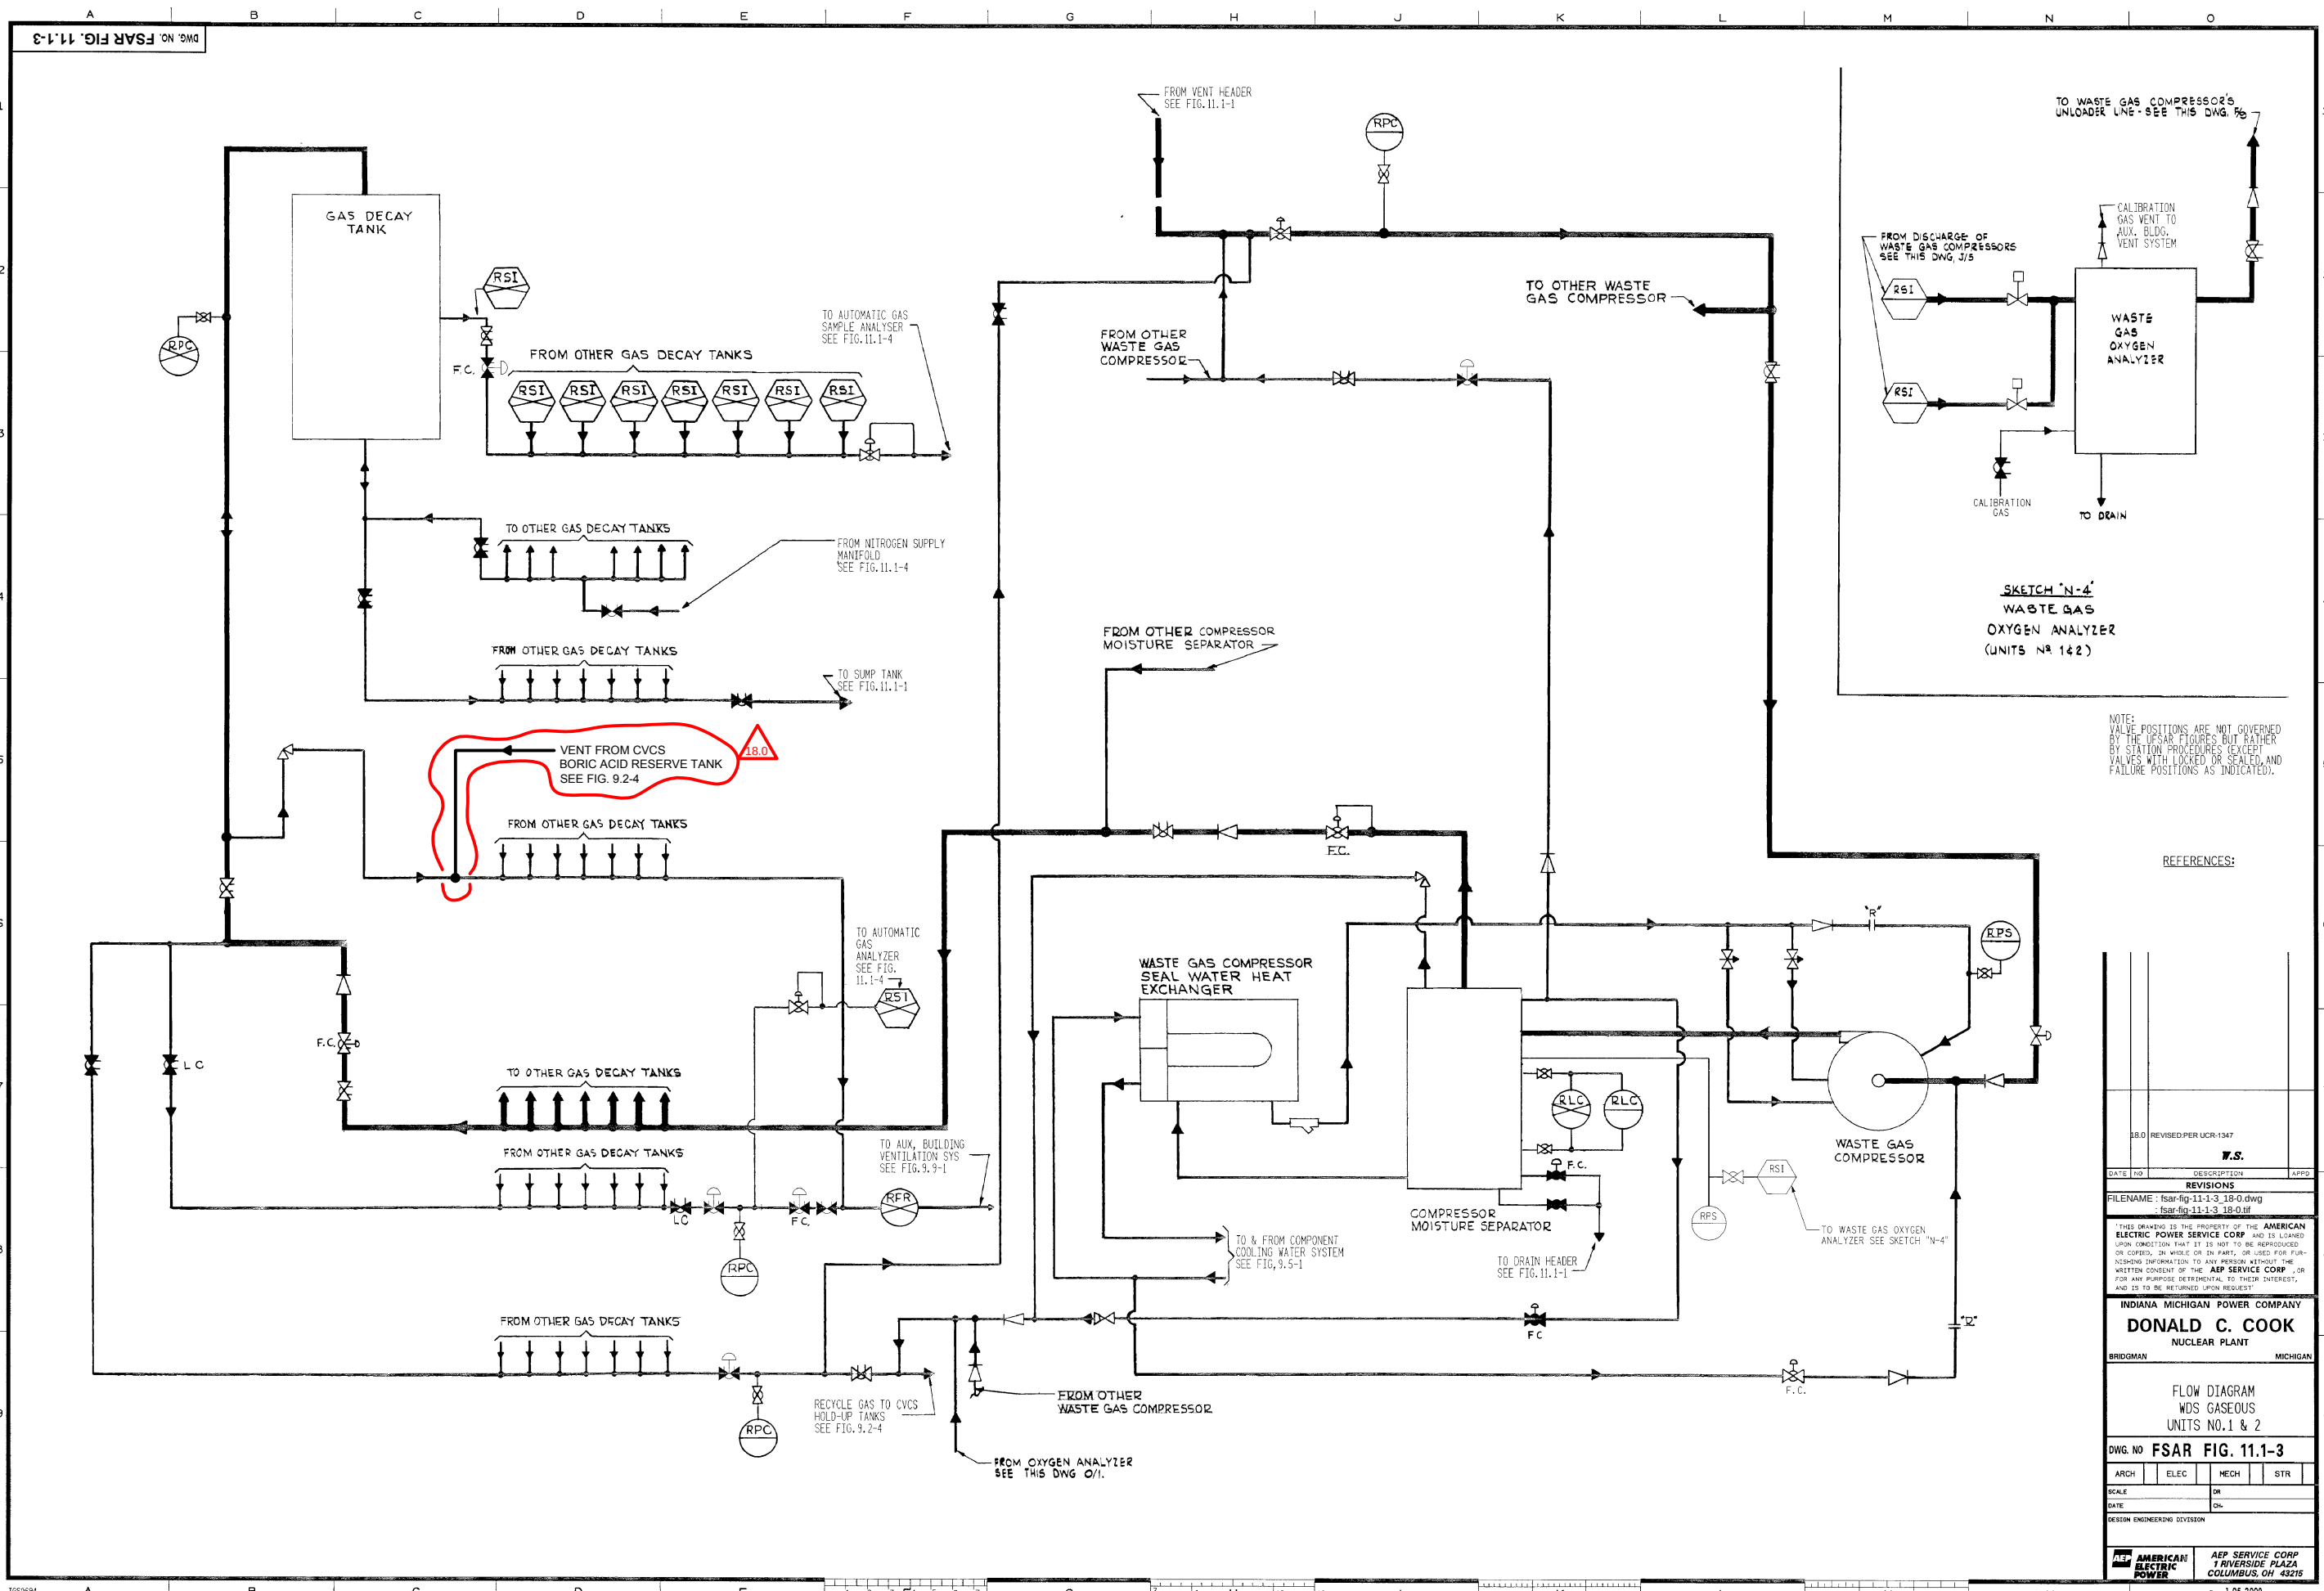

NOTE: VALVE POSITIONS ARE NOT GOVERNED BY THE FSAR FIGURES BUT RATHER BY STATION PROCEDURES (EXCEPT VALVES WITH LOCKED OR SEALED, AND FAILURE POSITIONS AS INDICATED).

REFERENCES:

18.0	REVISED PER UCR-1347	W.S.
DATE	NO.	DESCRIPTION
REVISIONS		
FILENAME: fsar-fig-11-1-3_18-0.dwg		
fsar-fig-11-1-3_18-0.tif		
THIS DRAWING IS THE PROPERTY OF THE AMERICAN ELECTRIC POWER SERVICE CORP. AND IS LOANED TO YOU ON THE CONDITION THAT IT IS NOT TO BE REPRODUCED, COPIED, OR IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE AEP SERVICE CORP., OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST.		
INDIANA MICHIGAN POWER COMPANY		
DONALD C. COOK		
NUCLEAR PLANT		
BRIDGMAN	MICHIGAN	
FLOW DIAGRAM		
WDS GASEOUS		
UNITS NO. 1 & 2		
DWG. NO. FSAR FIG. 11.1-3		
ARCH	ELEC	MECH
SCALE	OR	STR
DATE	OR	
DESIGN ENGINEERING DIVISION		
AEP SERVICE CORP.		
1 RIVERSIDE PLAZA		
COLUMBUS, OH 43215		
1-05-2000		
141358		