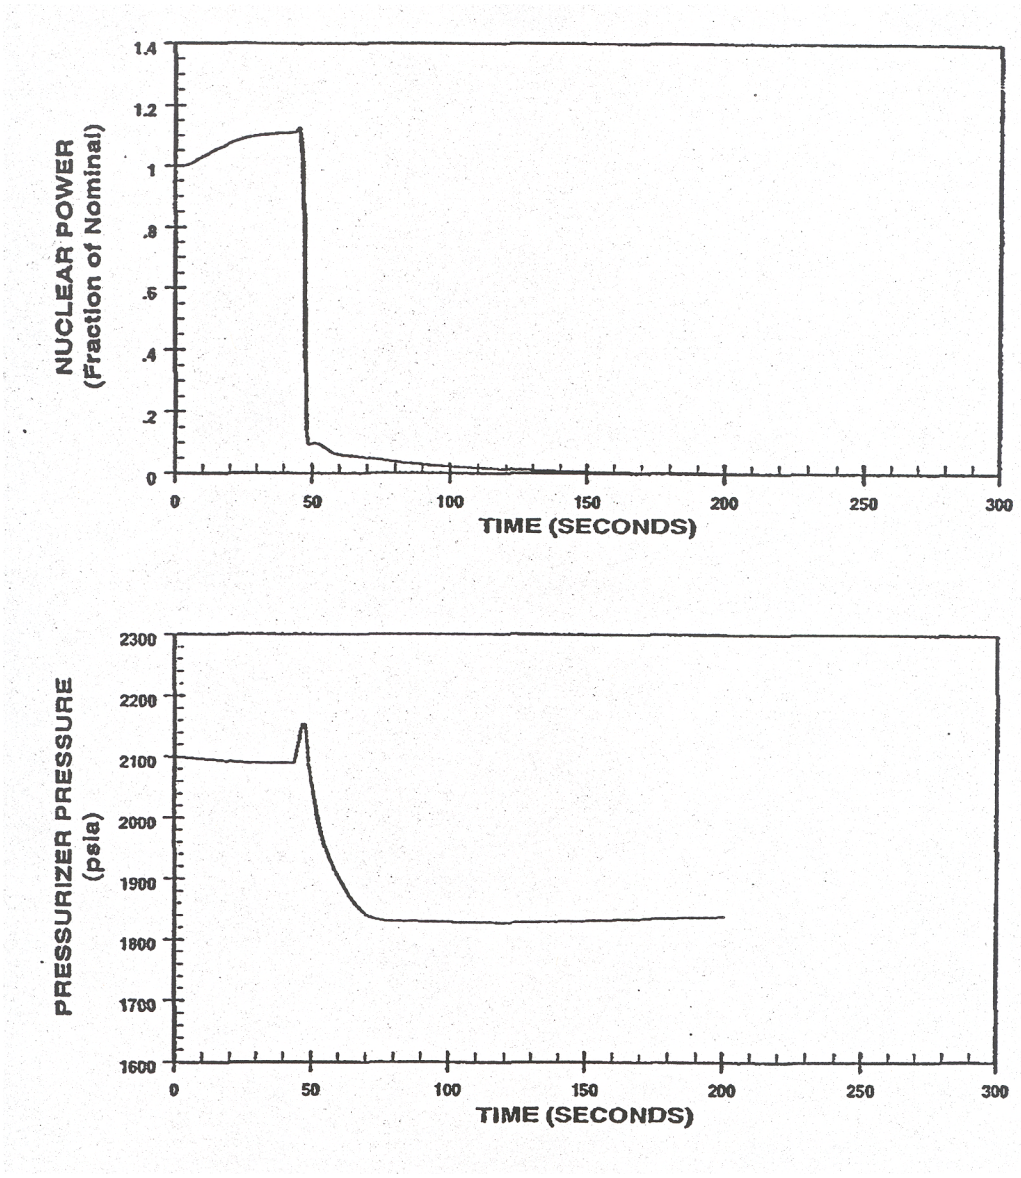

Revision: **18.1**	Change Description: **UCR-1667**

AMERICAN ELECTRIC POWER COOK NUCLEAR PLANT NUCLEAR GENERATION GROUP BRIDGMAN, MICHIGAN	Title: **Nuclear Power and Pressurizer Pressure vs. Time For Single Loop Feedwater Malfunction With Manual Rod Control at Full Power**	
	UFSAR Figure: **14.1.10-3**	Sheet 1 of 1