


DC Cook Unit 2 Containment Backpressure Comparison

— WCOBRA/TRAC Containment Backpressure
 - - - LOTIC2 Calculated Containment Backpressure

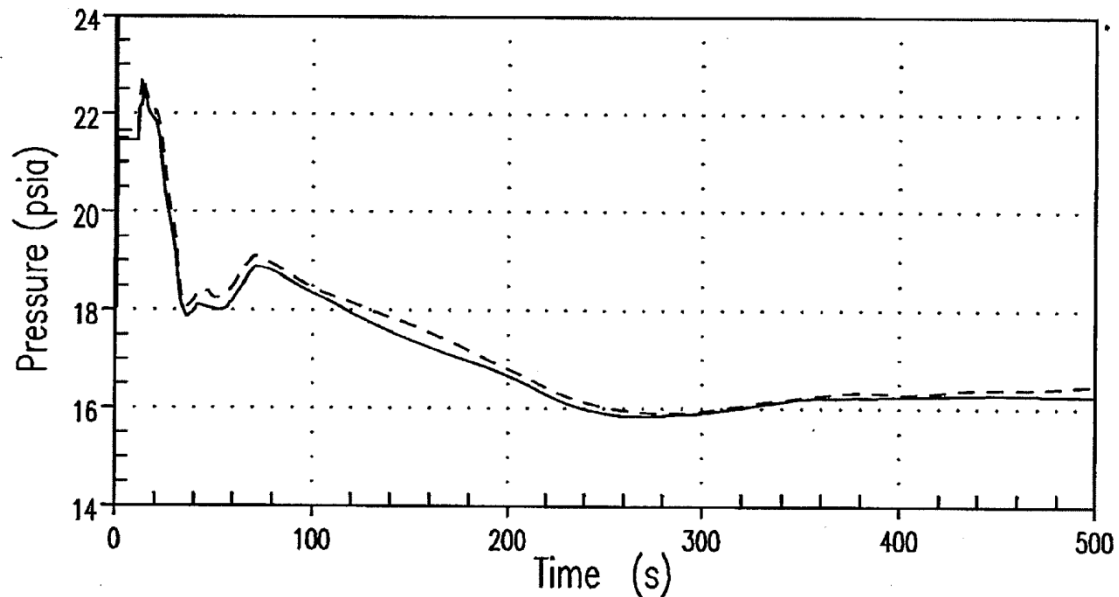

Notes:

1. Due to errors identified with the LOTIC2 containment backpressure calculation, an evaluation was performed assuming a revised initial CTS temperature. See Section 14.3.1.5 for more information.

Revision: **24.0**

Change Description: **UCR-1974, Rev. 0**

AMERICAN ELECTRIC POWER
 COOK NUCLEAR PLANT
 NUCLEAR GENERATION GROUP
 BRIDGMAN, MICHIGAN

Title: **D.C. Cook Unit 2**
Lower Bound Containment Pressure

UFSAR Figure: **14.3.1-3**

Sheet 1 of 1