


— L1 (Broken Loop - CHG Flow)
 - - - L1 (Broken Loop - HHSI/RHR Flow)
 - - - L2 (Intact Loop)
 — L3 (Intact Loop)
 - - - L4 (Intact Loop)

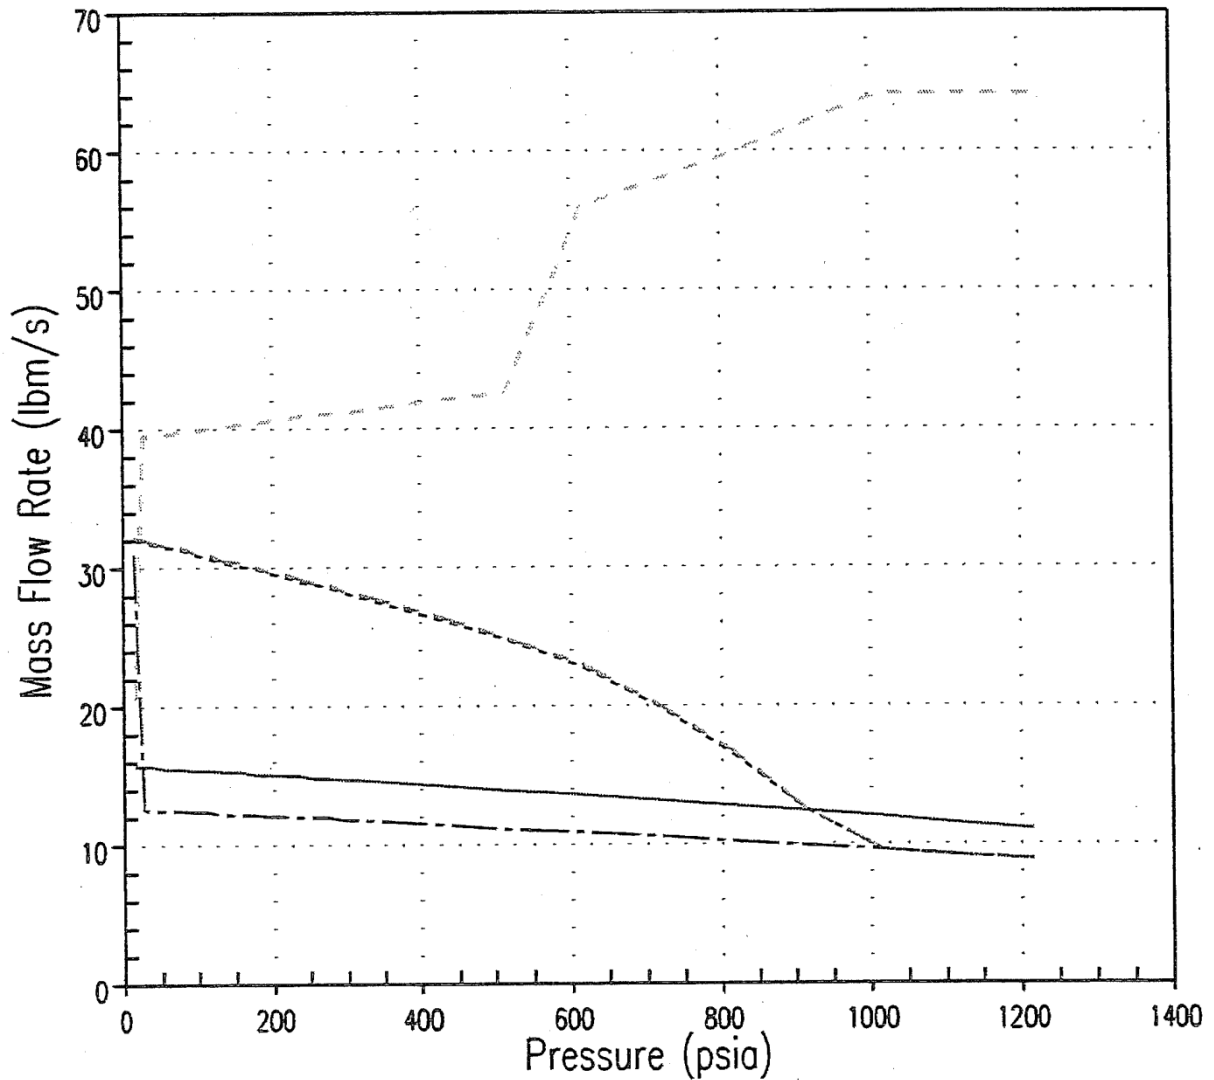

Revision: **24.0**

Change Description: **UCR-1966, Rev. 0**

AMERICAN ELECTRIC POWER
 COOK NUCLEAR PLANT
 NUCLEAR GENERATION GROUP
 BRIDGMAN, MICHIGAN

Title: **Pumped Safety Injection Flow Rate -
 Recirculation Phase - Faulted Loop Spilling to RCS Pressure
 Faulted Loop HHSI / RHR Spilling to Containment Pressure**

UFSAR Figure: **14.3.2-4**

Sheet 1 of 1