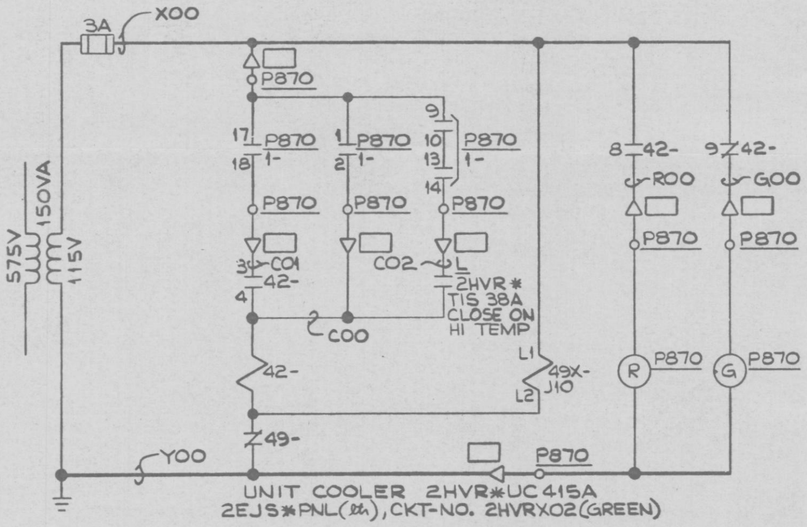

UNIT COOLER 2HVR*UC415A
2EJS*PNL(ft), CKT-NO. 2HVRX02(GREEN)

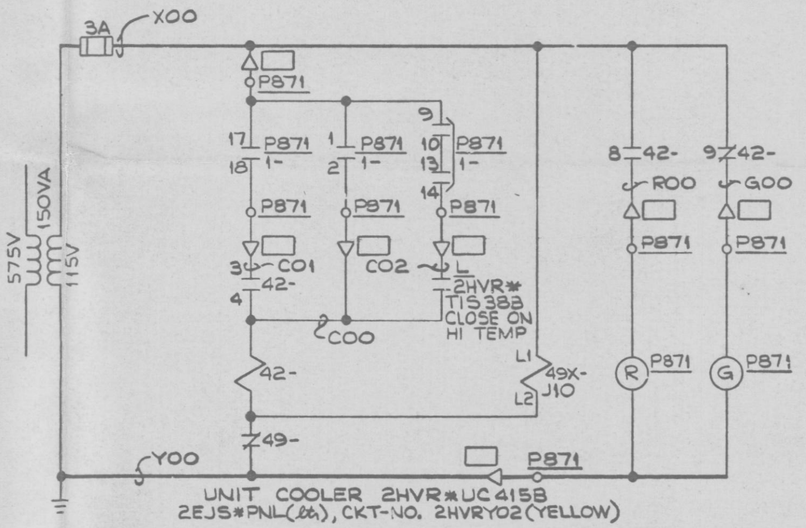

UNIT COOLER 2HVR*UC415B
2EJS*PNL(ft), CKT-NO. 2HVRY02(YELLOW)





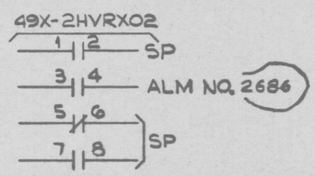





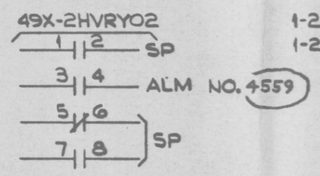

PRC APERTURE CARD

NOTES:
1. ALL EQUIPMENT LOCATED AT UNIT COOLER UNLESS OTHERWISE NOTED
2. LOGIC DIAG LSK-22-1H

CS	DETAIL	ESK	SPARE	USED ON
1-2HVRX02, 1-2HVRY02	TYP "R"	3C	3-4,5-6,7-8, 11-12,15-16,19-20	—

NUCLEAR SAFETY RELATED
QA CAT I

DESIGN CONTROL ISSUE 2		DESIGN CONTROL ISSUE 1	
2	ECN-003	1	

AC ELEM DIAG-600V CKTS
REACTOR BUILDING UNIT COOLERS
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION
12177-ESK-6HVR30

GE-NED | GE-LSTG

D