
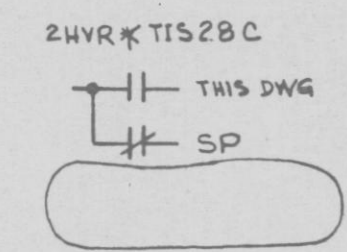
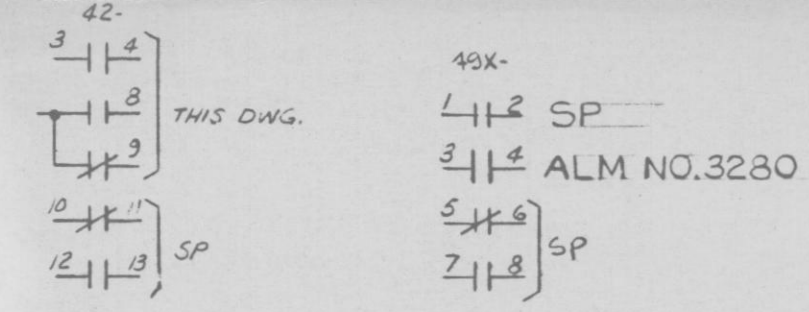


PRC
APERTURE
CARD

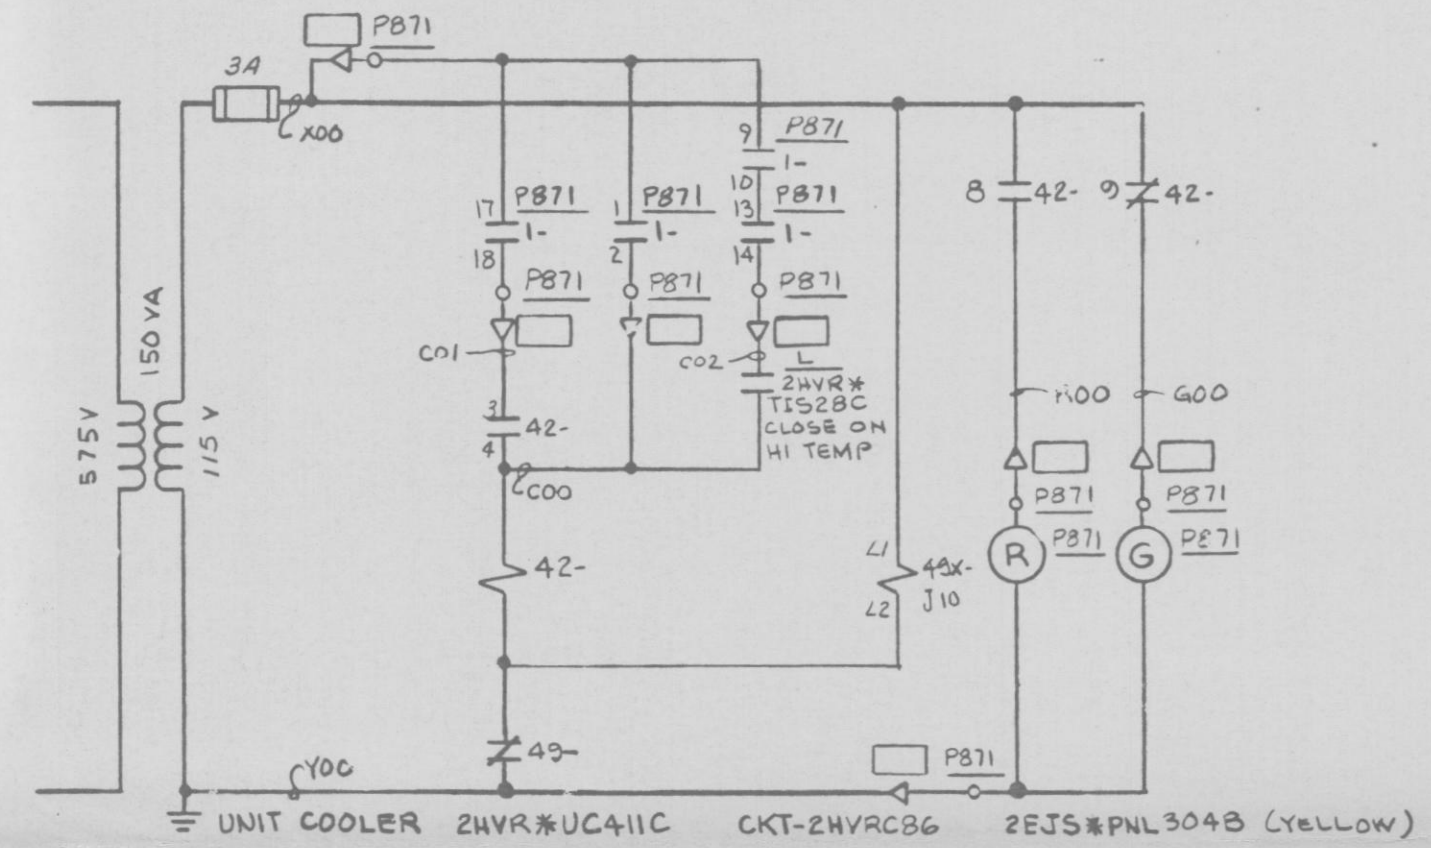

NOTES
1. ALL EQUIPMENT LOCATED AT UNIT COOLER
UNLESS OTHERWISE NOTED
2. LOGIC DIAG. LSK-22-1H

CS	DETAIL	ESK	SPARE	USED ON
1-2HVR20 1-2HVR20	TYP "R"	3C	3-4, 5-6, 7-8, 11-12, 15-16, 19-20	-

NUCLEAR SAFETY RELATED
QA CAT I
AC ELEM DIAG-600V CKTS
REACTOR BLDG UNIT COOLERS
NINE MILE POINT NUCLEAR STATION-UNIT2
NIAGARA MOHAWK POWER CORPORATION

DESIGN CONTROL ISSUE	REV	PGCC	PGCC
5	1/28/80	M	7/24/76
4	1/28/80	M	11/24/76
3	1/28/80	M	6-23-77
2	1/28/80	M	11/24/76
1	1/28/80	M	6/28/76

STONE & WEBSTER ENGINEERING CORPORATION
12177-ESK-6HVR25

GE-NEED
GE-1STG

350 76

D