
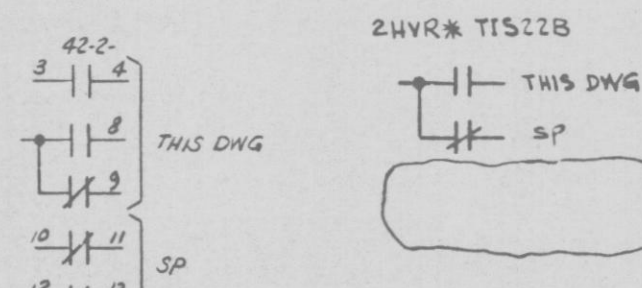
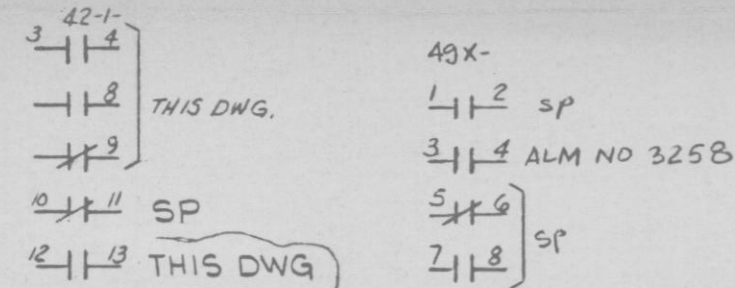


PRC
APERTURE
CARD

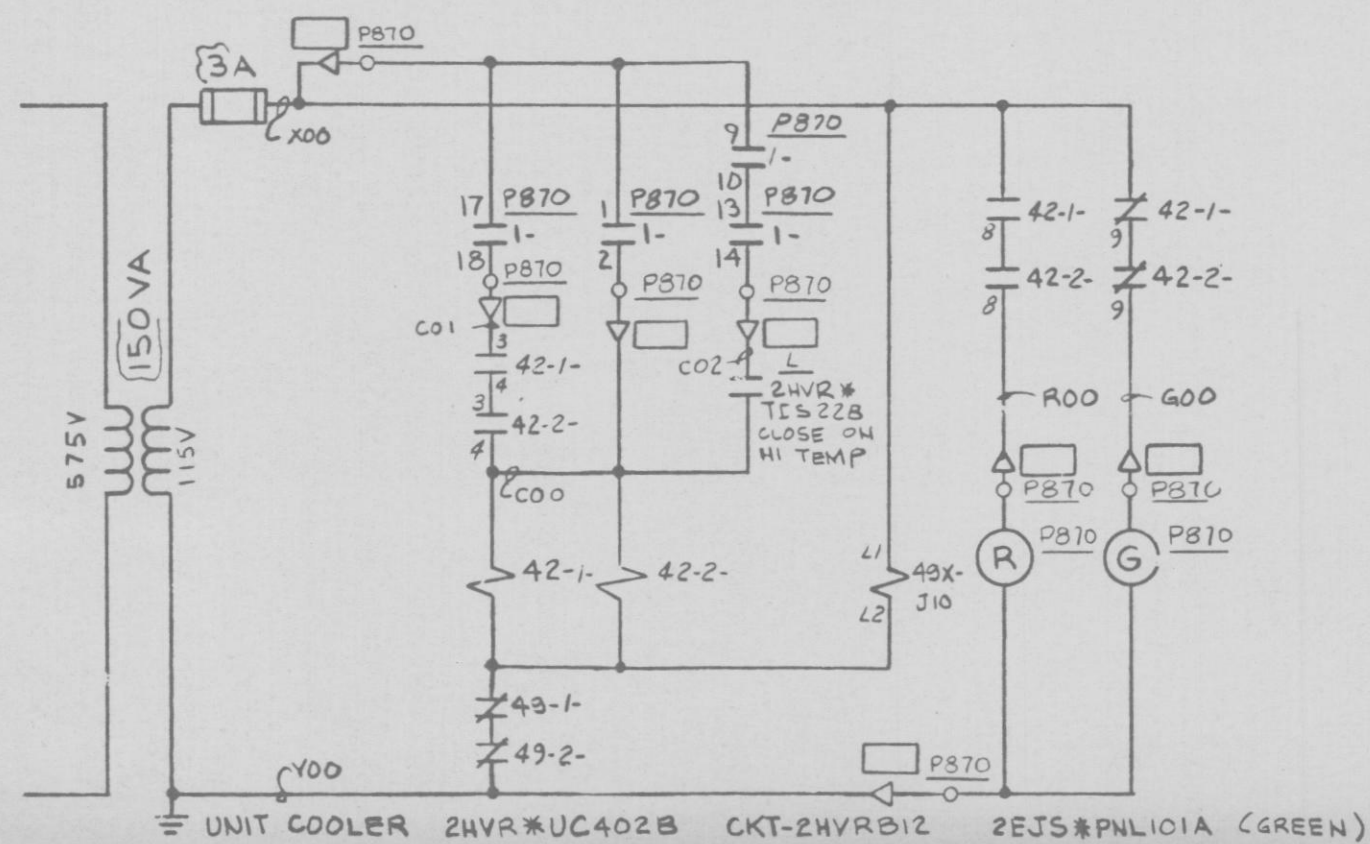

NOTES
1. ALL EQUIPMENT LOCATED AT UNIT COOLER
UNLESS OTHERWISE NOTED
2. LOGIC DIAG. LSK-22-1H

CS	DETAIL	ESK	SPARE	USED ON
1-2HVRA12	"R"	3C	3-4,5-6,7-8,11-12,15-16,19-20	[Symbol]
1-2HVRB12	"R"	3C	3-4,5-6,7-8,19-20	

NUCLEAR SAFETY RELATED
QA CAT I
AC ELEM DIAG-600V CKTS
REACTOR BLDG UNIT COOLERS
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

DESIGN CONTROL ISSUE	REV	PGCC	PGCC
5	10-9-80	M	6-23-77
4	2-4-76	M	11/24/76
3	10-1-75	M	4/29/76
2	10-1-75	M	1/23/76
1	10-1-75	M	1/23/76

STONE & WEBSTER ENGINEERING CORPORATION
12177-ESK-6HVR14

RK

8 1014

STO '76

GE-NEED ✓ GE-LSTG

D