


PRC
APERTURE
CARD

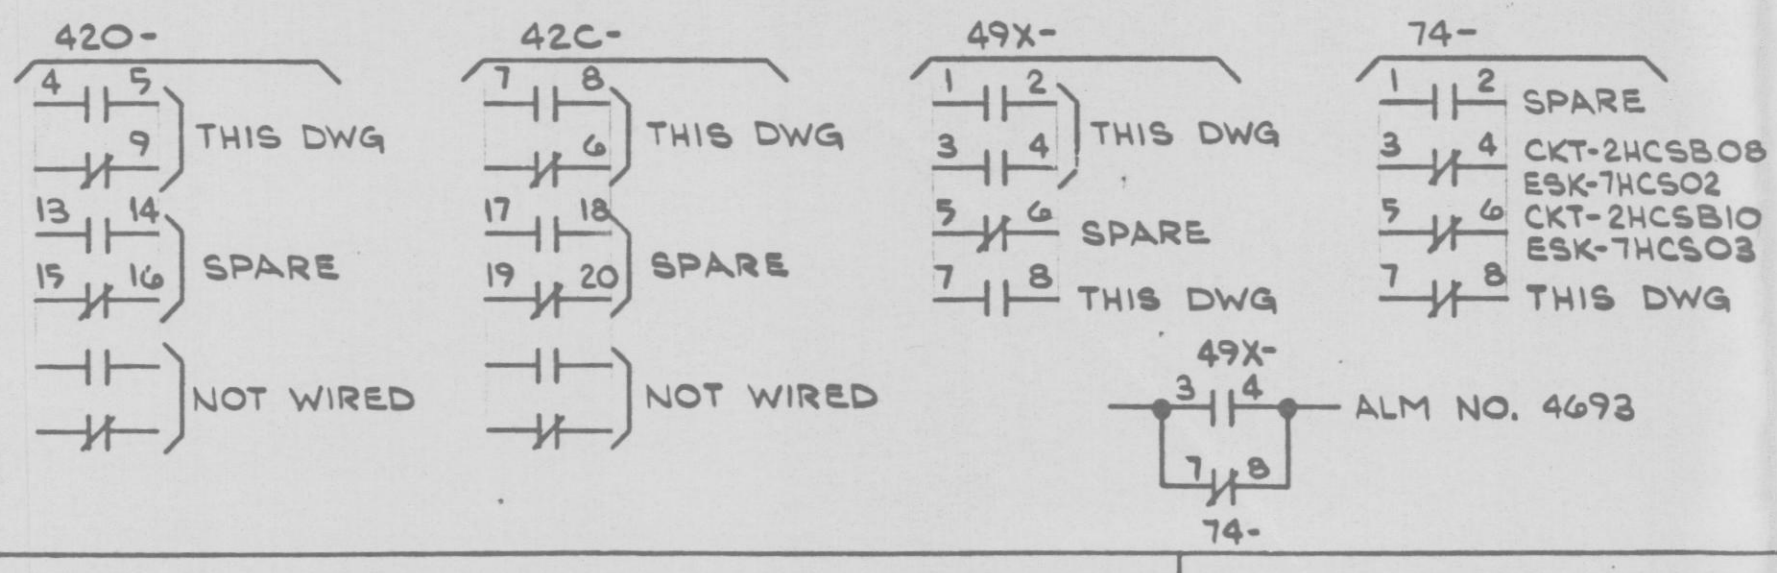

CS	DETAIL	ESK	SPARES	USED ON
1-2HCSB06	"H5"	3B	1T, 1B	

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG-600V MCC CKTS
DBA HYDROGEN RECOMBINER
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

Stone & Webster Engineering Corporation

12177-ESK-6HCS06 SH 2 OF 2

REDRAWN
DESIGN CONTROL
ISSUE 2

7/26/92
ECN-001, 003, 007

JRM

11	10	9	8	7
----	----	---	---	---

D