
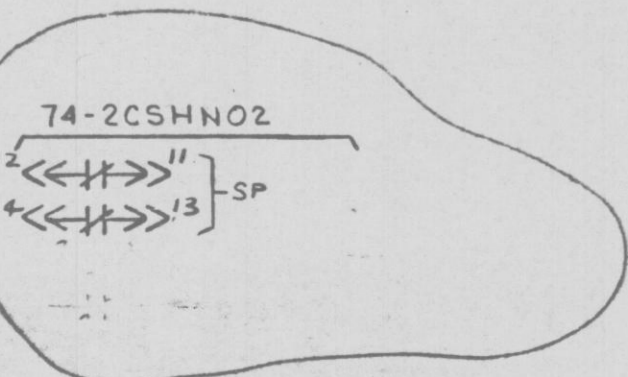


HPCS WATER LEG PMP 2CSH * P2 (GE. NO. E22-C003)
 CKT 2CSHNO2 MCC 2EHS * MCC 201 (PURPLE)

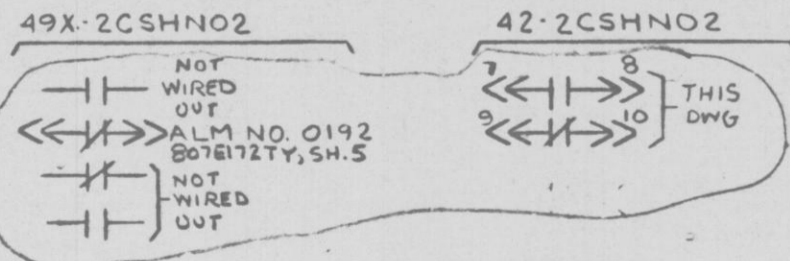

PRC
 APERTURE
 CARD

- NOTES:
1. ALL EQUIPMENT LOCATED AT MCC UNLESS OTHERWISE NOTED.
 2. APPLICABLE GE FCD-731E950
 3. APPLICABLE G.E. ELEM-807E152TY
 4. ALL GE CONTROL ELEMENTS PREFIXED BY "E22" DESIGNATOR.

CONTROL ELEMENT
 S3 REFERENCE GE. DWG
 807E171TY, SM.4

NUCLEAR SAFETY RELATED
 QA CAT I

AC ELEM DIAG-G00V MCC CKT
 HPCS WATER LEG PUMP
 NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION
 STONE & WEBSTER ENGINEERING CORPORATION

7	6	5	4	3	2	1
				M 3/27/81	M 4/1/81	9/29/73
				DESIGN CONTROL ISSUE	REDRAWN	RLA/SD EP LSB GRT
				3	2	1
				M.M.		

12177-ESK-6CSH01

D